



ORLEN SYNTHOS GREEN ENERGY

SMALL MODULAR NUCLEAR POWER PLANT

PROJECT INFORMATION SHEET

INVESTOR

BWRX-300 Ostrołęka sp. z o.o.
with its registered office in Warsaw,
Al. Jana Pawła II 22
00-133 Warsaw


CONTRACTOR

Team of authors: ORLEN Synthos Green Energy Sp. z o.o.

WARSAW, AUGUST 2023

Investor	BWRX-300 Ostrołęka sp. z o.o.
----------	--------------------------------------

Contractor	Team of authors: ORLEN Synthos Green Energy sp. z o.o.
------------	---

Team manager	Name	Signature
	Wojciech Januszczak	



■ TABLE OF CONTENTS

1. INTRODUCTION	10
2. OBJECTIVE AND SCOPE OF THE PROJECT INFORMATION SHEET	10
3. THE RATIONALE FOR THE CONSTRUCTION OF A NUCLEAR POWER PLANT BASED ON SMALL NUCLEAR REACTORS	12
3.1. THE ENERGY MIX OF POLAND	12
3.2. EMISSIVITY OF THE POWER SYSTEM	13
3.3. CLIMATE GOALS	14
3.4. NATIONAL ENERGY POLICY	15
3.4.1. Strategy for responsible development.....	15
3.4.2. Polish Energy Policy until 2040.....	16
3.4.3. Polish Nuclear Power Program	17
3.5. RATIONALE FOR THE CONSTRUCTION OF THE SMR	18
4. DESCRIPTION OF THE PROJECT	20
4.1. SCALE AND FEATURES OF THE PROJECT	20
4.1.1. Staging of the Project.....	21
4.2. PROJECT LOCATION.	21
4.2.1. Project Site (power part)	23
4.2.2. Project Site (water intake, pumping station, and water pipelines).....	24
4.2.3. Project Site (power output).....	26
4.2.4. Development of the Project site	27
4.2.5. Anticipated surface area of the Site	29
4.2.6. Local Development Plan	30
5. NUCLEAR POWER – GENERAL INFORMATION	32
5.1. NUCLEAR POWER PLANT – PRINCIPLE OF OPERATION	33
5.1.1. Fission reaction.....	33
5.1.2. Nuclear fuel	34
5.1.3. Water – moderator and coolant.....	34
5.1.4. Energy generation	35
5.2. COMPONENTS OF A NUCLEAR POWER PLANT	35
5.3. POWER PLANT COOLING CIRCUIT	36
5.3.1. Once-through cooling system	36
5.3.2. Closed-circuit cooling system.....	37
6. DESCRIPTION OF THE TECHNOLOGY SELECTED FOR IMPLEMENTATION – BWRX-300	38
6.1. GENERAL INFORMATION	38
6.2. CONCEPTUAL OUTLINE OF THE BWRX-300 POWER UNIT DESIGN	40

6.2.1.	Reactor Building	42
6.2.2.	Turbine Building (Turbine Hall)	44
6.2.3.	Control Building (Control Room Building).....	44
6.2.4.	Radwaste Building	45
6.2.5.	Main design solutions of the BWRX-300	45
6.3.	PROGRESS OF BWRX-300 TECHNOLOGY LICENSING PROCESSES IN THE WORLD.....	47
6.3.1.	Canada.....	47
6.3.2.	United States	48
6.3.3.	The United Kingdom	48
6.3.4.	Poland	48
7.	CONSIDERED OPTIONS FOR THE PROJECT.....	50
7.1.	TECHNICAL OPTIONS OF THE COOLING SYSTEM	50
8.	DESCRIPTION OF THE ENVIRONMENT	52
8.1.	SITE TOPOGRAPHY	53
8.2.	GEOLOGICAL STRUCTURE	54
8.2.1.	Karst phenomena	56
8.2.2.	Suffosion phenomenon.....	57
8.2.3.	Landslides, surface erosion, stability of existing batters and slopes	57
8.3.	TECTONIC STRUCTURE	58
8.4.	SEISMIC CONDITIONS	59
8.5.	MINING ACTIVITIES	60
8.5.1.	Location of deposits.....	60
8.5.2.	Mining lands	62
8.5.3.	Effects of current mining activity.....	63
8.5.4.	Effects of historical mining activities.....	63
8.5.5.	Summary of the analysis of mining activities.....	64
8.6.	HYDROGEOLOGICAL CONDITIONS.....	65
8.7.	MAJOR GROUNDWATER RESERVOIR	67
8.8.	GROUNDWATER BODIES	68
8.9.	HYDROLOGICAL CONDITIONS.....	69
8.10.	SURFACE WATER BODIES	71
8.11.	FLOOD RISK.....	74
8.12.	RISK OF FLOODING	76
8.13.	CLIMATE.....	77
8.14.	VEGETATION COVER.....	79
9.	EXPECTED AMOUNT OF THE CONSUMED WATER AND OTHER USED RAW MATERIALS, MATERIALS, FUELS AND ENERGY.....	82
9.1.	CONSTRUCTION STAGE.....	83
9.1.1.	Use of materials and raw materials at the construction stage.....	83

9.1.2.	Use of water during the construction stage	83
9.1.3.	Use of fuels at the construction stage	84
9.1.4.	Use of electricity at the construction stage	84
9.2.	OPERATION STAGE	84
9.2.1.	Use of materials and raw materials during the operation stage	85
9.2.2.	Use of water at the operation stage	86
9.2.3.	Use of fuels at the operation stage.....	86
9.2.4.	Use of electricity at the operation stage	87
9.3.	DECOMMISSIONING STAGE.....	87
10.	ENVIRONMENTAL PROTECTION SOLUTIONS.....	87
10.1.	RADIATION PROTECTION SOLUTIONS	88
10.1.1.	Selection of appropriate process and organizational solutions	88
10.1.2.	Fundamental safety functions	89
10.1.3.	Defense-in-depth	90
10.1.4.	Safety features of the BWRX-300 technology	92
10.1.5.	Practical elimination of the possibility of severe accidents.....	92
10.2.	NON-NUCLEAR SOLUTIONS.....	93
10.2.1.	Development and implementation of an environmental management plan	94
10.2.2.	Management of construction, operation and decommissioning stages... 95	
11.	TYPES AND ESTIMATED QUANTITY OF SUBSTANCES OR ENERGY RELEASED INTO THE ENVIRONMENT BY USING THE SOLUTIONS AIMED TO PROTECT THE ENVIRONMENT	95
11.1.	CONSTRUCTION STAGE.....	96
11.1.1.	Noise emission	96
11.1.2.	Gas and dust emissions into the air	97
11.1.3.	Emissions into the groundwater environment.....	97
11.1.4.	Electromagnetic emissions	98
11.1.5.	Heat emissions	99
11.1.6.	Radiation emissions.....	99
11.2.	OPERATION STAGE	99
11.2.1.	Noise emission	100
11.2.2.	Gas and dust emissions into the air	100
11.2.3.	Emissions into the groundwater environment.....	101
11.2.4.	Electromagnetic field emissions	101
11.2.5.	Heat emissions	105
11.2.6.	Radiation emissions.....	105
11.3.	DECOMMISSIONING STAGE.....	106
11.3.1.	Noise emission	106
11.3.2.	Gas and dust emissions into the air	107

11.3.3. Emissions into the groundwater environment.....	107
11.3.4. Electromagnetic emissions	108
11.3.5. Radiation emissions.....	108
12. POSSIBLE TRANSBOUNDARY ENVIRONMENTAL IMPACT	109
12.1. SAFETY FEATURES OF THE BWRX-300 TECHNOLOGY	109
12.2. PRACTICAL ELIMINATION OF THE CONSEQUENCES OF THE ACCIDENT.	110
13. AREAS SUBJECT TO PROTECTION UNDER THE ACT OF APRIL 16, 2004 ON NATURE CONSERVATION, LOCATED WITHIN THE RANGE OF SIGNIFICANT IMPACT OF THE PROJECT	112
13.1. NATIONAL PARKS	112
13.2. NATURA 2000 SITES	112
13.3. LANDSCAPE PARKS.....	119
13.4. PROTECTED LANDSCAPE AREAS.....	119
13.5. NATURE RESERVES	121
14. OTHER PROJECTS UNDER CONSTRUCTION AND COMPLETED	122
15. RISK OF A SERIOUS ACCIDENT OR NATURAL DISASTER AND STRUCTURAL COLLAPSE.....	123
15.1. RISK OF A SERIOUS ACCIDENT.....	123
15.2. RISK OF A NATURAL DISASTER	124
15.3. RISK OF A STRUCTURAL COLLAPSE	125
16. EXPECTED AMOUNTS AND TYPES OF WASTE GENERATED AND THEIR IMPACT ON THE ENVIRONMENT.....	126
16.1. CONVENTIONAL WASTE.....	127
16.2. RADIOACTIVE WASTE	127
16.3. CONSTRUCTION STAGE.....	128
16.4. OPERATION STAGE	129
16.5. DECOMMISSIONING STAGE.....	130
17. DEMOLITION WORKS FOR PROJECTS LIKELY TO HAVE A SIGNIFICANT IMPACT ON THE ENVIRONMENT.....	131
18. REFERENCES	133
LIST OF FIGURES.....	137
LIST OF TABLES	139

■ ABBREVIATIONS AND DEFINITIONS

I&C	Instrumentation and controls
OH&S	Occupational Health and Safety
NSRP	Nuclear Safety and Radiation Protection
Power Unit	Modular nuclear reactor in the BWRX-300 technology, control room building, turbine hall (turbine, generator)
BWR	Boiling Water Reactor
BWRX-300	The 10th generation of the BWR with a power output of 300 MW offered by GEH, the technology selected by the Investor
CCGT	Combined Cycle Gas Turbine
CNSC	Canadian Nuclear Safety Commission
CWS	Circulating Water System
DEC	Decision on environmental conditions for the project
Birds Directive	Directive of the European Parliament and of the Council 2009/147/EC of 30 November 2009 on the conservation of wild birds (OJ L 20/7 of 26 January 2010)
Habitats Directive	Council Directive 92/43/EEC of 21 May 1992 on the conservation of natural habitats and of wild fauna and flora (OJ L 206/7, 22.7.1992)
NPP	Nuclear Power Plant
EOC	Emergency Operation Center
EPK	Energoprojekt Katowice S.A.
GDOŚ	General Director for Environmental Protection
GE	General Electrics
GEH	GE-Hitachi Nuclear Energy Americas LLC
GWe	Gigawatt of electric power
GWh	Gigawatt hour
GZWP	Major groundwater reservoir
IAEA	International Atomic Energy Agency
ICS	Isolation Condenser System
Investor	BWRX-300 Ostrołęka sp. z o.o., whose 100% shares are owned by Orlen Synthos Green Energy Sp. z o.o.
Investment Project, Project	The Investment Project involving the construction and operation of a nuclear power plant with a power output of up to 1,300 MWe, which is the subject of the procedure for issuing a decision on environmental conditions
ISOK	IT System of National Protection
PIS	Project Information Sheet
JPWC	Surface water body

KOBiZE	National Center for Emission Management
KPPzOPiWPJ	National Plan for Handling Radioactive Waste and Spent Nuclear Fuel
NPS	National Power System
LCOE	Levelized cost of electricity
LCOH	Levelized cost of heat
LOCA	Loss of Coolant Accident
Site	An area of geodetic plots, in the area of which the foundation of nuclear power plant power units is planned, including auxiliary buildings and all necessary technical infrastructure.
IAEA	International Atomic Energy Agency
MCR	Main Control Room
MIT	Massachusetts Institute of Technology
LDP	Local Development Plan
MWe	Megawatt of electric power
MWh	Megawatt hour
Site Area	An area within 5 km of the boundaries of the planned Site of the nuclear facility
ONR	UK's Office for Nuclear Regulation
OSGE	ORLEN Synthos Green Energy sp. z o.o.
RES	Renewable energy sources
PCV	Primary Containment Vessel
PCW	Plant Cooling Water
EMF	Electromagnetic radiation
PEP2040	Polish Energy Policy 2040
PIG-PIB	Polish Geological Institute – National Research Institute
Prescreening	Works and analysis to make a preliminary determination of the suitability of the Site for the construction of a nuclear power plant
PNPP	Polish Nuclear Power Program
PSE	Polskie Sieci Elektroenergetyczne S.A. (Polish Power Grid Company)
PWR	Pressurized Water Reactor
EMP	Environmental Management Plan
EIA Report	Environmental impact report
Site Region	An area within 30 km of the boundaries of the planned Site of the nuclear facility
EIA Ordinance	Ordinance of the Council of Ministers of September 10, 2019 on projects that may have a significant impact on the environment (Journal of Laws of 2019, item 1839, as amended)
RPV	Reactor Pressure Vessel
SDF	Standard Data Form

SUiKZP	Study of Conditions and Directions of Spatial Development
SMR	Small Modular Reactor
SRD	Strategy for Responsible Development until 2020 (with the perspective until 2030)
U.S. NRC	United States Nuclear Regulatory Commission
EU	European Union
ERO	Energy Regulatory Office
EIA Act	Act of October 3, 2008 on providing access to information on the environment and its protection, public participation in environmental protection, and on environmental impact assessments (Journal of Laws of 2023, item 1094, as amended)
Atomic Law	Act of November 29, 2000 – Nuclear Law (Journal of Laws of 2023, item 1173)
Construction Law	Act of July 7, 1994 – Construction Law (Journal of Laws of 2023, item 682, as amended)
Cooling water	Water for making-up the power plant's cooling circuit
ZUOP	Zakład Unieszkodliwiania Odpadów Promieniotwórczych – public utility company

INTRODUCTION

1

This study is the Project Information Sheet (PIS) for the construction and operation of a nuclear power plant (NPP) with power output of up to 1,300 MWe (Project, Investment Project) at the Ostrołęka site and is part of the formal and legal documentation prepared by the Investor in order to obtain the Decision on Environmental conditions (DEC) for the planned Investment Project.

The Project will include the construction and operation of up to four Small Modular Reactors (SMR) in the BWRX-300 technology with total power output not exceeding 1,300 MWe, including all necessary auxiliary facilities and associated technical infrastructure. The planned Project will be implemented in the Mazowieckie voivodeship, Ostrołęka district, Ostrołęka municipality, Ostrołęka city, cadastral district: 0003, 0007 and Rzekuń municipality, cadastral district Teodorowo, Nowa Wieś Wschodnia, Rzekuń.

The location of the planned Investment Project is described in Chapter 4.2 Location of the Project. The Applicant is BWRX-300 Ostrołęka sp. z o.o. (Investor), whose 100% shares are owned by ORLEN Synthos Green Energy sp. z o.o. (OSGE) with its registered office in Warsaw.

The Project Information Sheet was prepared by the OSGE team.

OBJECTIVE AND SCOPE OF THE PROJECT INFORMATION SHEET

2

In accordance with Article 71 section 2 point 1 of the Act of October 3, 2008 on providing access to information on the environment and its protection, public participation in environmental protection, and on environmental impact assessments (Journal of Laws of 2023, item 1094, as amended, EIA Act), an environmental impact assessment is required for projects that may always have a significant impact on the environment (the so-called group I projects), the catalog of which is listed in the Ordinance of the Council of Ministers of September 10, 2019 on projects that may have a significant impact on the environment (Journal of Laws of 2019, item 1839, as amended, EIA Ordinance).

With reference to § 2 section 1 point 4 of the aforementioned EIA Ordinance, projects that may always have a significant impact on the environment include: nuclear power plants and other nuclear reactors, including their decommissioning, excluding research plants for the generation or processing of fissile or fuel materials with a nominal power

output of no more than 1 kW at continuous thermal load.

Taking into account the above, the Investment Project in question involving the construction and operation of a nuclear power plant including all necessary auxiliary facilities and associated technical infrastructure is on the list of projects that may always have a significant impact on the environment, for which preparation of an environmental impact report (EIA Report) is required.

In fulfillment of the obligation set forth in Article 74 section 1 point 1 of the EIA Act in conjunction with Article 69 section 1 of the same Act, the Applicant, when submitting an application for the decision on environmental conditions for the project, may submit, instead of the EIA Report, a project information sheet together with an application for determining the scope of the EIA Report.

The scope of this study is in accordance with the requirements of Article 62a section 1 of the EIA Act, according to which the PIS should contain only basic information about the planned project to determine the scope of the EIA Report (Table 2).

The required point of the scope of the study compliant with Article 62a section 1 of the EIA Act, concerning	Place in documentation
type, characteristics, scale and location of the project	Chapter 4
the area of occupied real estate, as well as the civil structure and their previous manner of use and vegetation cover of the real estate	Chapter 4 Chapter 8
technology type	Chapter 6
possible options of the project	Chapter 7
expected amounts of water, raw materials, materials, fuels and energy to be consumed	Chapter 9
solutions to protect the environment	Chapter 10
types and estimated amount of substances or energy released into the environment by using the solutions aimed to protect the environment	Chapter 11
possible cross-border environmental impact	Chapter 12
areas subject to protection under the Act of April 16, 2004 on nature protection and ecological corridors, located within the range of significant impact of the project	Chapter 13
ongoing and completed projects located in the area where the project is planned to be implemented and in the area of impact of the project, or whose impacts fall within the area of impact of the planned project – to the extent that their impacts may lead to cumulative impacts with the planned project	Chapter 14
risk of a serious accident or natural and construction disaster	Chapter 15
expected amounts and types of waste generated and their impact on the environment	Chapter 16
demolition works concerning projects likely to have a significant impact on the environment	Chapter 17

Table 2. Contents of the PIS in accordance with Article 62a of the EIA Act

THE RATIONALE FOR THE CONSTRUCTION OF A NUCLEAR POWER PLANT BASED ON SMALL NUCLEAR REACTORS

3

In connection with the Investor's plans to implement an Investment Project involving the construction and operation of a nuclear power plant, which will include up to four modular nuclear reactors in the BWRX-300 technology, the current situation of the National Power System (NPS) and its development plans were briefly analyzed.

THE ENERGY MIX OF POLAND

3.1

Electricity supplied to final customers is generated at power plants and combined heat and power plants. In Poland, these are mainly thermal power plants and combined heat and power plants (fired by lignite, hard coal or natural gas) and power plants classified as renewable energy sources (RES), which include wind, photovoltaic, hydropower and biogas plants.

According to data published by the Energy Regulatory Office (ERO), the volume of gross domestic electricity production in 2022 was at a higher level compared to the previous year, amounting to 175,157 GWh (a 0.9% increase compared to 2021). In the discussed period, gross domestic electricity consumption amounted to 173,479 GWh, decreasing by (-)0.53% compared to 2021.

The ERO also indicates that in 2022, the installed capacity of the NPS was 60,446 MWe, an increase of 12.7% compared to 2021. The average annual power demand in 2022 was at 23,389.0 MW, with a maximum demand of 27,296.2 MW, a drop of 1.20% and 1.16%, respectively, in relation to the data from the previous year.

The structure of electricity production in Poland has changed slightly compared to 2021, continuing to be dominated by fossil fuels, i.e., hard coal and lignite, whose share in electricity production in 2022 amounted in total to approx. 77%. There has been a decrease in generation at hard coal-fired power plants (a drop of approx. 6%) and an increase in generation at lignite-fired power plants (an increase of approx. 3%). A noticeable change is the significant increase in the share of production using renewable energy sources. Electricity production from wind sources increased from 8% to 10% and the production from other renewable sources increased from 3% to 5%. Electricity production in coal-fired power plants, production in gas-fired power plants and thermal power plants amounted to 5.44% of total electricity production

(Figure 1).

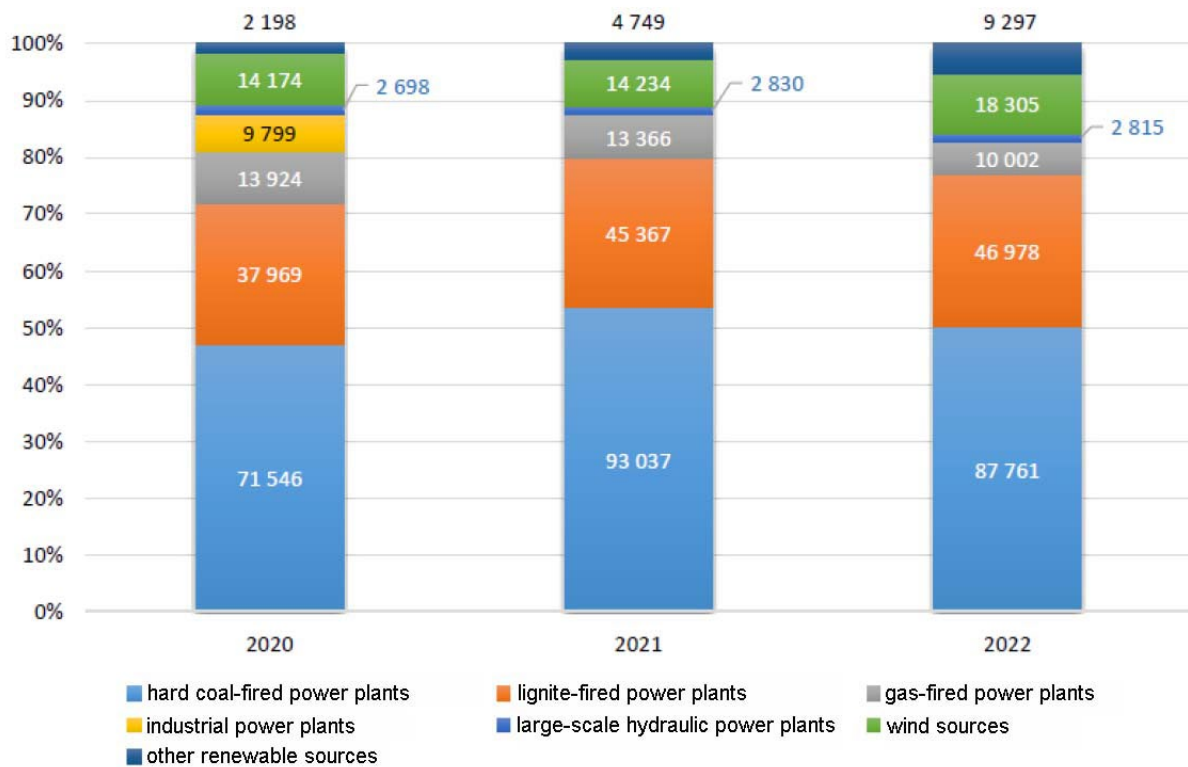


Figure 1. Comparison of the structure of electricity production in 2020–2022 [GWh], (Source: ERO Report 2022)

EMISSIONS OF THE POWER SYSTEM

3.2

Due to the large share of conventional power plants and combined heat and power plants in electricity production, Poland’s electricity supply system is characterized by high carbon dioxide emissions per MWh of electricity produced. According to a report by the National Center for Emission Management (KOBIZE) titled “CO₂, SO₂, NO_x, CO and total dust emission factors for electricity based on information contained in the national database on emissions of greenhouse gases and other substances for 2021”, the average CO₂ emission for each MWh of electricity considering all sources, including renewable ones, in 2021 was 761 kg. The KOBiZE report also indicates the average emissions of other pollutants produced during the electricity generation process at fuel combustion plants (Table 3).

Pollutant	Emission factor [kg/MWh]
Carbon dioxide (CO ₂)	761
Sulfur oxides (SO _x /SO ₂)	0.543
Nitrogen oxides (NO _x /NO ₂)	0.543
Carbon monoxide (CO)	0.255
Total dust	0.023

Table 3 | Emission factors expressed in [kg/MWh] for electricity produced in fuel combustion plants in 2021 (source: KOBIZE report: CO₂, SO₂, NO_x, CO and total dust emission factors for electricity based on information contained in the national database on emissions of greenhouse gases and other substances for 2021).

Table 4 compares CO₂ emissions by plant type. Emission values according to the “Carbon Neutrality in the United Nations Economic Commission for Europe Region: Integrated Life-cycle Assessment of Electricity Sources” were adopted for the calculations. One nuclear power unit in the BWRX-300 technology with a net power output of 285 MWh and a capacity utilization factor of 93% was used as a reference for the calculations. Annual electricity production in this case will be approx. 2.3 TWh, which will translate into full cycle emissions (including ore mining, transport, etc.) of approx. 13,000 tons of CO₂/year. Compared to the production of the same amount of electricity generated by a hard coal-fired power plant, emissions will be 2.1 million tons of CO₂/year, a lignite-fired power plant – more than 2.5 million tons of CO₂/year, and for gas-fired power plants more than 1 million tons of CO₂/year. For renewable sources, emissions will range from 27,000 to 40,000 tons of CO₂ for wind farms (onshore and offshore, respectively) and from 100,000 to 170,000 tons of CO₂/year for photovoltaics and hydropower plant. Operation of the BWRX-300 reactor will allow for preventing the emission from approx. 15,000 to approx. 2.5 million tons of CO₂ annually, which will translate into improved air quality both locally and regionally.

Plant type		CO ₂ emissions [full life cycle] [kg CO ₂ /MWh]			Emission [Mg CO ₂ /year]	Avoided emissions [Mg CO ₂ /year]
		min.	average	max		
Nuclear Power Plant	BWRX-300	5.1	6	6.4	13,350.57	
Coal-fired power plant	hard coal	751	923	1095	2,143,056.47	2,129,705.91
	lignite	966	1094	1221	2,538,929.85	2,525,579.28
Gas-fired power plant	CCPP system (CCGT)	403	458	513	1,063,401.80	1,050,051.24
Hydropower plant		6	77	147	177,620.61	164,270.04
Wind farms	onshore	7.8	12	16	27,629.87	14,279.30
	offshore	12	18	23	40,632.17	27,281.60
Photovoltaics		8	46	83	105,643.63	92,293.06

Table 4. CO₂ emissions by source (Source: own study)

CLIMATE GOALS

3.3

In December 2020, the European Council set a goal for the EU to reduce greenhouse gas emissions by at least 55% by 2030 compared to 1990 levels, with further efforts to

achieve climate neutrality by 2050. Under European climate law, these goals are binding on the EU and its member states. To achieve these goals, EU member states must take specific measures to reduce emissions and decarbonize the economy.

To fulfill these commitments, the Polish power system must undergo a rapid and profound energy transition, with the overriding goal of completely replacing conventional sources (fossil fuel-fired thermal power plants and combined heat and power plants) with zero-carbon sources. In view of the above, it is essential that Poland's energy transition be based on a foundation of sustainable development. Key sustainability criteria for NPS sources include:

- guarantee of security of electricity supplies
- guarantee of moderate electricity prices, conducive to the economic development of the country
- guarantee of counteracting climate change
- ensuring environmental protection.

Taking into account the overarching goal of achieving climate neutrality in the next 30 years and the above criteria, it is necessary to introduce a safe, low-carbon and economically efficient power system¹.

NATIONAL ENERGY POLICY

3.4

With the EU's climate and energy policy in mind, including the long-term vision of moving toward climate neutrality by 2050, the Government of the Republic of Poland has developed a number of documents that define the country's development directions in the long term. They include the strategic goals to be achieved in order to become climate neutral. It should be noted that the national energy policy provides for the development of both nuclear and other clean energy sources. The Investor's desire to develop and implement distributed generation sources in the form of modular nuclear power plants, which are sustainable, stable, and, at the same time, clean sources of electric power, is consistent with both the direction of development of Poland (as defined in official government documents) and the trends observed in other EU countries and North America.

Strategy for responsible development

3.4.1

¹ <https://www.gov.pl/web/polski-atom/atom-ratuje-klimat-czyli-transformacja-energetyczna-z-udzialem-energetyki-jadrowej-i-odnawialnych-zrodel-energii>

A national document indicating the need to build stable and zero-carbon generation sources is, among others, the Strategy for Responsible Development (SRD) until 2020 (with the perspective until 2030). The document states that ensuring energy security requires diversification of sources, raw materials and means of energy generation and distribution, and priorities include: guaranteeing stability and continuity of supplies and diversification of energy sources. According to the SRD, the challenges that condition the directions of development of Poland's energy policy point to the need to modernize and expand the low-carbon district heating sector to increase security of supplies and increase access for new customers. Indeed, a developed and modern zero-carbon district heating network is one of the ways to reduce the phenomenon of so-called low emissions² in urban areas. It is therefore recommended to use cogeneration in heat generation due to its emission neutrality especially at the level of local boiler houses³.

Polish Energy Policy until 2040

3.4.2

The main strategic government document titled “Polish Energy Policy 2040” (PEP2040), developed by the Ministry of Climate and Environment and published in 2021, states that meeting primary energy demand is one of the main elements of the country’s energy security. Therefore, measures are required to expand the generation infrastructure and ensure the efficiency of electricity transmission and distribution. PEP2040 indicates that with the involvement of domestic industry, an energy transition will be carried out that will affect the development of the economy and reduce emissions, while ensuring energy security. The energy transition should be based on three pillars:

1. Just transition – means transforming coal regions by providing new development opportunities in the areas most negatively affected by the transition, while providing new jobs and building new industries that participate in the transformation of the energy sector.
2. Zero carbon – means decarbonizing the energy sector through the implementation of nuclear power, among other things. This pillar addresses the long-term direction of the energy transition.
3. Good air quality – means improving air quality through investments in transforming the district heating sector or electrifying transportation, among other things.

PEP2040 also pays particular attention to the need to develop the district heating and cogeneration sector. The development of system-based district heating is treated by PEP2040 as a strategic direction of development – in addition to the ecological aspect, it is also an opportunity to stimulate local economic potential. The development of

² Low-stack emissions, which are emissions of dust and gases up to a height of 40 meters, mainly from inefficient combustion of coal from home heating stoves, or local coal-fired boiler houses.

³ Based on the Strategy for Responsible Development (SRD) until 2020 (with the perspective until 2030)

cogeneration, i.e., simultaneous generation of electricity and heat based primarily on low-carbon sources, will play a key role in achieving the strategic goals for heat engineering development⁴.

Works are currently underway to update PEP2040 to neutralize or mitigate risks associated with potential emergencies, such as the war in Ukraine. The revision of the document aims to ensure energy sovereignty by making the domestic economy independent of imported fossil fuels. With regards to nuclear power implementation, the PEP2040 update mentions, in addition to works related to the construction of Poland's first nuclear power plant, small modular reactors as an alternative to conventional units in power and heat generation. SMRs are indicated as part of the diversification of the electricity generation structure, which is a strengthening of energy security at the local level.

Polish Nuclear Power Program

3.4.3

In addition to the above-mentioned documents, it should also be pointed out that on October 2, 2020, the Council of Ministers adopted a Resolution on updating the multi-annual program entitled “Polish Nuclear Power Program” (PNPP). The document states that the main arguments in favor of implementing nuclear power in Poland are:

1. Energy security – the implementation of nuclear power will mean strengthening energy security, mainly by diversifying the fuel base and directions of delivery of energy carriers and replacing the aging fleet of high-emission coal-fired power units.
2. Climate and environment – nuclear power means a dramatic reduction in atmospheric greenhouse gas emissions from the power sector and low environmental external costs. The examples of large, industrialized and highly developed countries and regions such as France, Sweden and the Canadian province of Ontario prove that nuclear power contributes to the effective, rapid and profound decarbonization of the power sector. In all of these cases, emissions have been drastically reduced to well below 100 kg CO₂/MWh, relying mainly on nuclear power (France) or a combination of nuclear and large hydropower (Sweden, the Canadian province of Ontario).
3. Economy – in the economic context, nuclear power plants can stem the increase in energy costs for customers, or even lower them, counting the full bill for the final customer. This is due to the fact that they are the cheapest energy sources when taking into account the full calculus of costs (investor, system, network, environmental, health, other external) and the factor of long operation time after the depreciable life. This applies to both individual and business customers, and

⁴ Based on the “Polish Energy Policy 2040” (PEP2040) developed by the Ministry of Climate and Environment of February 2, 2021.

especially safeguards the development of energy-intensive enterprises (e.g., metallurgical, chemical industries). Nuclear power, due to its long operation period reaching up to 80 years, is also an important investment through which intergenerational solidarity is realized⁵.

RATIONALE FOR THE CONSTRUCTION OF THE SMR

3.5

The SMR implementation project fits perfectly into the framework and assumptions of the cited strategic documents on:

1. Just transition – the implementation of the proposed technology will mainly take place in industrial areas replacing conventional generating units with modern zero-carbon and innovative generating units providing stable, well-paid jobs that will give a boost to the development of entire regions. The transition will also favorably influence the emergence of new, innovative industries providing services to the nuclear industry.
2. Zero-carbon energy system – the proposed technology represents a zero-carbon energy source, the implementation of which in place of high-carbon conventional units will have a positive impact on both local air quality, which will directly translate into the quality of public health, and global CO₂ emissions responsible for climate change. The use of SMRs to generate heat and electricity (cogeneration) will also help reduce low emissions from combusting coal in domestic stoves, which have negative health effects on the population of the area.
3. Economy – the implementation of the BWRX-300 technology guarantees the delivery of stable and predictable energy over the long term at an acceptable price. The price of nuclear fuel, which is the main operating cost of a nuclear power plant, due to the directions of its origin (Canada, Australia, France, USA) is stable and does not fluctuate wildly due to speculative activities as is the case with natural gas or coal prices. In addition, due to zero-emission, the final price of the electricity and heat generated will not be charged for CO₂ emissions.
4. National energy security – aging conventional generating units (commercial power plants powered by hard coal and lignite) and the ever-increasing demand for electricity create the risk of electricity supply interruptions. Such a case occurs when the ability to import electricity proves insufficient to cover the domestic deficit, and thus the country's energy security may be threatened. Taking into account the above and the contents of the strategic government documents cited above, it should be concluded that the development of nuclear energy plays a key role in ensuring stable and zero-carbon generation sources. It also makes it possible to

⁵ Based on the Polish Nuclear Power Program (PNPP) (Resolution No. 141 of the Council of Ministers of October 2, 2020 on updating the multi-annual program entitled "Polish Nuclear Power Program")

fulfill the key tasks facing the commercial power industry today, i.e. ensuring the country's energy security (stable supply of large volumes of electricity or heat) and meeting short-, medium- and long-term commitments to climate protection and climate neutrality by 2050 (zero-carbon energy source). A very important point requiring special attention is the current geopolitical situation in the region. The armed attack by the Russian Federation on Ukraine and the resulting economic sanctions have translated into the mood of global markets, i.e. the rise in prices of energy raw materials. This applies primarily to prices of coal, oil and natural gas (including liquefied natural gas). Certainly, ensuring a stable supply of electricity at a price that is predictable over the long term will have a positive effect manifested in economic recovery.

Basing the decarbonization of Poland's electricity system solely on the potential of RES generation sources is not possible due to the instability of electricity generation in such sources. RES are inherently unstable and uncontrollable, which means they need balancing. Currently, balancing is done through conventional power plants, mainly coal-fired, and in the future gas-fired, but their operation is uneconomical in the long term. Further fuel combustion, moreover, poses a real risk of failing to meet the deadlines declared for achieving climate neutrality. The ideal solution to support RES is to generate electricity using the modular nuclear power plant technology, which is a stable, fully controllable and flexible generation source that can operate either in the base of the system (continuous operation at maximum power output) or as a balancing unit.



■ DESCRIPTION OF THE PROJECT

4

▮ SCALE AND FEATURES OF THE PROJECT

4.1

The Project involves the construction and operation of a nuclear power plant, which will include:

- up to four Power Units (each power unit contains, i.a., a BWRX-300 modular nuclear reactor, control room building, turbine hall (turbine, generator)) with a total power output not exceeding 1,300 MWe,
- auxiliary buildings (including, i.a., spent fuel storage facility, interim radioactive waste storage facility, office buildings, workshop),
- necessary technical infrastructure (including, i.a., water intake, pumping station, cooling water pipelines, cooling system infrastructure (mechanical/natural draft cooling towers), switchyard, power output to the NPS).

The purpose of the Investment Project is to generate electricity or electricity and heat (cogeneration) using nuclear energy. The electricity generated will supply the National Power System (NPS) using the power connection. The heat, in turn, can be used for district heating purposes, supplying the local district heating network (the implementation of a connection for district heating purposes is not included in the scope of this application for the decision on environmental conditions; it will be implemented on the basis of separate administrative decisions).

Currently, the Investor does not yet have the conditions for connection to the electric power grid issued. Connection conditions will be determined in cooperation with the Transmission System Operator – Polskie Sieci Elektroenergetyczne S.A. (PSE) at a later stage of the Investment Project. Taking into account the topography of the power system and the fact that there is a 400/220/110 kV “Ostrołęka” substation in the immediate vicinity of the Site (approx. 1.5 km north of the Site), it was assumed that the connection point would be located at this substation. Eventually, however, the connection point and technical parameters will be determined at the stage of the feasibility study of power output to the NPS.

The final installed power output of the power plant, and therefore its final parameters, will be determined at a later stage of the Investment Project.

Implementation of the project also includes the construction and operation of a spent fuel storage facility and an interim radioactive waste storage facility. Currently, the Investor has not decided what type of storage facility (dry, wet) will be built at the Site.

Staging of the Project

4.1.1

It is anticipated that the Project may be implemented in stages. All the Power Units will be built using the same BWRX-300 reactor technology, and the total installed capacity of the Project will not exceed 1300 MWe, while the number of reactors, whether and how many stages the Investment Project will be divided into, and how long the interval between the implementation of successive stages will be, have not been definitively determined at present. However, it should be emphasized that within the framework of the procedure in question, the Project with parameters encompassing all possible stages together is covered by the application for an environmental decision.

The effects of staging of the Project will be the subject of an environmental impact assessment and will be described in the EIA Report. In turn, the individual stages will be defined and characterized in detail at the stage of preparing the building permit design, taking into account the parameters set for the whole Project.

PROJECT LOCATION.

4.2

The planned site of the Project is located in the Mazowieckie Voivodeship (Fig. 2), Ostrołęka District, Ostrołęka City, cadastral district 0007, 0003, and Mazowieckie Voivodeship (Fig. 2), Ostrołęka District, Ostrołęka City, Rzekuń Municipality, Teodorowo cadastral district.



Figure 2. Location of Ostrołęka on the map of Poland

The planned Site is located at the eastern border of Ostrołęka (approx. 52,000

inhabitants). At a distance:

- of approx. 30 km northeast of the Site there is the center of Łomża (approx. 62,000 inhabitants),
- of approx. 28 km southwest of the Site there is the center of Różan (2,800 inhabitants), which is the largest city in the region.

The investment project area is an area of industrial use. The Site currently houses the construction site of the CCGT, and previously there was the construction site of the not completed Ostrołęka C coal-fired unit. Previously, there was a repository for waste remaining after the construction of Ostrołęka A and B power plants. For the construction of the coal-fired power unit, the repository was reclaimed. As part of the reclamation, layers of soil and waste that did not meet the parameters of the construction substrate were removed and the site was leveled. The facilities of the Ostrołęka C coal-fired power unit that had been constructed until the investment project was suspended have been demolished. The most significant facilities adjacent to the site of the proposed nuclear facility comprise: Ostrołęka Power Plant, Ostrołęka CHP (under construction), Ostrołęka CCGT (under construction, on a closed area in accordance with the decision of the Minister of Climate and Environment), 400/220/110kV "Ostrołęka" substation, Ytong building ceramic plants, and the bankrupt horticultural farm Prywatne Gospodarstwo Ogrodnicze Sp. z o.o. (bankruptcy declared in 2018). To the west, a railroad line with a siding serving the Ostrołęka B power plant (formerly also the Ostrołęka A power plant), as well as one that can serve the nuclear facility and the CCGT, runs along the boundaries of the plots intended for the location of the nuclear facility. The location of the planned nuclear facility site with the designation of the most important facilities in the vicinity is shown in Figure 3.

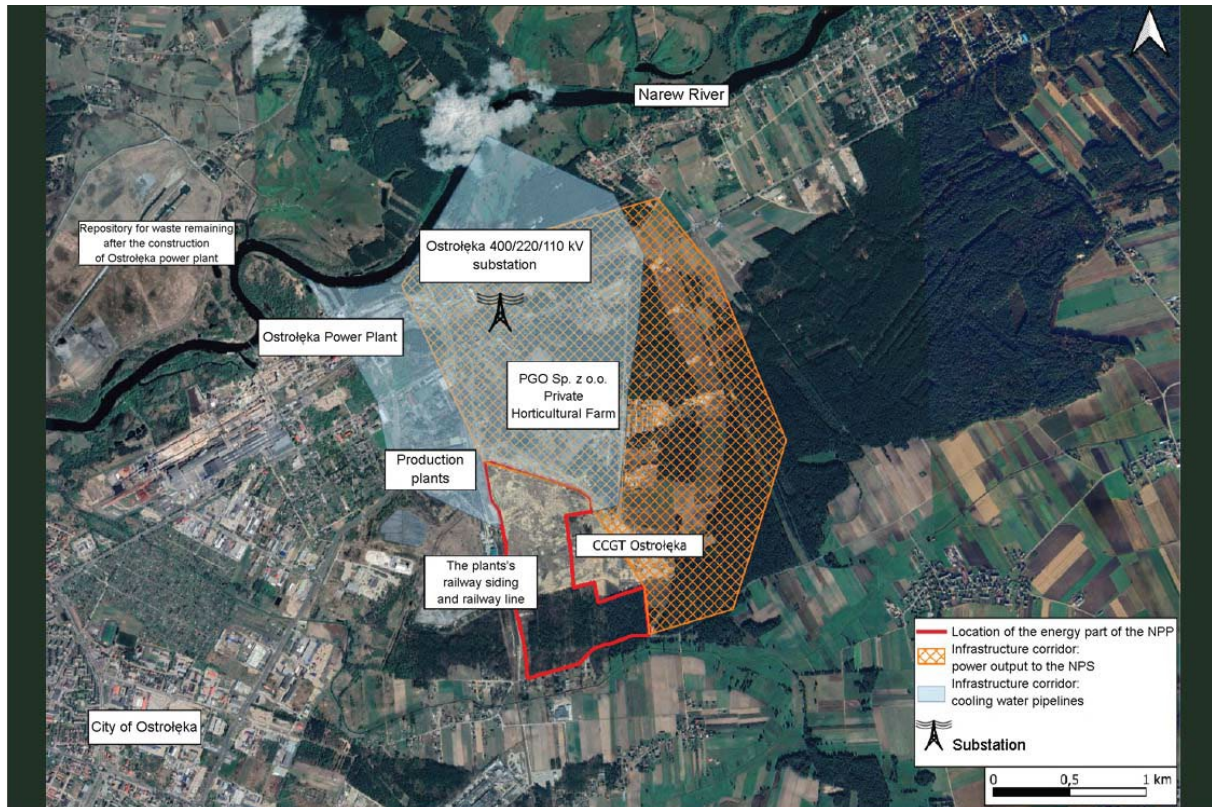


Figure 3. Areas adjacent to the planned Site (Source: own study using Google maps data)

Due to the diversity of spatial location, the Project can be divided into:

- The power part, i.e. the power unit including auxiliary buildings and all necessary technical infrastructure (excluding water intake, cooling water pipelines, power output to the NPS) located on the premises of the Site
- Water intake, pumping station and cooling water pipelines
- Power output to the NPS

Project Site (power part)

4.2.1

The part of the Project comprising the Power Units together with the switchyard, auxiliary buildings (including the spent fuel storage facility and the interim radioactive waste storage facility), and all necessary technical infrastructure will be located in the Mazowieckie Voivodeship, Ostrołęka District, within the boundaries of Ostrołęka, cadastral district 0007 (Fig. 4) with a total surface area of approx. 71 hectares.



Figure 4. Location of the power part of the Project (Source: own study using Google maps data)

The investment project area is an area of industrial use. The Site currently houses the construction site of the CCGT, and previously there was the construction site of the not completed Ostrołęka C coal-fired unit. Along the western boundary of the investment plot, a railway line runs, owned by the Ostrołęka CCGT. This line, together with the railroad siding located at the height of the designed power plant, were used for the construction of the Ostrołęka CCGT. This line is not used for daily passenger or freight train traffic.

Project Site (water intake, pumping station, and water pipelines)

4.2.2

The location of the cooling water infrastructure corridor is shown in Fig. 5. The water intake, pumping station and pipelines will be located in the Mazowieckie Voivodeship, Ostrołęka District, Ostrołęka Municipality, cadastral district 0007, 0003, and Rzekuń Municipality, Teodorowo cadastral district. It should be emphasized that the area occupied by the cooling water pipelines will represent only a small fraction of the designated infrastructure corridor. The assumed width and shape of the corridor makes it possible to freely adjust the routing of pipelines and other components of the water intake and discharge system, taking into account obstacles such as residential

development or underground infrastructure, the presence of which may be revealed during the development of a detailed power output study. The infrastructure corridor is therefore the area where the implementation of cooling water infrastructure will take place, which does not mean that the entire area will be transformed and developed.

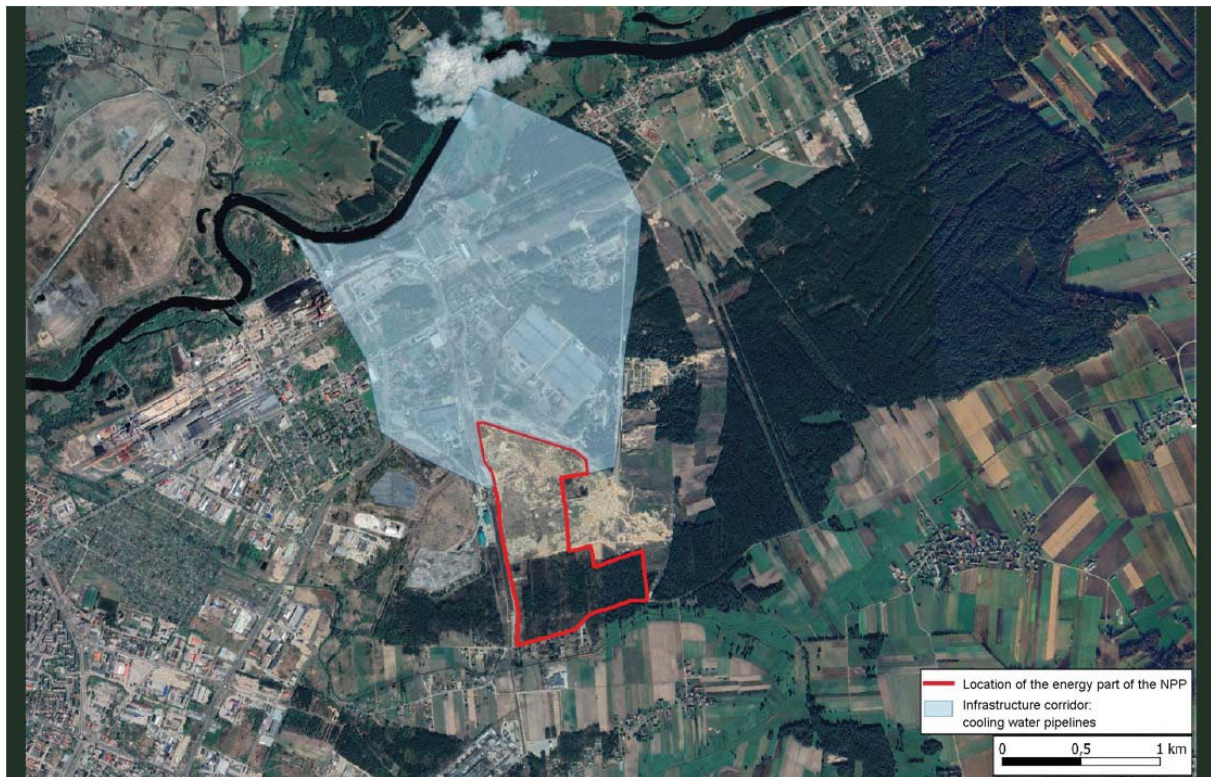


Figure 5. Infrastructure corridor – cooling water pipeline (Source: own study using OpenStreetMap data)

Regardless of the selected cooling system for the power plant (once-through or closed circuit), the preferred source of cooling circuit water is the Narew River located approx. 1.8 km northwest of the planned power plant. Cooling water will be pumped from the Narew River to the power plant by means of pumps and pipelines after the construction of a surface water intake (the use of existing water intake infrastructure belonging to the Ostrołęka Power Plant is also allowed). Depending on the selected type of the cooling system, the final power output of the power plant, and the amount of needed water, the number of necessary pipelines and their diameter will be determined. At the current stage of the Investment Project preparation, the use or extension of the existing water intake infrastructure of the existing Ostrołęka Power Plant is also being considered.

The description of the cooling systems under consideration is included in chapter 7.1 Technical options of the cooling system.

The identified water body will be subjected to further and in-depth analyses to determine and clarify possible technical options of the cooling system, location of the water intake, pumping station, and the route of cooling water pipelines, taking into account factors such as the quantity and quality of available water, as well as analyses of the technical capability of implementing the various elements of the cooling system,

including potential locations of water intakes and discharges (in the case of a once-through cooling system), site utilities, and the presence of technical obstacles or natural conditions.

The entire area intended for the location of the cooling water intake infrastructure will be covered by an environmental survey, and the impact assessment of this part of the project will be analyzed in detail at the EIA Report stage.

Project Site (power output)

4.2.3

Given the planned power output of the power plant which is covered by the Investment Project, a power output system to the national power system using 220 kV or 400 kV overhead or cable lines is being considered. Based on the analysis of available connection capacities and the topography of the power system, connection of the power plant to the NPS is possible at the 400/220/110 kV “Ostrołęka” substation located at a distance of approx. 1.5 km from the planned Investment Project. It was therefore assumed that the connection point would be at this particular substation. However, it should be emphasized that ultimately the connection point determining the length of the connection and the technical parameters of this connection, particularly the rated voltage, will be determined in cooperation with the Transmission System Operator – PSE S.A. at the stage of the application for issuing the conditions for connection to the power system.

The approximate route of the infrastructure corridor within which the power infrastructure that constitutes the power output from the power plant will be implemented is shown in Fig. 6.

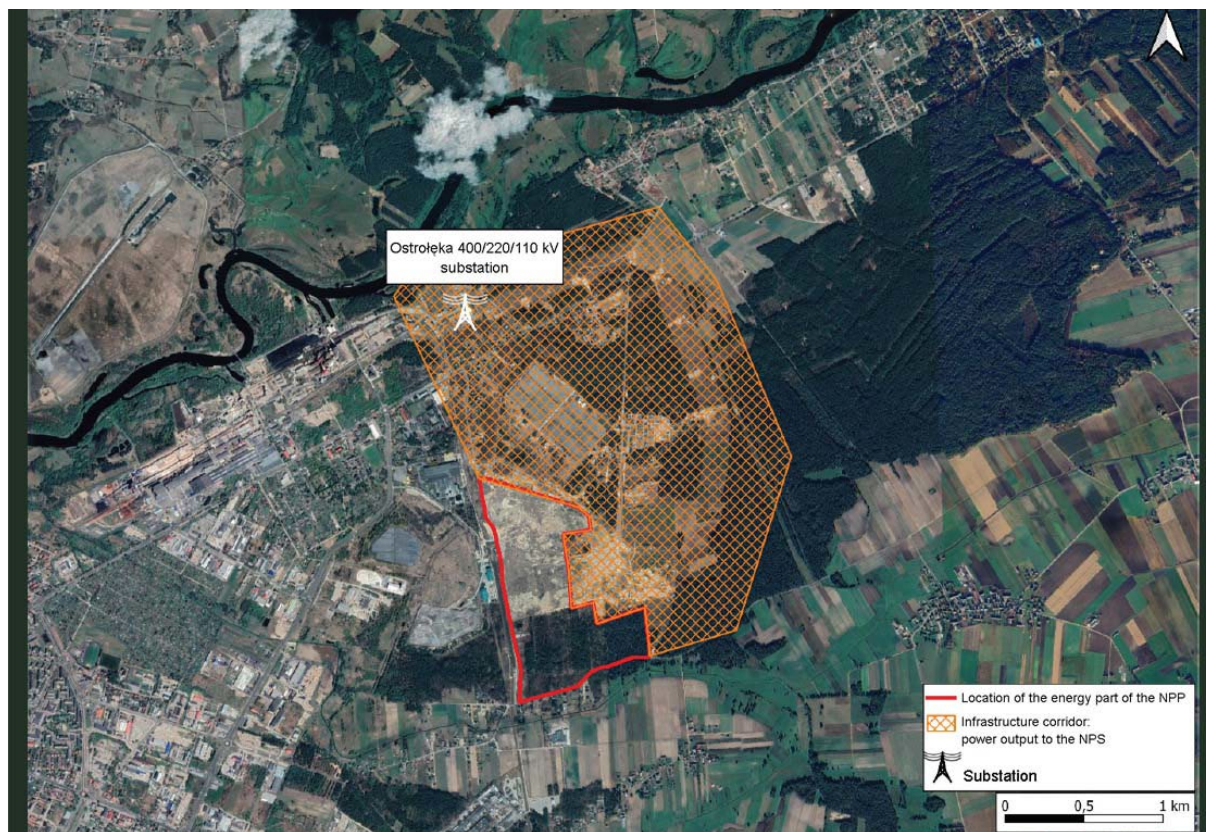


Figure 6. Considered directions for implementation of the grid connection (Source: own study using Google maps data)

It should be emphasized that the area occupied by the power output infrastructure will be only a small part of the designated infrastructure corridor. The assumed width and shape of the corridor makes it possible to freely adjust the course of the direction of power output infrastructure within areas of urban agglomerations and concentrated settlements, as well as areas of higher social (cultural, recreational and health) value in such a way that the infrastructure bypasses the above-mentioned facilities. Thus, the infrastructure corridor is an area where the implementation of power output infrastructure will take place, which does not mean that the area will be entirely transformed and developed.

The entire area intended for the location of the power output infrastructure corridor will be covered by an environmental survey, and the impact assessment of this part of the project will be analyzed in detail at the EIA Report stage.

Development of the Project site

4.2.4

The area of the planned construction site of NPP power units in its northern part is an area of industrial use characterized by the lack of vegetation cover, with industrial buildings present – according to CLC2018 (Corine Land Cover – European spatial database of land cover/land use in Europe), it is an area classified as class 121

(characterized by the lack of vegetation cover with industrial buildings present). Currently, in the central part of the Site there is the construction site of the CCGT, and previously there was the construction site of the not completed Ostrołęka C coal-fired unit. Before the construction of the coal-fired power unit, there was a repository for waste remaining after the construction of Ostrołęka A and B power plants. For the construction of the coal-fired power unit, the repository was reclaimed. As part of the reclamation, layers of soil and waste that did not meet the parameters of the construction substrate were removed and the site was leveled. The southern part of the area intended for the construction of the NPP is made up of forest areas designated by class 313 – mixed forests (plant formations composed of deciduous and coniferous trees, which occur in an almost equal degree of mixing in areas of 25 hectares).

The most significant facilities adjacent to the site of the proposed nuclear facility comprise: Ostrołęka Power Plant, Ostrołęka CHP (under construction), Ostrołęka CCGT (under construction, on a closed area in accordance with the decision of the Minister of Climate and Environment), 400/220/110kV “Ostrołęka” substation, Ytong building ceramic plants, and the bankrupt Prywatne Gospodarstwo Ogrodnicze Sp. z o.o. (bankruptcy declared in 2018). To the west, a railroad line with a siding serving the Ostrołęka B power plant (formerly also the Ostrołęka A power plant), as well as one that can serve the nuclear facility and the CCGT, runs along the boundaries of the plots intended for the location of the nuclear facility.

The infrastructure corridor within which cooling water pipelines are planned to be built, along with the raw water intake and pumping station, according to CLC2018, mainly consists of industrial or commercial areas and low-density housing (classes 121 and 112, respectively). A considerable part of the area is not covered in vegetation: there are numerous residential and industrial buildings and paved surfaces. In the vicinity of the Narew River, class 231 (meadows and pastures) and 312 (forests and shrub vegetation in a state of change) dominate – these are vegetation formations composed mainly of trees, as well as thicket and shrubs. Coniferous tree species predominate here.

The infrastructure corridor in which the construction of the power line being the power output to the NPS is planned overlaps to a large extent (its western part) with the infrastructure corridor in which the construction of cooling water pipelines is planned. This area is dominated by industrial and residential development with numerous paved surfaces and relatively little vegetation cover. By far the largest part of the eastern area of the corridor, where the construction of the power output infrastructure is planned, consists of forests and thicket included in class 324 (forests and shrub vegetation in a state of change). These are formations that are the result of forest degradation or regeneration. Forest nurseries and clearing operations are also included in this class. To a lesser extent, areas of classes 312 (coniferous forests) and 211 (arable land beyond the reach of irrigation facilities) are also visible⁶ (Fig. 7).

⁶ Based on Corine Land Cover 2018

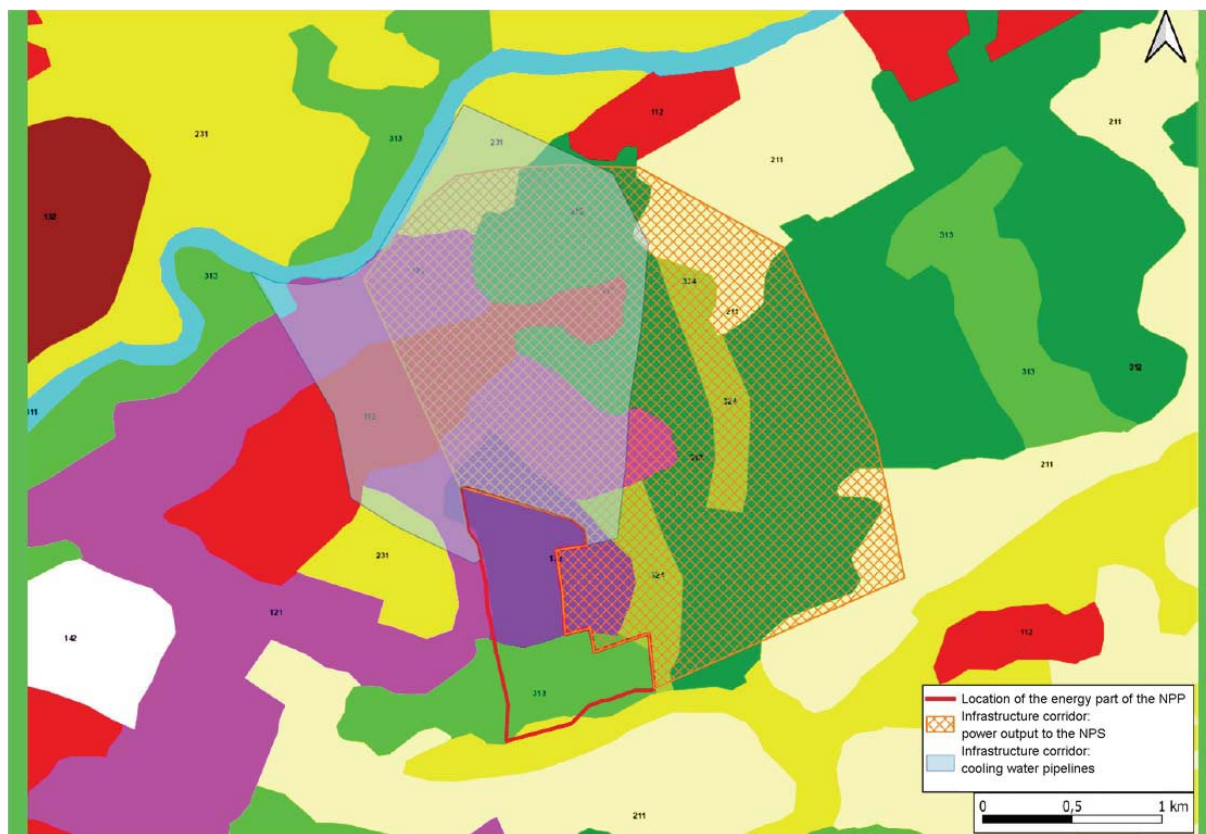


Figure 7. Land cover forms (Source: own study using Corine Land Cover 2018)

In the area of the project plots, there are, i.a., power, gas, sewerage, water supply, and telecommunication systems. Prior to the commencement of construction works, all infrastructure components will be relocated outside the Project area.

Anticipated surface area of the Site

4.2.5

According to information provided by the technology supplier – GE-Hitachi, construction of one 300 MWe power unit using the BWRX-300 technology requires the estimated surface areas specified in Table 5.

Facility	Estimated surface area [ha]
Office buildings	0.4
Parking area	0.3
Spent nuclear fuel storage facility (dry)	0.2
Maintenance buildings (workshops)	0.8
Power Unit including the turbine hall building	1.3
Electrical switchyard	1

Table 5. Estimated surface area of real property required for the construction of a 300 MWe nuclear power plant using BWRX-300 technology (based on data provided by technology supplier GE-Hitachi, BWRX-300 Generic Plant Parameter Envelope 005N3953 Rev. D).

Table No. 5 does not include facilities whose dimensions depend on the specifics of the site or for which no final decision has been made at this stage of the works regarding the planned technical solution (e.g. cooling system).

It is assumed that the estimated surface area of land required for the construction and operation of one 300 MWe power unit including the technical infrastructure is approx. 10 hectares. For the duration of construction, a site back-up facilities will be established that will be used as a parking and repair area for construction machinery, a storage area for prefabricated power plant components, or a warehouse for construction materials. The site back-up facilities will occupy a surface area of approx. 10 ha.

Depending on field conditions affecting the spatial distribution of nuclear power plant components, the developed area of the real estate may change. In addition, it should be noted that in the case of the construction of a multiple unit nuclear power generating plant, the total developed area per one power unit will be smaller due to the presence of common elements such as parking areas, such as office buildings and workshops.

At the current stage of preparation of the Project; however, it is not possible to precisely determine the occupied surface area. The final surface area of occupied area will be determined at the stage of EIAR preparation.

The area required for the construction of cooling water pipelines of up to several hectares should be added to the surface area of the Investment Project, depending on the chosen method of cooling the power plant and its final power output.

The areas occupied for the construction of infrastructure in the form of water pipelines for making-up the cooling circuit and the power line will be determined at the stage of the EIA Report.

Local Development Plan

4.2.6

On the Site, the provisions of the Local Development Plan (MPZP), adopted by the Ostrołęka City Council are in force: resolution No. 105/XVI/2003 of the Ostrołęka City Council of December 3, 2003 on amendments to the local general development plan of the City of Ostrołęka in terms of structural units: B1 I, B1 II and B3 II (northern part) – “WOJCIECHOWICE” region. According to the adopted Local Development Plan, the areas intended for the various elements of the Project are designated as follows:

- planned area for the construction of power units with auxiliary buildings and technical infrastructure: the area is not included in the Local Development Plan.
- planned construction site for cooling water pipelines (within the designated infrastructure corridor): P (industrial areas), MN/U (areas of single-family housing with services), KW/MN/U (internal streets, areas of single-family housing with services), KK (railway areas), EE (buffer zone area), LS (forest areas), PSU (industrial areas, warehouses, services,), U/MW (areas of services with multi-family

housing), UO (areas of educational services), MW (areas of multi-family housing), PT/PSU (areas of city maintenance and industrial areas, warehouses, services), PT (areas of technical service of the city), KUG (areas of main streets (national No. 61)), KUL (areas of local (municipal) streets), U (areas of services), UK (areas of religious worship), ZP (areas of park greenery), PTU/KK (areas for production-technical-service development with railroad areas), PTU/KK (areas for production-technical-service development with railroad areas), ZN (areas of low landscaped greenery).

- power output (infrastructure corridor within which the power line or lines connecting the power plant to the substation will be executed): P/U/E - IN (areas for the location of local and supra-local power equipment, including substations and power lines), P (industrial areas), MN/U (areas of single-family housing with services), KW/MN/U (internal streets, areas of single-family housing with services), KK (railway areas), EE (buffer zone area), LS (forest areas), PSU (industrial areas, warehouses, services), U/MW (areas of services with multi-family housing), UO (areas of educational services), MW (areas of multi-family housing), PT/PSU (areas of city maintenance and industrial areas, warehouses, services), PT (areas of technical service of the city), KUG (areas of main streets (national No. 61)), KUL (areas of local (municipal) streets), U (areas of services), UK (areas of religious worship), ZP (areas of park greenery), PTU/KK (areas for production-technical-service development with railroad areas), PTU/KK (areas for production-technical-service development with railroad areas), ZN (areas of low landscaped greenery).

As a rule, any investment project that is carried out should comply with the provisions of the LDP, if it is in force in the area where the investment project is to be carried out. However, this rule does not apply to nuclear power facilities or associated investment projects.

Non-compliance of the planned Investment Project with the Municipal Development Plan does not affect the possibility of constructing the nuclear power facility. Pursuant to Article 9 section 2 of the Act of June 29, 2011 on the preparation and execution of investments in nuclear power facilities and accompanying investments (Journal of Laws of 2021, item 1484, as amended), the nuclear power facility site permit is binding upon the competent authorities in terms of the preparation of the study of conditions and directions of spatial development, as well as local development plans. The Province Governor should immediately submit the issued nuclear power facility site permits to competent commune heads (town mayors, city presidents). The commune authority should state that the plan provisions are not binding upon it by adopting a resolution expressing a positive opinion on the investment project.

Pursuant to Article 80 section 2 of the EIA Act, the competent authority issues the decision on environmental conditions having ascertained the compliance of project location with stipulations set out in the local development plan, if the plan was adopted. This does not apply to the decision on environmental conditions issued for investment projects in the construction of nuclear power facilities or accompanying investment

projects.

Taking into account the above, it should be concluded that the planned Investment Project is incompatible with the function specified in the Local Development Plans for the analyzed area; however, in view of the regulations cited above, such compliance is not required.

NUCLEAR POWER – GENERAL INFORMATION

5

The history of nuclear power development dates back more than 70 years. Its beginning was in the 1950s. Initially, the development of nuclear technologies was closely linked to military objectives. The main purpose of building nuclear reactors was to produce enriched uranium used to make nuclear bombs. Over time, military objectives have been extended with activities for civilian power sector. In 1951, heat from a reactor was used for the first time in the United States to generate steam and drive a steam turbine. This represented a milestone in the further development of the sector. In 1954, the first nuclear power plant with a capacity of 5 MW was commissioned in Obninsk in the Soviet Union.

Now, after a stagnant stage in the development of nuclear power worldwide, its implementation or development is planned in 35 countries. As of April 2023, 420 nuclear power reactors with a total capacity of 374,827 GWe are in operation, while 56 reactors are under construction⁷.

⁷ Data based on IAEA Power Reactor Information System PRIS as of April 2023.

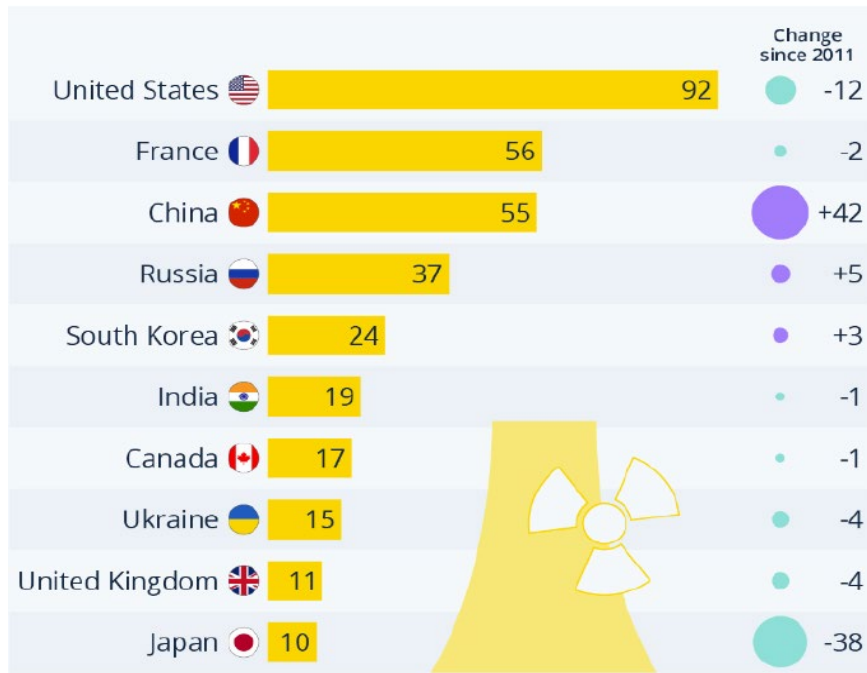


Figure 8. Countries with the largest number of nuclear power plants as of 2011 (source: World Nuclear Industry Status Report 2022, www.statista.com)

NUCLEAR POWER PLANT – PRINCIPLE OF OPERATION

5.1

The general principle of operation of a nuclear power plant, as far as the process of generating electricity is concerned, is not significantly different from that of a conventional thermal power plant – the main difference here is the heat source. While in a traditional power plant the heat is generated by burning coal or gas in a combustion chamber, in a nuclear power plant the heat is the result of the fission reaction of nuclei of uranium atoms inside the reactor.

Fission reaction

5.1.1

The fission reaction involves the fissioning of uranium nuclei under the influence of neutrons. The reaction is a chain reaction – the reaction products (neutrons) initiate subsequent reactions. A single fission reaction creates two nuclei of lighter elements with high kinetic energy (the main part of the energy from the reaction), neutrons, and gamma radiation. Fission products undergo further nuclear transformations, while continuing to emit energy. The neutrons created in the reaction cause subsequent fission reactions of subsequent uranium nuclei, making the reactions of a chain nature. The rate at which the reaction takes place in the reactor is controlled by the amount of

neutrons using the so-called control rods made of neutron-absorbing materials.

The schematic view of the fission reaction is illustrated in Fig. 9.

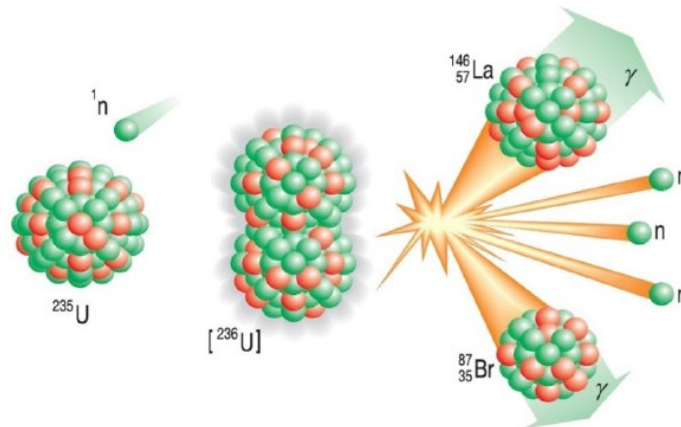


Figure 9. The schematic view of the fission reaction (“Energia jądrowa i promieniotwórczość” [Nuclear Energy and Radioactivity], A. Czerwiński, Oficyna Edukacyjna Krzysztof Pazdro, Warsaw 1998, <http://www.pazdro.com.pl/>)

Nuclear fuel

5.1.2

Uranium in a natural or enriched form is the fuel in nuclear power plants. The type of fuel used depends on the type of a nuclear reactor.

Uranium is formed into special pellets with a maximum length of approx. 15 mm and a diameter of approx. 10 mm. Pellets are then placed in long tubes called fuel rods, which are placed in fuel assemblies consisting of dozens of fuel rods depending on the type and design of a reactor. A set of fuel assemblies forms the reactor core, where a controlled nuclear chain reaction takes place.

Water – moderator and coolant

5.1.3

The element that makes it possible to sustain the chain reaction in the reactor is the so-called moderator. In most cases, it is high-purity demineralized water. The main task of the moderator is to slow down neutrons to a velocity that facilitates fission of the uranium nucleus (neutrons with too high velocity do not cause the fission reaction in sufficient capacity). The second extremely important function that water performs is cooling the reactor core. Water acts as a medium for transferring thermal energy to subsequent stages of conversion. In addition, ensuring that there is enough water in the reactor protects its core from overheating and a serious accident involving core meltdown.

Water, flowing between fuel elements in the reactor core, receives the heat generated during nuclear chain reactions and is transformed into steam (this happens in the so-called boiling water reactors) or, while obtaining a sufficiently high temperature, is sent to a steam generator, where, giving up heat, it causes the formation of steam in the secondary circuit (this happens in pressurized water reactors). In BWR-type reactors, water at a pressure of approx. 7.0 MPa evaporates directly in the reactor core and, when dried, is directed to the turbine, where thermal energy is converted into mechanical energy in the form of a rotating motion of the turbine shaft driving a generator, where mechanical energy is converted into electrical energy. Generated electricity receives proper parameters for the power system it feeds (Fig. 10) using transformer systems.

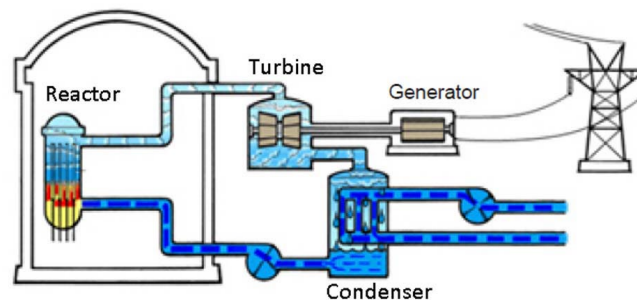


Figure 10. General process flow diagram of a NPP with a BWR (<https://www.nrc.gov>)

Reactor power is controlled using control rods. The insertion of control rods into the reactor core lowers the intensity of the fission reaction and, as a result, reduces the reactor power. Control rods are inserted between fuel elements when the reactor needs to be shut down also in emergency situations⁸.

COMPONENTS OF A NUCLEAR POWER PLANT

5.2

A typical nuclear power plant can be divided into two parts including:

- **Nuclear**
a nuclear island – a nuclear reactor and safety systems building
- **Non-nuclear**
turbine hall – turbine units, generator
cooling circuit

⁸ <https://swiadomieoatomie.pl/Energetyka-jadrowa/Kompendium-wiedzy/Elektrownia-jadrowa/Jak-dziala-elektrownia-jadrowa>

electrical switchyard
power output infrastructure
administration buildings
interim radioactive waste storage facility
auxiliary and associated infrastructure

POWER PLANT COOLING CIRCUIT

5.3

All thermal power plants, including nuclear power plants, are capable of converting only part of the thermal energy into electricity, while the rest of the heat generated must be discharged as waste heat.

When output from the reactor, steam with correct parameters is supplied to the turbine, while setting it into rotating motion (conversion of thermal energy into mechanical energy). The turbine drives a generator, where electricity is generated (conversion of mechanical energy into electrical energy). After passing through the turbine, the steam is directed to a condenser, where condensation takes place, i.e. the water state of matter is changed from gas to liquid. Heat removed from the condenser has parameters that limit its further use in a technological process (due to its too low temperature), so it is considered waste heat. Condensate (condensed steam) then flows through a system of pumps (a condensate pump and feedwater pump) and a system of regenerative heat exchangers and, having correct parameters (pressure and temperature), returns to the reactor, closing the primary circuit of a BWR-type power plant.

The cooling circuit of the power plant is intended to dissipate heat from the condenser with water as the working medium. The cooling circuit in a BWR-type power plant is a secondary circuit, i.e., heat is received in a condenser and water working in the cooling circuit does not come into direct contact with water working in the primary circuit of a power plant.

There are two main types of cooling circuits:

- **once-through cooling system**
- **closed-circuit cooling system**
 - natural draft cooling towers
 - mechanical draft cooling towers

Once-through cooling system

5.3.1

In a once-through cooling system, cooling water is taken via cooling water channels

from rivers, seas or other water bodies. As the water flows through the condenser, it receives heat, and then heated water returns to the same source from which it was taken. The heat is returned entirely to the water body. Due to the fact that after leaving the cooling system, the water has a higher temperature compared to the temperature of the liquid in the source from which it was taken, the water intake and discharge system must be properly designed so that discharged waters do not mix with intake waters causing them to heat up, which will consequently reduce the efficiency of the entire cooling system.

Closed-circuit cooling system

5.3.2

PRINCIPLE OF OPERATION OF COOLING TOWERS

Water flowing through the condenser removes heat from the primary circuit of the power plant. The heated water is then piped to the inlet manifold of the cooling tower and distributed through a system of internal pipes to the spray nozzles, whose task is to break up the water jet into small droplets dispersed evenly at a suitable place inside the cooling tower (above the fill packs). As it falls, the water gives up heat to the air flowing from the bottom to the top (in a countercurrent flow). Air movement is forced by the draft created in the cooling tower due to its geometry. Cooling of water is obtained mainly by evaporation of a small part of the water stream (approx. 1.5%) and due to heat exchange between water and air by convection.

The cooled water accumulates in a collection basin at the bottom of the cooling tower, from where it is sucked up by circulating pumps. The water is then directed to a condenser. Water circulates in a closed-circuit cooling system – it removes heat from the condenser and discharges it to the environment through the atmospheric air. In the system, there are losses associated with evaporation, drift and the need to demineralize the circulating water.

Due to the large height of cooling towers and the heating of air inside, a stack effect is created, forcing air from the bottom to the top of the cooling tower without the use of fans.

PRINCIPLE OF OPERATION OF A MECHANICAL DRAFT COOLING TOWER

Physical processes leading to the reduction of water temperature that take place in a mechanical draft cooling tower are the same as those of a cooling tower without fans. The difference between the two types of cooling towers is that in mechanical draft cooling towers the airflow is usually generated by an axial propeller fan located at the top of the cooling tower above the water distribution system. Louvers – drift eliminators are placed above the fill pack, stopping water droplets lifted by strong air currents, thus reducing drift losses. The capacity and parameters of the fan are selected to ensure

that the heat is removed from the water supplied to the cooling tower. Air flows into the cooling tower through inlet windows below the fill pack. The use of fans makes it possible to significantly reduce the size of mechanical draft cooling towers relative to natural draft cooling towers.

Regardless of the cooling option chosen, it is necessary to build cooling water channels (in the form of pipelines) that will supply raw water from the water reservoir to the power plant to make up for water losses occurring in the cooling system.

For a description of the cooling options for the proposed nuclear power plant at the Site see Chapter 7.1. Options of the cooling technology.

DESCRIPTION OF THE TECHNOLOGY SELECTED FOR IMPLEMENTATION – BWRX-300

6

GENERAL INFORMATION

6.1

The boiling water reactor (BWR) is a common type of the power reactor. It is a nuclear reactor moderated and cooled with water circulating in a single circuit – water converted to steam in the reactor is supplied directly to the turbine that drives the generator, then cooled and condensed steam is returned to the reactor.

So far, during more than 60-year history of development of BWR type reactors, 113 boiling water reactors have been constructed and commissioned in the world, and two ABWRs are currently under construction. There are currently 48 BWRs in operation worldwide. The highest concentration of boiling water reactors is in the USA, where 31 of 93 reactors currently in operation are BWR-type units⁹. Outside the USA, the technology is used in, i.a., Sweden, Finland, Spain, Switzerland, Japan, and Taiwan.

The BWRX-300 reactor is a boiling water reactor designed to achieve optimum investment cost while maintaining safety standards and minimal environmental impact at every stage of the investment project life.

The BWRX-300 design is the 10th generation of the boiling water reactor technology, and it is based on proven solutions drawn from past operating experience. Features of the BWRX-300 reactor:

- it is the 10th generation boiling water reactor,
- it represents an evolutionary development of the ESBWR project certified by the

⁹ Data based on IAEA Power Reactor Information System PRIS as of April 2023.

U.S. Nuclear Regulatory Commission (U.S. NRC)¹⁰,

- it has a world-class defense line,
- it is able to operate with variable power according to demand,
- it provides an ideal solution for electricity generation, heat generation and industrial applications (process steam generation),
- design solutions reduce construction time (erection of prefabricated modules on the construction site) and reduce environmental impacts,
- it is a cost-optimized project.

In addition, it should be noted that the BWRX-300 reactor technology undergoes various licensing processes in the in the USA, Canada, and the UK.

Ensuring the safe operation of the BWRX-300 reactor is based on the use of passive systems, the operation of which is based on natural physical phenomena (convection, gravity). The reactor design reduces the number of active components in the safety systems, increasing their reliability. Having the safety of a nuclear power plant operation rely on passive systems has undoubted advantages in that the proper operation of these systems does not depend on actions taken by the operator, nor do they depend on the availability of external power supply. These systems also cannot fail in such a manner that can occur in other technologies based on the operation of solenoid valves or pumps. Passive systems provide effective cooling of the reactor core during normal operation, as well as in the event of accident conditions. The system will work even if there is no electric power supply.

The BWRX-300 design is a direct evolutionary development of the design of the large 1520 MWe ESBWR reactor, which successfully passed the certification process of the U.S. Nuclear Regulatory Commission (U.S. NRC). Compared to its larger and older predecessor, the BWRX-300 is distinguished by its ten times smaller size of the reactor concrete shield. The reactor core contains about 5 times less fuel (resulting in less fission products produced) and approx. 5 times less thermal power, which has an impact on the lower requirements for heat removal from the reactor (including residual heat in potential adverse events). GNF2-type fuel rods manufactured by GE Hitachi Nuclear Energy are used as the fuel for the reactor. Water is used as a coolant and neutron moderator.

The BWRX-300 design is based on proven fuel, materials, and manufacturing processes, while incorporating innovative solutions such as passive and simple design concepts.

BWRX-300 reactors are characterized by a high degree of standardization, which allows for mass production of components and, as a result, a reduction in costs and potential environmental impact. The most important advantages of SMRs are lower reactor construction costs compared to large BWR-type units, while maintaining the

¹⁰ <https://www.nrc.gov/reactors/new-reactors/large-lwr/design-cert/esbwr.html>

safety standards of these reactors.

The main components of the BWRX-300 reactor will be manufactured in specialized production facilities and will be delivered to the construction site in the form of prefabricated components ready for erection. The preparation of components in specialized factories enables high standards of their quality to be maintained. Such a solution allows a significant reduction in construction time and the scope of the necessary construction works at the site, which is associated with a lower environmental impact during the construction of such a facility.

The BWRX-300's design enables clean power generation with high reliability and flexibility at costs competitive with natural gas-fired power plants. Expected services include:

- electricity generation operating at the base load of the power system (continuous operation at the fullest possible capacity),
- generation of electricity with variable capacity depending on the load, generally in the range of 50 to 100 percent of capacity (power system balancing),
- large-scale heating engineering,
- production of other process heat,
- use of electricity for green hydrogen production.

What distinguishes BWRX-300 (following its predecessor – ESBWR) from older types of BWRs is the use of natural circulation of coolant in the reactor core instead of circulating pumps. The use of such a solution both reduces investment costs and improves safety, as the number of moving parts that could potentially be a source of failure is reduced. The very principle of the steam generation system remains characteristic of boiling water reactors: water supplied as coolant boils in the reactor and is supplied as steam directly to the turbine. Steam from the turbine is condensed in a condenser and routed back to the reactor vessel (through filtration, demineralization systems and heaters).

The BWRX-300 design ensures optimization of construction, operation, repair, maintenance and decommissioning costs. These costs have been minimized while maintaining the highest safety class by safety strategy based on sequences of defense lines in accordance with the defense-in-depth concept of the International Atomic Energy Agency (IAEA). The concept and other safety-related solutions are described in chapter 10 Solutions protecting the environment.

CONCEPTUAL OUTLINE OF THE BWRX-300 POWER UNIT DESIGN

6.2

The main part of the investment project, according to the preliminary concept, will be

the power unit, which will include, among others (Fig. 11):

- Reactor Building,
- Turbine Building (Turbine Hall),
- Control Building (Control Room Building),
- Radwaste Building.

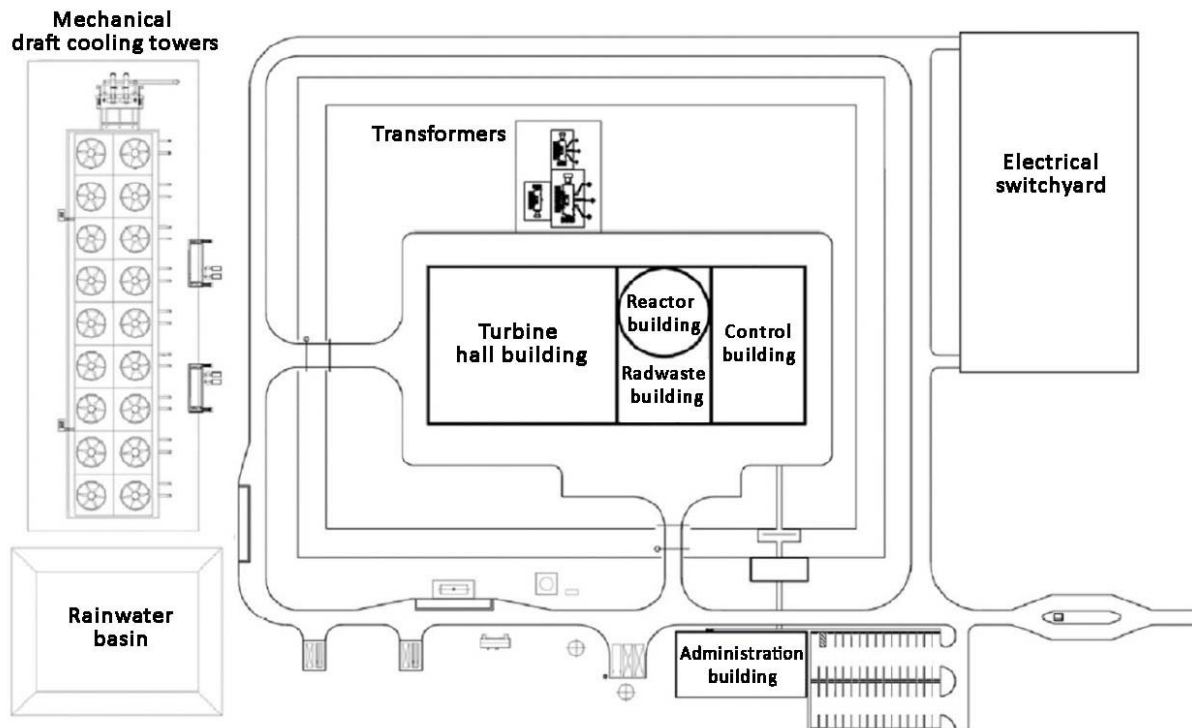


Figure 11. Example location of power plant buildings (source: GE-Hitachi)

The power unit together with auxiliary buildings and technical infrastructure will occupy an area of approximately 10 hectares (Fig. 12). The approximate dimensions of the power unit buildings are shown in Table 7. The specified values are subject to change depending on the final building permit design, which will be developed at a later stage of the Project.

Building	Length [m]	Width [m]	Height [m]
Reactor Building	40	40	40
Turbine Building	75	65	35
Control Building	40	15	15
Radwaste Building	40	40	30

Table 6. Example of dimensions of the main buildings of the BWRX-300 power unit (Source: technology supplier GE-Hitachi)

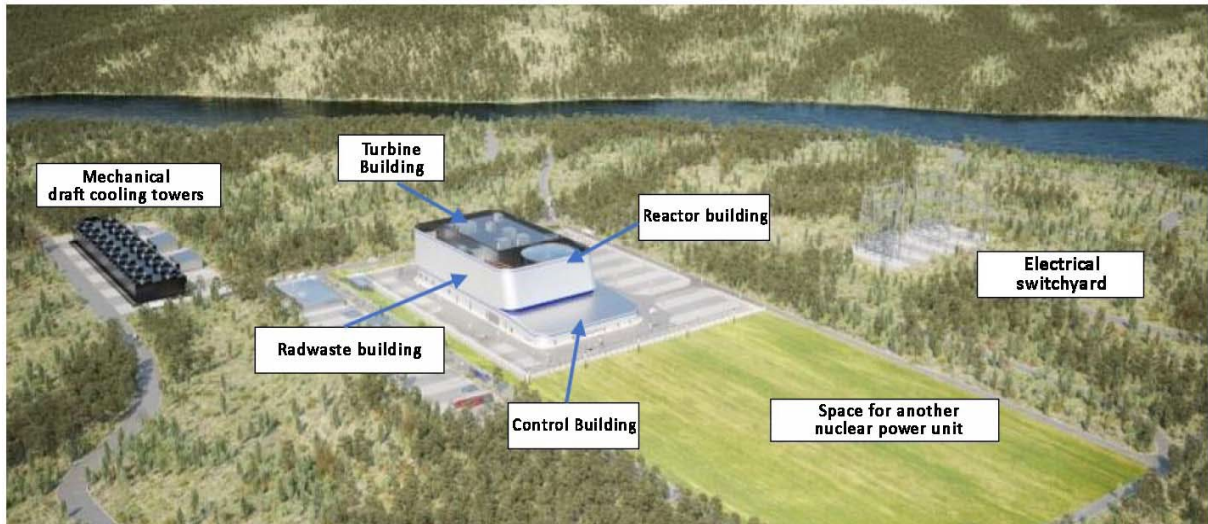


Figure 12. Visualization of a power plant with the BWRX-300 reactor (source: GE-Hitachi)

Reactor Building

6.2.1

The main building of the power unit as well as the entire nuclear power plant is the Reactor Building. The Reactor Building (Fig. 13) extends below the ground level, where the Primary Containment Vessel (PCV) and the Reactor Pressure Vessel (RPV) are partially located, forming the centerline of the Reactor Building with a cylindrical shape. The reactor core is located inside the reactor pressure vessel. The Reactor Building is distinguished from nuclear power plants (NPPs) by its unique design and construction method. The building is a cylindrical structure set in a vertical excavation approx. 36 m below ground level and approx. 40 m in diameter.

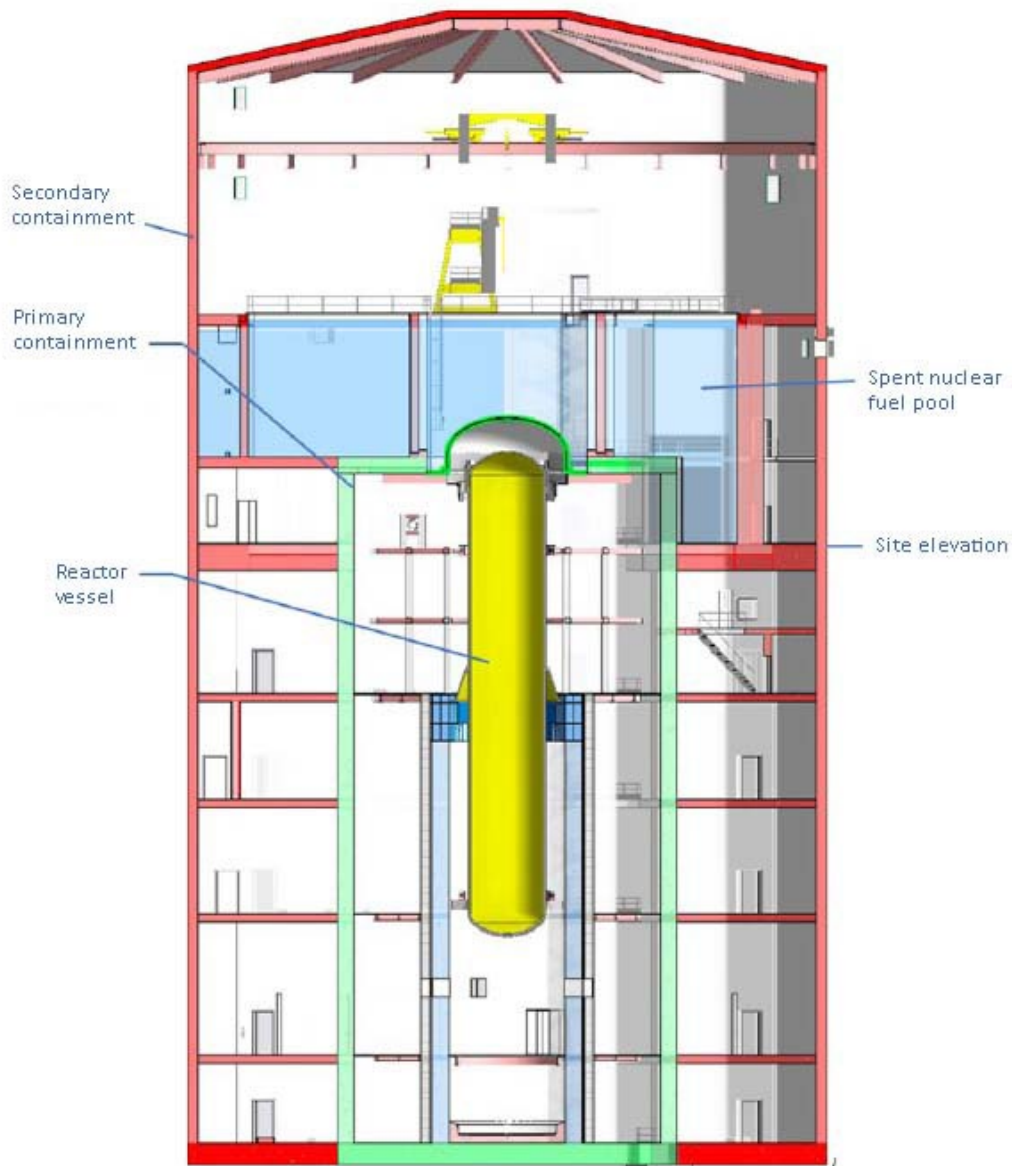


Figure 13. Reactor Building – Schematic cross-section through the primary containment of the BWRX-300 reactor (source: GE Hitachi)

The excavation will be performed using techniques commonly used in mining and construction. The underground structure of the Reactor Building minimizes the need for concrete compared to the surface installation of the reactor pool. Above the primary containment there is a pool in contact with the containment head that provides a backup source of reactor cooling water in the event of an accident.

The Reactor Building is equipped with safety systems to protect against potential consequences of a reactor failure. It has been designed to withstand any external event such as earthquakes, floods, fires, extreme weather conditions or aircraft impact.

The spent fuel pool is located at the ground level in the Reactor Building and has enough capacity for the storage of spent fuel from eight years of operation and a full discharge of the core.

The Reactor Building was designed in such a way that in the event of an adverse event, its structural integrity is fully preserved, and so that such an event does not endanger the systems, structure and equipment components that perform safety-related functions.

Turbine Building (Turbine Hall)

6.2.2

The Turbine Building is where the electricity is physically generated. Steam from the reactor via pipelines is transferred to the Turbine Hall, where it drives the turbine (Fig. 14) connected to the electric generator, in which electricity is generated.



Figure 14. Example of a steam turbine (source: GE-Hitachi)

The Turbine Hall houses the turbine generator unit (turbine and generator) along with pipelines supplying steam from the Reactor Building, auxiliary systems of the turbine generator unit, condenser system, condensate circulation system, and cooling water fed back to the Reactor Building, along with auxiliary systems for filtration and preheating.

Control Building (Control Room Building)

6.2.3

The Control Building is intended for automation and control systems. The building houses the Main Control Room (MCR), where operators monitor and control operating parameters of the reactor, the Emergency Operation Center (EOC), and the electronic and structural components that make up the instrumentation and control (I&C) system without measurement and transmission parts located in other buildings. The design of the Control Building ensures safe working conditions for reactor operators and does not adversely affect systems, structures and components responsible for performing safety functions in the event of adverse events.

Radwaste Building

6.2.4

A special-purpose building for the management of interim radioactive waste generated during reactor operation. It includes systems, structures and equipment responsible for waste volume reduction, segregating waste by category or subcategory and preparing it for transport or storage as well as gas filtration systems using carbon absorbers. The building structures are designed adequately to the activity of the substance in accordance with the standards of radioactive waste management buildings.

Main design solutions of the BWRX-300

6.2.5

Although the BWRX-300 is predominantly a traditional boiling water reactor, several simplification features have been incorporated into its design resulting in an improved concept for mitigating adverse events and leading to lower costs. The following features should be mentioned:

- reactor vessel isolating valves: the BWRX-300 reactor pressure vessel is equipped with isolating valves that provide fast isolation of the broken pipeline, helping to mitigate the consequences of the Loss of Coolant Accident (LOCA). All large fluid transfer piping systems are provided with double isolating valves that are an integral part of the reactor pressure vessel;
- no pressure relief valves: pressure relief valves have been eliminated from the BWRX-300 design. The high-capacity Isolation Condenser System (ICS) provides the reactor overpressure protection. Historically, safety valves were the most likely cause of LOCA, therefore they were eliminated from the BWRX-300 design, and their function was replaced with another solution (ICS);
- the passive nature of the reactor core Isolation Condenser System (ICS): this system performs its function without the need for power, using the law of gravity and natural convection, which determines its high reliability;
- the use of a dry containment: the BWRX-300 reactor has a dry-type containment, which provides effective containment of steam, water and fission product emissions following a hypothetical LOCA;
- passive cooling system for the primary containment: ensuring that the temperature and pressure inside the containment are maintained within design limits. The system performs its function when required without the need for power supply and using the law of gravity and natural convection, which determines its high reliability;
- the use of standard commercially available equipment: due to its smaller size, the

BWRX-300 design makes greater use of standard commercially available equipment than previous boiling water reactors. This makes it possible to adapt technical solutions proven in the non-nuclear industry.

The design solutions used ensure that safety design goals are met. Even in the event of a hypothetical accident with estimated frequency of occurrence of less than 1 in 10,000,000 years of reactor operation, safety functions will remain preserved (safe shutdown of the reactor, ensuring effective cooling, and protecting against releases) for 7 days without the need for operator action or external resources. In existing nuclear power plant designs, the design self-sufficiency time is 72 hours. In BWRX-300, the time margin has been significantly extended, assuming a backup for external operations even in the most extreme adverse event scenarios (experience from the Fukushima accident events).

The technical design of the BWRX-300 virtually eliminates the risk of a major accident resulting in the release of radioactive substances into the environment (probabilistic analyses estimate the probability of a major accident at less than 1 in 10,000,000 years of reactor operation).

A simplified diagram of the BWRX-300 design showing concepts of operation is presented in Fig. 15.

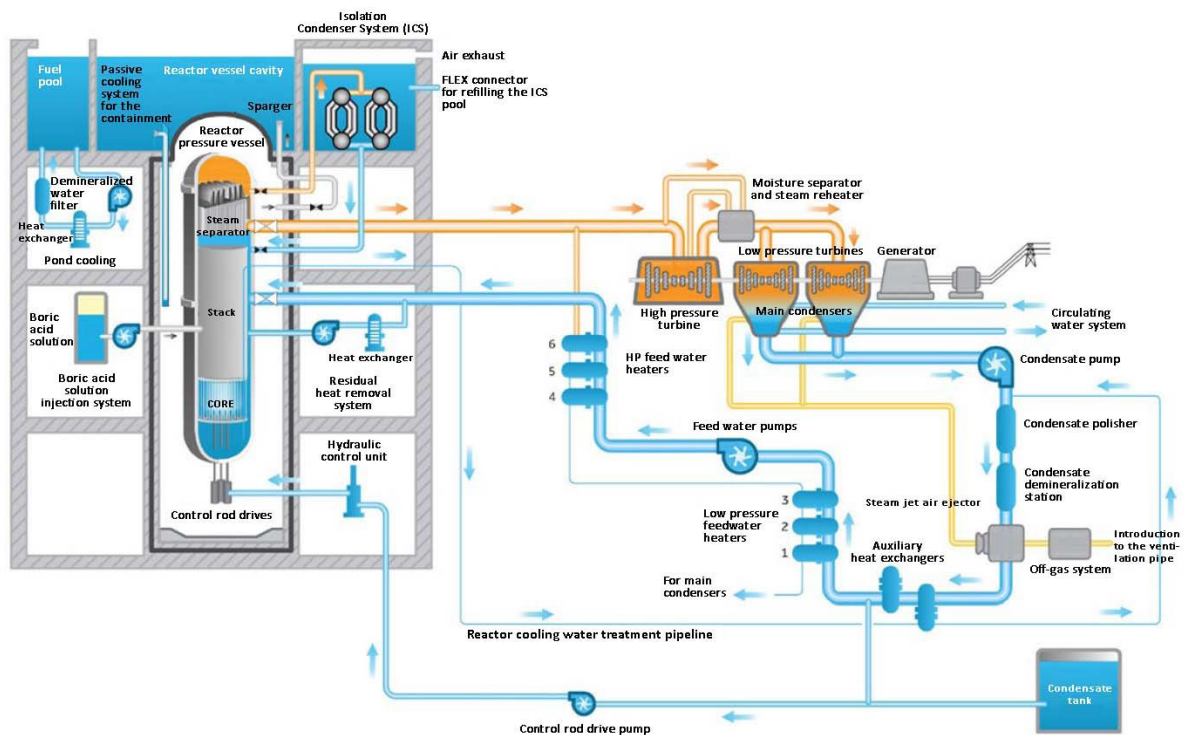


Figure 15. Simplified diagram of the BWRX-300 systems (source: GE-Hitachi)

PROGRESS OF BWRX-300 TECHNOLOGY LICENSING PROCESSES IN THE WORLD

6.3

At present, licensing or preliminary approval processes for BWRX-300 technology are taking place in several countries including those with a long tradition and extensive experience in nuclear power plant operations such as Canada, the United States and the United Kingdom. Poland is also among the countries actively involved in the BWRX-300 technology project evaluation process.

Canada

6.3.1

The world's most advanced licensing process for BWRX-300 technology is taking place in Canada, where an experienced nuclear power plant operator that is also the largest energy producer in the Ontario province – Ontario Power Generation (OPG) – applied to the Canadian Nuclear Regulatory Commission (CNRC) on October 31, 2022 for construction licenses for a nuclear power plant at the DNNP-1 Darlington site in the Ontario province. OPG's works schedule calls for the plant to begin operation in 2028.

The actual licensing process for the technology in Canada began in 2019, when GE Hitachi applied to the CNRC for an early Vendor Design Review (VDR) of the proposed technology. The VDR is a non-mandatory, optional early technology review process intended to evaluate whether adopted design solutions meet the requirements of Canadian nuclear regulations. The CNRC's review of design documentation consisted in identifying any design issues that could become significant obstacles in the construction licensing process for new nuclear projects using BWRX-300 technology. Canada's VDR process ended in March 2023 with a positive CNRC review. Based on the documents reviewed, the CNRC concluded that the BWRX-300 reactor does not have any significant design features that would prevent the issuance of a permit for its construction.

The selection of the BWRX-300 technology by OPG, with which OSGE is working closely, is an important factor for the implementation of the Investment Project in Poland. It means that Poland's first BWRX-300 nuclear power plant will be a NOAK (Next of a Kind) project, and the Canadian project as FOAK (First of a Kind) will become a reference project for the Polish project. This will enable the use of Canadian experience in the development, preparation of the investment process, licensing, construction and operation of a nuclear power plant of the same type in Poland.

United States

6.3.2

The Tennessee Valley Authority (TVA) – which is the largest public electricity supplier in the United States (USA) – is also interested in developing BWRX-300 SMRs. TVA is planning to build BWRX-300 reactors in the Clinch River near Oak Ridge, Tennessee. The works schedule calls for the first BWRX-300 reactor to begin operation in mid 2032.

The licensing process for the project in the USA began at the end of 2019. The U.S. nuclear regulator has so far approved several reports describing individual technical solutions used in the project (Licensing Topical Report – LTR), with the remaining LTRs in the review phase. LTRs in the USA serve a similar function to the VDR process in Canada. During the process, the safety functions of individual systems and organizational and technical solutions affecting the overall safety of reactor operation are evaluated. The individual LTRs contain data and information that can be evaluated independently in a process unrelated to the issuance of construction license for the power plant. Conclusions of review of LTRs by the U.S. NRC can however be used in the process of evaluating individual construction license applications for reactors being built at different sites and included in different projects. According to the U.S. NRC, such a procedure primarily minimizes the time and effort required to process applications for subsequent licenses for identical designs.

The United Kingdom

6.3.3

In December 2022 GE-Hitachi submitted an application to the UK's Office for Nuclear Regulation (ONR) to begin evaluating the BWRX-300 reactor under the Generic Design Assessment (GDA) procedure.

The GDA is a pre-licensing procedure under which an initial technical and environmental assessment is performed for a nuclear power technology. This is not a mandatory procedure required by law. The GDA's project evaluation concludes with a preliminary safety analysis report and an environmental impact assessment of the technology being evaluated. The GDA process is not connected to a specific site and concerns design assumptions only.

Poland

6.3.4

Polish regulations also provide for a preliminary assessment of applied organizational

and technical solutions for the proposed nuclear technology. In accordance with Article 39b of the Nuclear Law Act of November 29, 2000 (Journal of Laws of 2023, item 1173), the applicant may apply to the President of the National Atomic Energy Agency (PAA) for a general opinion on the applied organizational and technical solutions of the planned nuclear power plant.

The general opinion by the President of the PAA is to assess whether the proposed technology or organizational and technical solutions are characterized by the presence of significant deficiencies that may affect the safe operation of the nuclear power plant. However, the issuance of such an opinion is not a substitute for the process of obtaining a construction license for a nuclear power plant. The general opinion by the President of the PAA is an optional tool, and it is the applicant that may or may not request an assessment of technology or organizational and technical solutions.

In July 2022 OSGE requested the President of the PAA to assess the proposed organizational and technical solutions for the BWRX-300 technology. On May 23, 2023 the President of the PAA issued a positive opinion stating the correctness of the BWRX-300 design assumptions adopted in accordance with nuclear safety requirements. In the opinion issued it was concluded that the assumptions adopted in the design of the technology are correct and meet the requirements of the Nuclear Law Act and selected ordinances on the safety of nuclear facilities. The conclusions presented by the PAA will be used in the development of the detailed design for the GE Hitachi (GEH) reactors to be constructed in Poland.

The opinion emphasized that a complete analysis of the reactor's nuclear safety aspects will be possible after the applicant submits safety analyses, which will take place at the stage of the construction permit application to the President of the PAA.

It should also be noted that for the first time in history a private Polish company is participating in the development of nuclear power technology. In March 2023 Synthos Green Energy Spółka Akcyjna (Joint Stock Company) signed an agreement with OPG, TVA and GEH to co-finance the development of the BWRX-300 technology. The agreement assumes an investment in the development of the GEH-led BWRX-300 project, the total amount of which will exceed \$400 million. Due to these activities, a standard design of the power plant with the BWRX-300 reactor will be prepared, as well as detailed designs for, i.a., the Reactor Building along with the equipment inside, including the reactor.

In summary, the BWRX-300 technology has been pre-assessed for safety by nuclear regulators in the United Kingdom (ONR), the United States (U.S. NRC), Canada (CNSC), and Poland (PAA) during which the technical solutions used in the project were evaluated to meet the regulatory requirements and guides of those countries. It should be noted that the countries listed are among the most experienced in the nuclear power field, and the legal systems and safety requirements are consistent with those of the IAEA.

CONSIDERED OPTIONS FOR THE PROJECT

7

In accordance with the provisions of both international (Espoo Convention, Aarhus Convention, EIA Directive) and national requirements (EIA Act), the Investor is free to determine the possible options for the planned operation. According to the referenced documents, the environmental impact assessment should analyze viable options for the project, including the option to abandon the project. The scale of the project, the technology used, technical solutions and the site of the investment project are most often referenced as examples of alternative solutions.

In the case of the implementation of this Project, the subject of optioneering is the technical solution for the cooling system. An additional option under consideration is also the scale of the investment project.

The subject of the optioneering is not technology due to the fact that the investor has selected the technology. The Project is for the construction and operation of the GE-Hitachi BWRX-300 reactor. The optioneering of sites is also not considered. This is connected with the new international approach to location of SMRs – potential sites for modular reactors are located in currently operating fossil fuel-fired power plants (Coal2Nuclear) or near existing industrial plants. The purpose of construction and then operation of SMRs is to replace high-carbon sources of energy and heat with a zero-carbon energy source, in this particular case using the BWRX-300 technology. Given the aforementioned information, the Investor has selected the technology, whereas the potential site is based on existing industrial plants, and thus there is no justification for including the optioneering of technologies and sites.

In accordance with the EIA Act, the so-called “zero option” will also be analyzed at the environmental impact assessment stage. This will allow to determine environment impacts if the Project is not undertaken.

TECHNICAL OPTIONS OF THE COOLING SYSTEM

7.1

As part of the preliminary site analyses, the Investor indicated the Narew River as the primary cooling source for the power plant. An assessment of the potential cooling systems that could be implemented at the Site was made. At the current stage of the Investment Project preparation, the Investor does not exclude the possibility of implementing any of the cooling system options described in Chapter 5.3 Power Plant Cooling Circuit. In-depth analyses of water availability, as well as technical analyses

of the possible implementation of different types of cooling system will be conducted. According to the data provided by the technology supplier, the water demand for the once-through cooling system is estimated at approx. 50,000 to 90,000 m³/h, while the water demand for one nuclear power unit with a closed-circuit system averages approx. at 800 m³/h, and in extreme situations (summer period) can reach approx. 1,200 m³/h (water demand for the operation of one BWRX-300 reactor).

The amount of water drawn is the main difference between once-through and closed-circuit cooling systems. In a closed-circuit system, the amount of water taken to make up the cooling system is considerably less than in a once-through system, but this water is lost irretrievably through evaporation and release in the cooling towers. In the once-through system, the entire volume of drawn water, after passing through the NPP cooling systems, is then discharged into the water tank, but the temperature of the discharged water is higher than the temperature of the water in the tank. Due to the large volumes of pumped water, the once-through system will need pipelines with larger cross-sectional diameters, and a pumping station equipped with higher capacity pumps.

In terms of the closed-circuit cooling system, two basic technical solutions are considered:

- natural draft cooling towers,
- mechanical draft cooling towers.

As a rule, traditional cooling towers are taller and bulkier structures compared to mechanical draft cooling towers. They are therefore characterized by higher material consumption at the construction stage, and will generate more waste at the decommissioning stage. Cooling towers also cause a greater impact on the landscape. Mechanical draft cooling towers, on the other hand, are characterized by higher electricity consumption during their operation. As part of the preparation of the EIAR, the investor will analyze and compare the environmental impact of the above-mentioned options and identify the preferred solution.

OPTION FOR THE NUMBER OF NUCLEAR POWER UNITS

7.2

As part of the Investment project, the Investor intends to build and operate a nuclear power plant with a capacity of up to 1,300 MWe. As potential options, the Investor is considering:

- construction and operation of 2 BWRX-300 nuclear power units, or
- construction and operation of 3 BWRX-300 nuclear power units, or
- construction and operation of 4 BWRX-300 nuclear power units.

Thus, the number of power units with immediate environmental impact of the Project will be optioneered with regard to:

- quantities of materials, raw materials and energy used during construction,
- the amount of water needed to make up the cooling system of the power plant (in a closed-circuit system) or the amount of water needed for cooling (in the case of a closed-circuit system),
- acoustic impact of the power plant,
- quantity of waste generated, including radioactive waste,
- quantity of spent nuclear fuel generated,
- size of the paved areas,
- quantity of waste generated during the decommissioning stage of the Project,
- amount of electricity produced (avoiding the CO₂ production)

DESCRIPTION OF THE ENVIRONMENT

8

As part of the preliminary siting analyses, the planned nuclear power plant Site (excluding technical infrastructure) was evaluated to determine the presence of phenomena and hazards in the fields of geology, mining activity, seismology, or human activity. A preliminary analysis of the tectonic structure and seismicity was performed by the Institute of Geophysics of the Polish Academy of Sciences (IGF PAN). An analysis of geological phenomena, hazards posed by human activity, including mining, was conducted by Energoprojekt Katowice (EPK).

As reported by the EPK, given the geological, mining, social and economic conditions, there are no contraindications to the construction and operation of nuclear facilities at the Site considered. Also, the preliminary analysis of tectonic structure and seismicity performed by experts from IGF PAN did not reveal factors excluding the considered Site from the possibility of constructing a nuclear power plant.

The investigations conducted as part of the preliminary analyses refer to the Site Area and the Site Region.

This chapter includes descriptions and conclusions of the aforementioned analyses¹¹
¹².

¹¹ Ostrołęka site analysis final report, Energoprojekt Katowice, 2023

¹² Report on preliminary seismicity assessment for the nuclear facility (Ostrołęka, Ostrołęka district) Institute of Geophysics of the Polish Academy of Sciences, Warsaw, April 2023

According to the physical and geographical division of Poland (Regionalna geografia fizyczna Polski [Regional Physical Geography of Poland], collective work edited by: Andrzej Richling, Jerzy Solon, Andrzej Macias, Jarosław Balon, Jan Borzyszkowski and Mariusz Kistowski, Poznań 2021) the Site, including the area intended for the construction of cooling water channels and power output infrastructure, lies within the region of the North European Plain (31), subregion of the Central Poland Plain (318), macroregion of the North Mazovian Lowland (318.6), mesoregion of the Łomża Interfluve (318.67).

Moraine upland located on the left bank of the Narew river is the highest elevated part of the city of Ostrołęka. It rises on average from 100 to 105 m a.s.l. In the physical and geographical regionalization, it is a mesoregion of the Łomża Interfluve, representing a type of postglacial relief from the period of the middle Polish glaciation, aligned by periglacial and postglacial processes. Currently, the site is an almost flat plain with slopes of no more than 2%. The land relief is diversified by numerous dune forms and, in some places, a well-developed and high batter of the upland with slopes of more than 20% (a narrow edge zone stretching along the Narew river). In the described area, there are also extensive and shallow kettle depressions and valley forms of the fluvial-denudation origin. The largest of these is the valley of the Czeczotka river.

The right bank of the Narew river is an area of sandr plain. According to the physical and geographical regionalization, it is a mesoregion of the Kurpiowska Plain. Morphologically, it is a flat plain surface with slopes of less than 2%, the origin of which is related to the outflow of glacial waters from ahead the face of the continental glacier of the Baltic and middle Polish glaciations. The surface of the sandr slopes gently from the northwest toward the southeast, following the direction of the rivers draining the area: Omulew, Piasecznica, Rozoga. The ground level ordinates range from 95 to 98 m a.s.l. The surface is overbuilt by numerous aeolian forms occurring in the area mainly in the form of extensive dune bars of various shapes, heights, and slope inclinations. The landscape is complemented by extensive but highly fragmented forest areas, mainly dry pine forest and widespread crops on very poor soils, and idle lands.

The valley of the Narew river forms a natural morphological boundary between the above-discussed areas of the sandr plain and moraine upland, as well as the aforementioned mesoregions of the Łomża Interfluve and Kurpiowska Plain. It is elevated at an average of 95–97 m a.s.l., the flood terrace is elevated at an average of about 2–5 m above the water table of the river. It is a flat area, but varied locally with dune hills and numerous depressions, shaped by the flood waters of the river. There are numerous sandbanks and cut-off sections of the old river bed filled with water. The area is mainly covered with meadows and pastures. There are also small groups of

riparian forests¹³.

The topography in the Site Region is presented in Fig. 16.

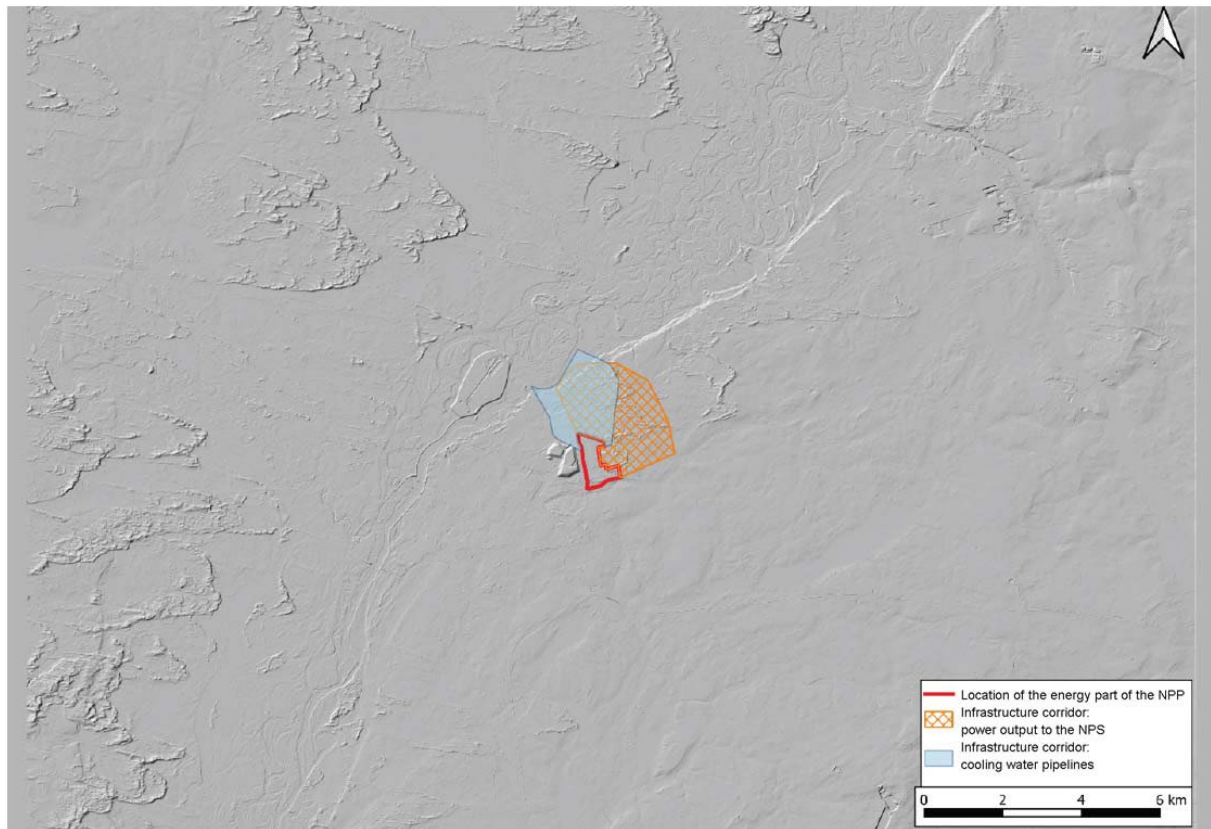


Figure 16. Topography of the Site area (source: Own study using the data from the Digital Elevation Model – geoportal, OpenStreetMap)

■ GEOLOGICAL STRUCTURE

8.2

According to the explanations contained in the Detailed Geological Map of Poland at a scale of 1:50 000 sheet – Ostrołęka (333) (A. Bałuk, 1989) and based on the Explanatory Notes to the Hydrogeological Map of Poland at a scale of 1:50 000 sheet – Ostrołęka (333) (A. Hulboj, 2002), the area of the planned nuclear facility site is located on the slope of the Precambrian East European Platform within the range of

¹³ Study of conditions and directions of spatial development for the City of Ostrołęka, DOM-Pracownia Autorska architektury – Lucjan Chojnowski, Ostrołęka, 2020

the Masuria-Suwałki crystalline core uplift. The overlying Paleogene-Neogene (Tertiary) formations have been subject to erosion processes in the area and have been significantly eroded in some places.

The oldest formations, the presence of which was confirmed by boreholes (with depths reaching 200 m BGL drilled within the sheet area), are Paleogene-Neogene Eocene glauconitic sands (pE) on which carbonaceous sands and loams and sands with glauconite (pOI), and carbonaceous sands (M) are deposited.

Overlying the Paleogene-Neogene formations are Quaternary sediments, the thickness of which in of the planned nuclear power plant site is about 150 m. The Quaternary formations at the Site are built from strata of lower and upper boulder clay (gQp) with a thickness of about 30 m. On top of the boulder clays lie proglacial (varved) clays, (iQp), and on top of them again is a stratum of boulder clays (gQp) of the oldest glaciation (of the Narew river) with inserts of glaciofluvial formations. Within the complex of boulder clays and silty clay loam sediments, there are glaciofluvial sands with gravel (pżQp), drilled in the Ostrołęka region at depths of 80 m. Above these formations, there is a stratum of fluvial and lake sands from the Mazovian interglacial period. Between the above-mentioned sand strata, there is a layer of silt and loam (imQp) with a thickness of several meters, developed during the middle Polish glaciation as an extensive limnoglacial reservoir. A thick layer of silt, loam, and marginal sands (iQp) with a thickness of about 30 m is found on top of glaciofluvial and glacial sands and gravels, and its floor is about 30 m BGL. The next stratum is made up of glaciofluvial sands and gravels (pżQp) and boulder clays (gQp). These sediments are locally overlain by a layer of loam and marginal sands (mpQp) and boulder clay (gQg). The sediments that are located the shallowest sediments are glaciofluvial sands (pQp) (Fig. 17).

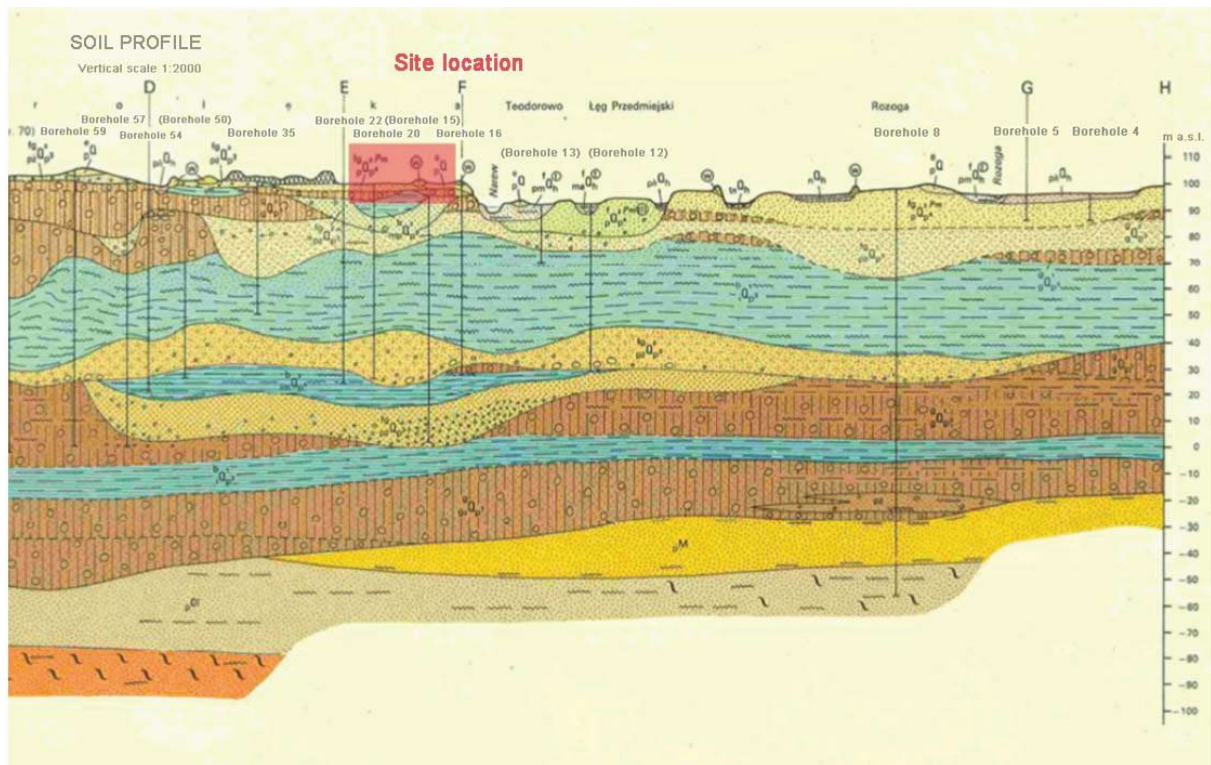


Figure 17. A fragment of a geological cross-section (source: Detailed Geological Map of Poland, sheet – Ostrołęka)

At the current stage of works related to the location of the nuclear facility, it can be assumed that the soil engineering conditions at the nuclear facility site will not differ from those identified for the foundation of the CCGT unit operating at the Ostrołęka C Power Plant site, bordering the SMR Site under consideration. According to the geotechnical opinion developed, it should be stated that despite the presence of varied subsoil and, in some places, marginal formations and varved clays, there are no extensive areas where geotechnical conditions would prevent the location of a nuclear facility. Soils with poor mechanical parameters, weak soils, swelling soils, or other sediments with highly unfavorable parameters for the foundation of a nuclear facility will be removed, replaced, or reinforced as necessary.

Karst phenomena

8.2.1

Karst processes involve the chemical dissolution of rocks by surface and groundwater leading to the formation of rock voids and caves. Limestones, as well as dolomites, marls, gypsum, anhydrite, and halite are mainly subject to the Karst phenomenon.

No Karst formations were found in the Site Area. This is due to the geological structure of the area. According to the Explanatory Notes to the Detailed Geological Map of Poland at a scale of 1:50 000 (A. Bałuk, 1993) and Explanatory Notes to the Geoenvironmental Map of Poland at a scale of 1:50 000, sheet – Ostrołęka (A.

Jasińska, D. Janica, P. Kwecko, I. Bojakowska, H. Tomassi-Morawiec, J. Król, 2010), there are no carbonate or gypsum rocks in the Site Region close to the land surface (there is no bedrock prone to karst processes). According to data from deep boreholes (CBDG), Cretaceous carbonate formations developed in the form of marls occur at a depth of about 230–260 m BGL.

Suffosion phenomenon

8.2.2

Suffosion is understood as the phenomenon of movement of fine soil particles in the pores of its structure under the influence of water movement. As a result of suffosion, pores enlarge, the filtration rate and water velocity increase, allowing water to move larger and larger particles of soil and can cause further development of suffosion until caverns or channels form in the soil. The phenomenon then takes on the characteristics of a piping failure. Suffosion occurs in loose soils, primarily in non-uniform soils. Piping failure should be understood as the deformation of the soil involving the formation of a continuous conduit (channel) in the subsoil, filled with water or soil of disturbed structure (in the final stage of the phenomenon – suspended matter) and connecting places of higher and lower pore water pressure. The external sign of failure are craters (springs) with “boiling” soil suspended matter. In cohesive soils, piping failure is the final most dangerous result of suffosion and can have a somewhat more complex course.

In the Site Area, within the framework of the available geological, hydrogeological, and geoenvironmental data that was analyzed, no such phenomenon was found, but it may occur as a result of poorly conducted earthworks and soil excavation. The possibility of its occurrence and methods to protect against it will be specified in the soil survey report, as well as at the stage of excavation drainage projects.

Landslides, surface erosion, stability of existing batters and slopes

8.2.3

A landslide is a geological form occurring in the terrain relief, created as a result of gravitational displacement along the slip plane, flow or detachment of rock material, in particular, rocks, saprolites, soils, and fills. Landslides may cause damage to infrastructure, crops, forest stands, and general degradation of land subject to mass soil movements. The analysis performed by EPK was intended to assess the risk of a landslide that could affect the safety of the Project at the Ostrołęka Site.

Based on the analysis of the Geoenvironmental Map of Poland at a scale of 1:50 000 (A. Jasińska, D. Janica, 2010) and the Detailed Geological Map of Poland at a scale

of 1:50 000 (A. Bałuk, 1989) sheet – Ostrołęka and according to the conclusions of the geotechnical opinion for the foundation of the designed power unit operating in the CCGT system at the Ostrołęka C Power Plant (in the area bordering the planned SMR Site), no landslides and surface erosion were found in the Site Region. Data on the websites of the Landslide Protection System (SOPO), which is maintained by the Polish Geological Institute – National Research Institute, also confirm the absence of landslides in the described Site Area (Fig. 18).

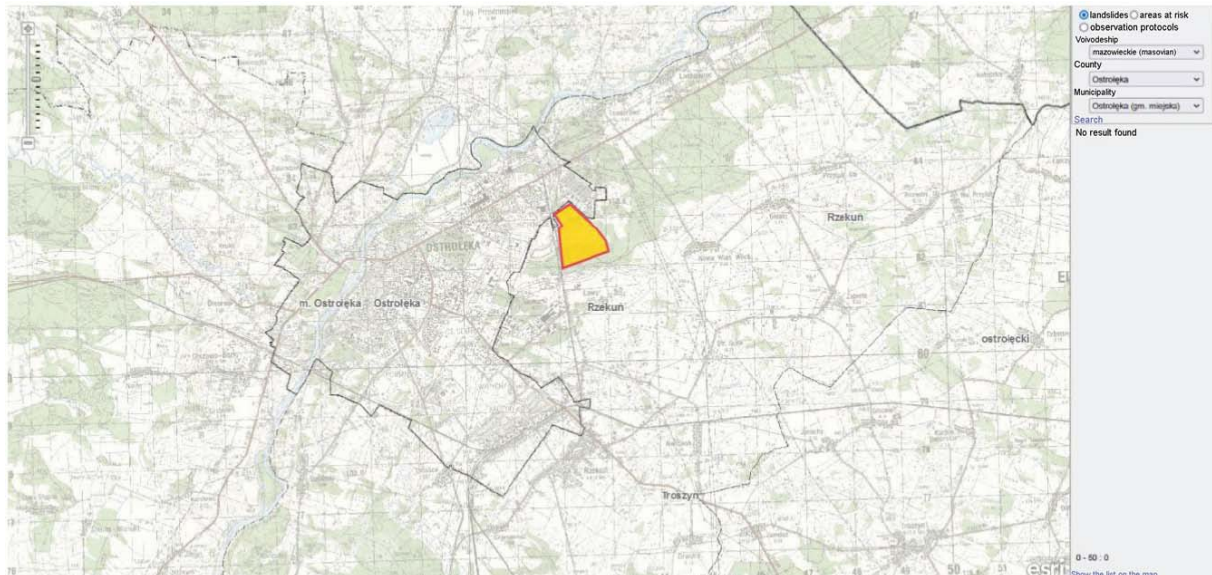


Figure 18. No landslides in the analyzed Site region for the planned location of the nuclear facility (according to SOPO access May 17, 2023) with the approximate location of the nuclear facility and CCGT marked (source: Ostrołęka site analysis final report, 2023, Energoprojekt Katowice)

The stability of existing batters and slopes has been analyzed within the limits of the planned nuclear facility site. As a result of the analysis of the available soil survey report, as well as the site inspection performed on the area designated for the SMR site, it should be noted that within the boundaries of the Site, the land is flat and there are no batters or slopes that could affect the safety of the nuclear facility. The only unevenness of the land is due to its previous use and can be leveled in the course of preparing it for development.

TECTONIC STRUCTURE

8.3

For the preliminary evaluation of the Ostrołęka Site in terms of factors that would preclude the site from being considered suitable for the location of a nuclear facility, analyses were performed by Institute of Geophysics of the Polish Academy of Sciences (IGF PAN) on the fault activity and seismicity of the Site Region and its immediate vicinity.

The Site area in Ostrołęka is located in the most geologically stable region of Poland. Very few faults occur there. They are mostly very old (Precambrian), in any case not younger than the Mesozoic (>250 million years). Their exact age is difficult to determine, because in the analyzed area the Triassic formations lie directly on the Precambrian foundation. The location is within the East European craton covered only by the marginal zone of the Polish basin with a low thickness (about 1000 m). Therefore, the effects of late Cretaceous inversion are not marked there. Neogene and Quaternary fault tectonic activity is also not observed within a radius of much more than 30 km (Zuchiewicz et al., 2007; Jarosiński et al., 2009).

The tectonic features of the Site Region and its surroundings are shown in Table 7.

Feature	Site
Faults entombment	200–250 m under Quaternary formations plus 1000 m under Mesozoic formations (total about 1200 m)
Age of activity	Faults of varying orientation no younger than Triassic (>250 million years)

Table 7. Tectonic features of the Site Region and its surroundings (source: Report on preliminary seismicity assessment for the nuclear facility (Ostrołęka, Ostrołęka district) Institute of Geophysics of the Polish Academy of Sciences, Warsaw, 2023).

Poland, and, in particular the Site Region and Area, and the Site itself, are classified as very low seismic areas. Therefore, from the point of view of the safety of the nuclear facility, an important period of fault activity analysis in the Site Area and Region refers to the period from Pliocene to Holocene, i.e., approximately the last 5.3 million years. The faults in the Site Region are much older. The analysis showed that their last activity took place more than 250 million years ago. Therefore, the faults in the Site Region can be considered as not having the potential to generate natural seismic shocks¹⁴.

SEISMIC CONDITIONS

8.4

Poland, including the Ostrołęka Site Region, are classified as very low seismic areas. According to the current state of knowledge, the macroseismic intensity for the strongest earthquake recorded historically in Poland in the last millennium and using instruments since the 1960s never reached the value of 8 in the EMS-98 scale (B. Guterch, 2009).

In order to assess the seismic conditions of the Site, the identification of Poland's seismogenic zones was performed and the seismogenic potential of these zones was assessed based on the reconnaissance of Poland's seismic activity, analysis of historical earthquakes, and analysis of data acquired with instruments performed by B. Guterch (2009, 2015), and on the basis of literature information. Subsequently, the maximum potential magnitudes of shocks that can be generated by these zones and

¹⁴ Report on preliminary seismicity assessment for the nuclear facility (Ostrołęka, Ostrołęka district) Institute of Geophysics of the Polish Academy of Sciences, Warsaw, 2023

the possible surface effects of these shocks in the Site were determined.

The highest accelerations of ground vibrations, assuming the worst-case scenario, that may occur at the Site were provisionally estimated at the level of $PGA = 0.22 g^{15}$.

MINING ACTIVITIES

8.5

The analysis performed by EPK assessing the effects of current and historical mining activities in the Site Region indicates that there is no potential impact of such economic activities on the safe operation of the nuclear power plant at the Site. The analysis covered:

- range of natural resources deposits,
- effects of historical mining activities,
- range of mining lands,

Location of deposits

8.5.1

The analysis of natural deposit distribution allows the determination of potential locations of future mining operations areas and mining lands that may affect the environment and facilities on the ground surface. As defined in the Geological and Mining Law Act (Journal of Laws of 2023, item 633), the term mineral deposit should be understood as the natural accumulation of minerals, rocks, and other substances whose extraction may bring an economic benefit. Mining of the deposit can be done through underground and open pit mining plants or boreholes.

The analysis identified 137 deposits located mainly to the east and southeast of the site of the proposed nuclear facility. The closest one is the Kupnice-Laskowiec deposit – a deposit of quartz sand for the production of cellular concrete; it is located in the Site Area and is located about 4.0 km to the northeast.

The Site Area in view of mineral deposits is shown in Fig. 19.

¹⁵ Report on preliminary seismicity assessment for the nuclear facility (Ostrołęka, Ostrołęka district) Institute of Geophysics of the Polish Academy of Sciences, Warsaw, 2023

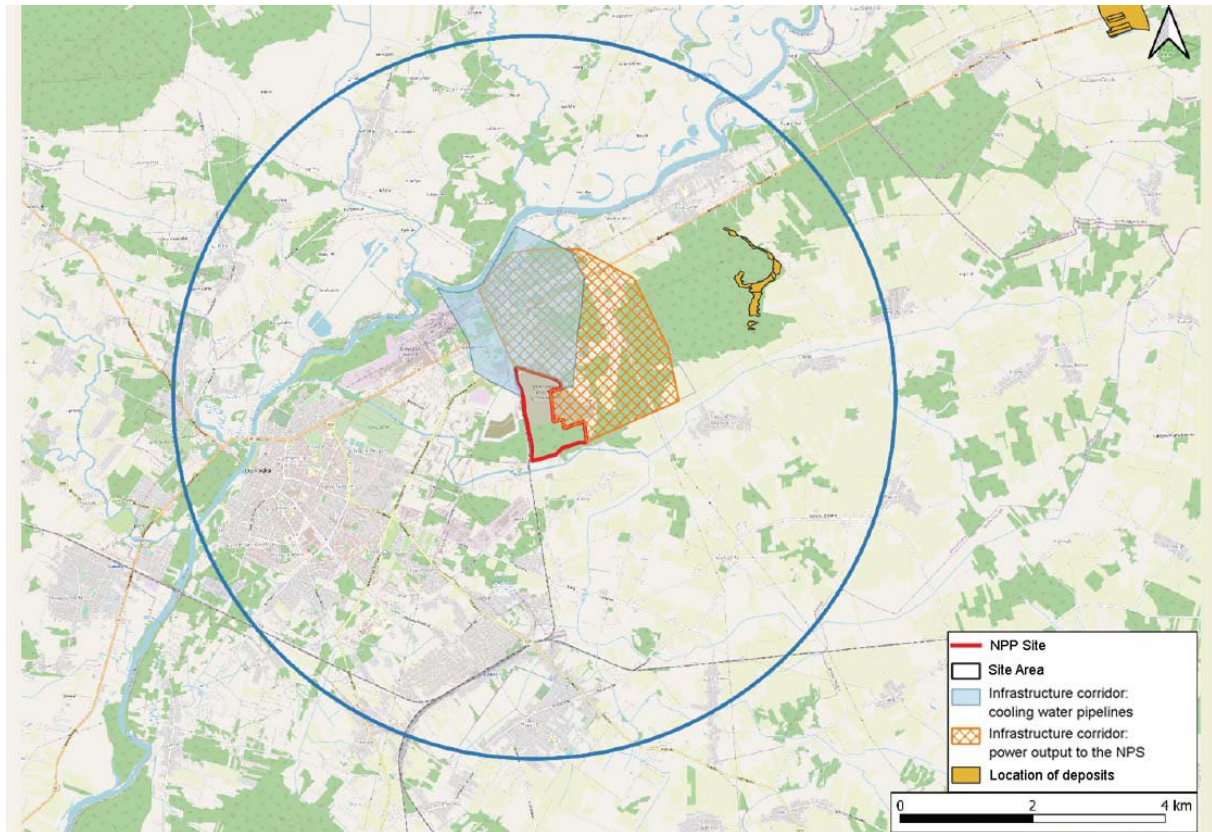


Figure 19. Location of deposits in the Site Area (Source: own study using OpenStreetMap data, CBDG database – mining lands)

The surveyed deposits (excluding the Kupnice-Laskowiec deposit) do not affect the possibility of locating a nuclear facility in the proposed site due to the type of mineral that can be extracted from the deposit. It will be possible to assess the potential impact of the Kupnice-Laskowiec deposit on the nuclear facility site only after the mining licensee has developed a method of mining, and in particular, a method of draining the mining field.

No hard coal and lignite deposits have been identified in the Site Region¹⁶.

In the case of the construction of a nuclear facility, the potential issue of a license for the extraction of deposits in the Site Area and the designation of a mining land will have to meet, in accordance with the Geological and Mining Law, the safety conditions for the nuclear facility. Under Article 104, mining operations areas and mining lands should be included in the land use plan and spatial development plan of the commune and in the local development plan. In accordance with point 5 of Article 104, the Plan may in particular specify the facilities or areas for which a protecting pillar is determined, within the boundaries of which mining plant operation may be prohibited or allowed only in a manner ensuring proper protection of these facilities.

¹⁶ Ostrołęka site analysis final report, 2023, Energoprojekt Katowice

As defined in the Geological and Mining Law Act (Journal of Laws of 2023, item 633), the term “mining land” should be understood as the area covered by the expected harmful impact of mining works of the mining plant. Conducting underground extraction of deposits, regardless of geological and mining conditions, may cause the formation of continuous deformations observed, among others, in the form of subsidence basins. The analysis of the location of mining lands allows the determination of the risk of revealing of the extraction effect within the Site and the impact on a nuclear facility.

No mining activities are performed in the Site Area, so no mining lands or areas exist.

In the Site Region, there are individual mining areas associated with the extraction of sands, gravels, and peats of local importance. The location of all mining lands is shown in Fig. 20. In the case of the mineral deposits exploited in the Site Region, the mining land (i.e., the area affected by the mine) will be the same space as the mining area (i.e., the area where mining takes place). The only exception may be in cases where the groundwater level will be lowered for the purposes of the mining operation. Dewatering wells create a depression cone around the deposit to extract the mineral. In this case, the mining land will include the zone of occurrence of this cone. There are no mining lands in the Site Region under consideration that could affect the nuclear facility. No information was found in the available databases stating historical mineral extraction activities that could negatively affect the nuclear facility site.



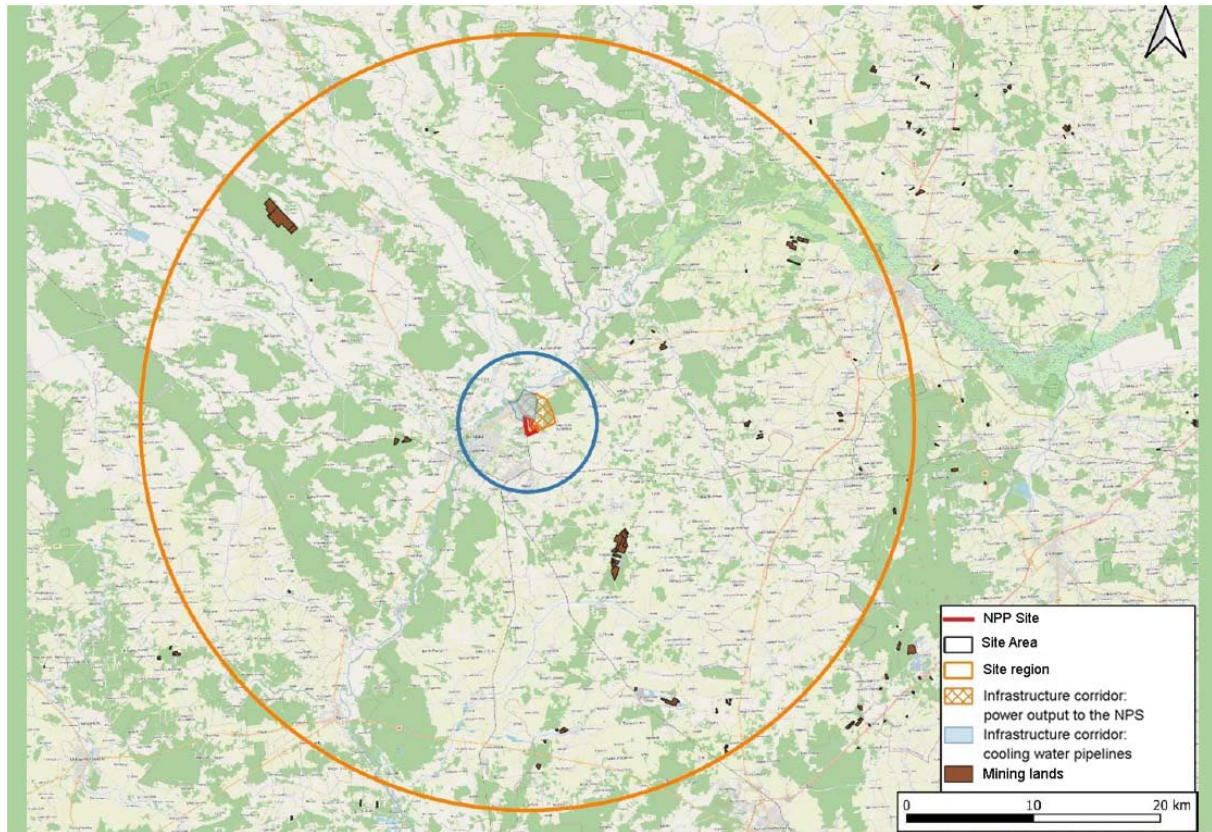


Figure 20. Mining lands in the Site Region and Area (Source: own study using OpenStreetMap and CBDG data – mining lands)

Effects of current mining activity

8.5.3

In the Site Region, 66 mining lands have been established, the vast majority of which are for the extraction of sands and gravels (61), peats (3) and quartz sands for the production of sand-lime bricks (2). The methods and scale of exploitation of these deposits have insignificant impact on environment. Due to the nature of the mineral and the method of its extracted, mining lands coincide with mining areas (exploitation area). The mining land established in the closest proximity to the planned site of the Project is located at a distance of about 9 km and concerns the extraction of quartz sands for the production of sand-lime bricks. Therefore, it is necessary to exclude the possibility of the impact of ongoing mining operations on the safety of the planned nuclear facility.

Effects of historical mining activities

8.5.4

In the Site Region, there have been no mining operations in deep mines, thus the effects of historical mining activities related to such operations (soil discontinuities or

collapses) are impossible.

The exploitation of aggregates takes place on a small scale at a significant distance from the Site boundaries (the nearest aggregate mine is located at a distance of about 9 km), hence the conclusion that their presence does not pose any threat to the Project located in the planned Site. In the analyzed region, there were also no abolished mining areas. Therefore, the occurrence, also in the future, of negative effects of historical mining operations should not be assumed.

The lack of historical mining activity in the Site Area, consisting in the exploitation of raw materials, which may cause negative effects after the cessation of mineral extraction, allows to conclude that there are no risks to the safety of the planned Project.

■ Summary of the analysis of mining activities **8.5.5**

Analyses conducted as part of the preliminary site assessment for the planned nuclear power plant in the area of mining activities performed in the Site Region lead to the conclusion that there are no significant risks associated with the analyzed Site:

- the absence of historical mining activities in the Site Area, involving the exploitation of raw materials, which could cause negative impacts on civil structures even after the deposit has ceased to be exploited, makes it possible to conclude that there is no risk of negative impacts from these activities in the Site
- the lack of mining lands covering the Site area indicates that there are no possibility of occurrence of expected outcomes of the current mining activities, including subsidence, collapses, and overflow land
- the current prospecting licenses cover an area well away from the Site. Even if a mining license is granted and mining begins, the significant distance of the potential mine from the Ostrołęka Site will not generate a threat to the nuclear facility.
- No tankless storage of substances or underground storage of waste is performed in the Site Region. No license has been issued to allow such activities to take place.

The mining activities conducted in the past do not pose any risk of subsidence and other negative effects in the Site Region. Effects of the historical mining activities that would create a risk for a nuclear facility at the Site should not be assumed to occur.

In conclusion, the current and historical mining activity does not pose a risk to the nuclear safety for the foundation of the nuclear facility in the Ostrołęka Site.

According to Hydrogeologia regionalna Polski (the Regional Hydrogeology of Poland) (edited by B. Paczyński, A. Sadurski, 2007), the Site Region under consideration is located within the Mazovia-Podlasie-Masuria region. This region is a combination of the Mazovia-Podlasie (exclusively Quaternary usable stage), North Masovian and Masurian units (Cenozoic aquifer with the participation of the Late Cretaceous stage), separated by the elevation of the Paleogene and Neogene aquifer.

The Site Area is located on the Ostrołęka (333) sheet of the Hydrogeological Map of Poland at a scale of 1:50 000 (A. Hulboj, 2002). Quaternary and Paleogene-Neogene aquifer systems have been recognized within the sheet area. The Site Area includes hydrogeological units where the main aquifer zone has been determined only in Quaternary aquifer layers. The Quaternary system consists of two aquifer systems of different ages – a shallower one, considered the main one in the northern part of the sheet and in the Narew River valley, and a deeper one, which is the main aquifer system in the Ostrołęka region and south of it.

The shallower aquifer system occurs over almost the entire sheet area. It is associated with sandr sands of the North Polish and Middle Polish glaciations and sands of the accumulation terraces of the Narew and Rozoga rivers. Despite the relatively favorable hydrogeological conditions, this aquifer system is second-rate in the Ostrołęka region due to numerous contamination centers and the threat to water quality from anthropogenic environmental impact. In the northern part of the sheet and in the Narew River valley it is an uncovered aquifer system and in the rest of the area, it occurs under a small (mostly 20 m) layer of boulder clay. The aquifer part associated with sandr accumulation is developed mostly in the form of fine-grained sands with a large amount of silt fraction. Within the Narew and Rozoga river valleys, medium-grained and gravel fractions also occur in the fine-grained sands of fluvial accumulation. The greatest thicknesses of up to 40 m occur in the north of the sheet and the Narew River valley, decreasing to several meters in the southern and eastern directions. Conductivity in regions of low stratum thicknesses ranging between 100–200 m²/24h increases to >200 m²/24h with thicknesses of about 30–40 m. In regions where the proportion of less favorably developed sandr sediments in the total stratum thickness decreases (e.g., in the Narew River valley), the conductivity can reach up to 500 m²/24h. The distribution of potential well capacity in the Site Area ranges from 10 m³/h to 120 m³/h in the Ostrołęka region. In areas where formations isolating the aquifer from the land surface are absent or locally present, the water table is unconfined or remains slightly confined. In the area where this stage is covered by low-permeable formations, the water table is of a confined nature and remains at a pressure of 1–2 atm. The drainage base is the Narew River (along with the estuary sections of its tributaries – Omulew and Rozoga rivers), into which groundwater runs off. This aquifer system is exploited by numerous wells drilled within Ostrołęka. Their long-term use

has created a regional depression cone defined in 1980 at 110 km². Currently, there is a significant reduction in the impact of the current use of this aquifer system – to an area of about 20–30 km².

Below the described usable aquifer system, in the central and southern parts of the sheet, there are aquifers (with the floor mostly at 40–50 m a.s.l.) associated with glaciofluvial sediments of the South Polish glaciation and fluvial and lake sediments of the Masovian interglacial period. They constitute a deeper usable aquifer, which is bipartite in the Ostrołęka region and south and west of it. In the central and southern parts of the sheet, it is the main usable aquifer, and in the rest of the area of occurrence, a second-rate one. It is mostly characterized by a thickness of 10–20 m, increasing to 30–40 m in the Ostrołęka region. Within the main usable stage, there is a silt-clay stratum of several meters thick. The capacity of the potential well covering this aquifer system ranges from 30 m³/h (northern part of the unit) to more than 120 m³/h in the Ostrołęka region. The water table remains at a pressure of 5–6 atm, and shows a general decline toward the Narew River. This aquifer system also has a regional depression cone marked caused by the use of intakes in the Ostrołęka area with the center now located in the area of the OPWiK City Intake. The extent of the cone covers both the left and right sides of the Narew River. In 1980 its surface area was determined to be 50 km². In the Narew River valley zone, the deeper aquifer system is drained by the shallower one, while in the upland area the directions of vertical flows are reversed – the deeper aquifer system is supplied by filtration from the shallow one. This pattern of variation in supply and drainage is typical of transition zones between uplands and river valleys. The pattern in the Ostrołęka region has not been disturbed by the depression cones that have formed in both usable aquifers. Since 1994, a process of filling in the depression cone has been observed due to reduced water intake in the Ostrołęka region.

Under the Quaternary formations lie sandy Paleogene-Neogene sediments (Miocene, Oligocene, and Eocene). The Paleogene-Neogene (Tertiary) aquifer system occurs at a depth of 140–180 m. The regional survey presented in the materials shows that the Paleogene-Neogene aquifer is characterized in this area by a conductivity of 200–500 m²/24h and a potential well capacity of 70–120 m³/h, and available resources of <25 m³/24h*km².

According to the Hydrogeological Map of Poland at a scale of 1:50 000 sheet – Ostrołęka (333) (A. Hulboj, 2002), the boundary of the planned nuclear facility site is located at the junction of three hydrogeological units: 7^Q/_(cbQI), 8 cbQI, and 9 abQI. The site of the planned Project is located in the area of the aforementioned unit No. 7. Within this unit, a secondary aquifer (shallow aquifer) and a main usable aquifer (deeper aquifer) were separated. Both aquifers are associated with water-logged Quaternary formations. The secondary usable aquifer consists of sandr sands. The hydrogeological parameters of the secondary aquifer are comparable to those of the main aquifer. However, due to its poor isolation from surface incomes, it was not considered a main one. There are many facilities in Ostrołęka that pose a threat to the water quality of this aquifer. In some areas, contamination centers have been found to

affect this aquifer. The floor of the main aquifer (deeper aquifer) occurs at depths of 50–60 m. Two different strata of sands and gravels, separated by silt or clays, remain hydraulically connected in the Ostrołęka region. The total thickness of this bipartite aquifer is about 40 m. Conductivity in the area where the bipartite aquifer occurs is about 500 m²/24h but can locally reach up to 1000 m²/24h. In the remaining area it is 100–400 m²/24h. The highest potential capacities of wells >120 m³/h are associated with the region of the bipartite usable aquifer in the Ostrołęka region. The module of renewable resources determined by the natural infiltration modeling method is at 80 m³/24h*km², and the module of disposable resources – at 60 m³/24h*km².

MAJOR GROUNDWATER RESERVOIR

8.7

The Site Region is located within the range of three Major Groundwater Reservoirs. In the north there is a fragment of Major Groundwater Reservoir (GZWP) No. 216 Sandr Kurpie, and in the south, there is a small area of the Major Groundwater Reservoir (GZWP) No. 221 Dolina Kopalna Wyszaków. In the central part, there is Major Groundwater Reservoir (GZWP) No. 115 Subniecka Warszawska (Fig. 21).

The site of the planned Investment Project is located within the undocumented Major Groundwater Reservoir No. 215 Subniecka Warszawska. The surface area of the reservoir is about 51,000 km². Its resources are estimated at 250,000 m³/d, the type of formation – porous. Paleogene-Neogene waters of aquifer are of the primary use significance. These reservoirs are distinguished by waters with natural chemical composition and long water dwelling time in the rock formation. It is mainly composed of clastic formations separated in zones by hardly-permeable loams and clays of the Eocene, Oligocene, and Miocene. The aquifer occurs at a depth of 115 to 170 meters and reaches a thickness ranging from a dozen to 90 meters. The Miocene stage is not included for drinking purposes due to the unfavorable physical-and-chemical parameters of the water. The conditions for occurrence of the Paleogene-Neogene water-bearing formations (significant isolation) and high resistance to anthropogenic pollution do not require taking actions to establish a reservoir protection area¹⁷.



¹⁷ Environmental impact forecast for the local development plan for the "Wilcza 3" area in Ostrołęka, VizEko

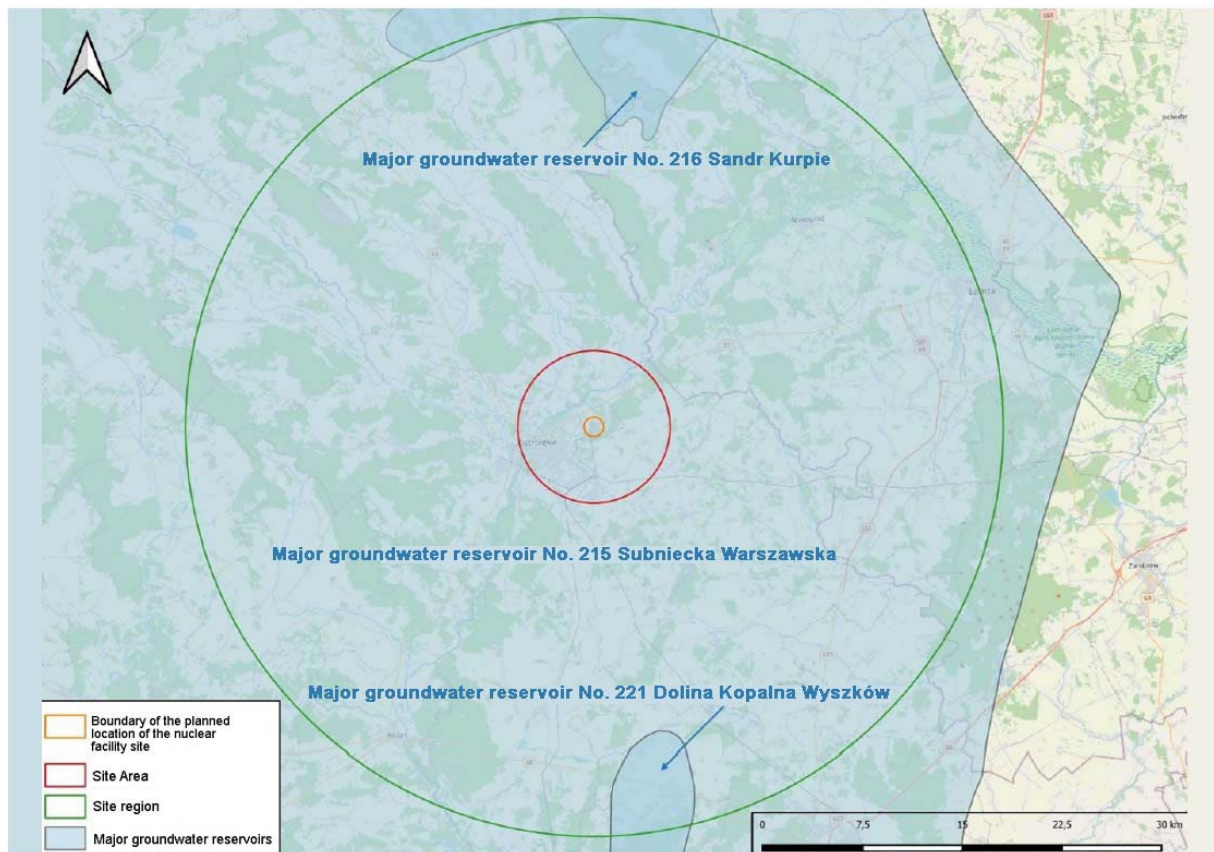


Figure 21. Site Region in view of the major groundwater reservoirs (source: own study using data from the Public Information Bulletin of the Central Geological Database of the Polish Geological Institute, OpenStreetMap)

GROUNDWATER BODIES

8.8

According to the definition given in the Water Framework Directive (WFD), Groundwater Bodies (JCWPd) include groundwater that occurs in aquifers with porosity and permeability that allow abstraction that is significant in the supply of water to the population or flow at a rate that is significant in shaping the desired condition of surface water and terrestrial ecosystems.

The Site Region of the Investment Project is within the range of the following Groundwater Bodies PLGW200031, PLGW200050, and PLGW200051 (Tab. 8, Fig. 22).

Groundwater body code	Basin area	Chemical status	Quantity status	General condition	Assessment of risk of failing to meet the environmental objectives
PLGW200031	Vistula	Good	Good	Poor	Not at risk
PLGW200050		Good	Good	Good	At risk
PLGW200051		Good	Good	Good	Not at risk

Table 8. Groundwater Bodies within and adjacent to the area of the planned Project (Source: <https://apgw.gov.pl/>).

According to the Vistula River Basin Management Plan (in the vicinity of the Site of the planned Investment Project), the overall assessment of the condition of the groundwater bodies with codes PLGW200031, PLGW200050, and PLGW200051 has been determined as good and is the good assessment result of both chemical and quantitative status (Tab. 8).

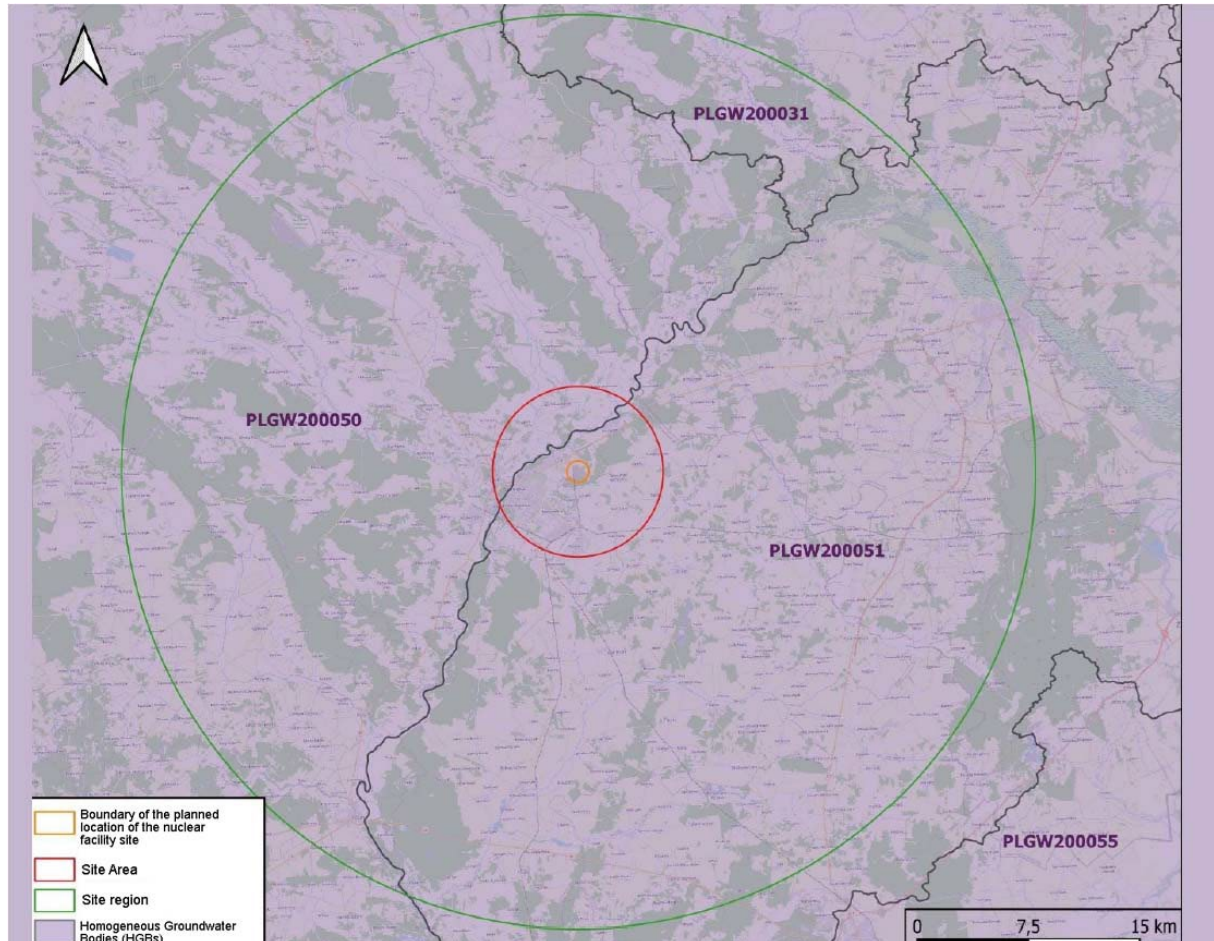


Figure 22. Groundwater Bodies (Source: own study using materials from <https://apgw.gov.pl> and OpenStreetMap)

The results of the surveys and studies carried out in connection with the implementation of the Investment Project will be considered in terms of assessing the risk of failing to achieve the environmental objectives set for these groundwater bodies in the Vistula River Basin Management Plan and taking into account the findings and actions contained in the National Water and Environment Program.

HYDROLOGICAL CONDITIONS

8.9

The Site Region is entirely located in the Vistula River basin. The Site area, according to the explanatory notes to the Ostrołęka (333) sheet of the Geoenvironmental Map of Poland at a scale of 1:50000 (A. Jasińska, D. Janica, P. Kwecko, I. Bojakowska, H.

Tomassi-Morawiec, J.Król, 2010), lies entirely in the catchment area of the second order of the Narew River, which flows through the area in question from northeast to southwest. Narew is a lowland river, strongly meandering, and there are numerous old river beds along its route, especially in the section above Ostrołęka. The river network in the area in question is well developed. In the Site Region, major rivers include: Pisa, Szkwa, Rozoga, Omulew, Orz, and Ruż.

Eight streamgage stations of the Institute of Meteorology and Water Management – National Research Institute are located on the rivers present in the Site Area (Tab. 9).

Name	Station no.	River	SNQ ¹⁸ [m ³ /s]	NNQ ¹⁹ [m ³ /s]
Dobrylas	153210220	Pisa	12.2	7.1
Nowogród	153210210	Narew	38.0	20.1
Zaruzie	153210180	Ruż	0.25	0.06
Szkwa	153210140	Szkwa	0.33	-
Walery	153210120	Rozoga	0.54	0.04
Białobrzeg Bliższy	153210070	Omulew	3.4	1.5
Ostrołęka	153210090	Narew	43.0	22.0
Czarnowo	152210100	Orz	0.32	0.04

Table 9. Characteristic flows recorded at existing hydrological stations in the Site Area (Source: <https://hydro.imgw.pl/>)

Below and in Table 10 are summarized characteristic flow rates from a multi-year period for the Ostrołęka streamgage located on the Narew River.

Extreme flow rates from a multi-year period 1951–2020:

WWQ²⁰ = 1360 m³/s date April 4 and 5, 1979

NNQ = 21.6 m³/s date August 23, 2015

SNQ = 43.1 m³/s

Extreme flow rates in the hydrological year 2022:

WQ²¹ = 213 m³/s date February 28, March 1 and 2, 2022

NQ²² = 40.6 m³/s date December 27, 2021

- 18 SNQ – the average of the lowest annual flows
- 19 NNQ – the lowest flow over a multi-year period
- 20 WWQ – the highest flow rate over a multi-year period
- 21 WQ – the highest annual flow rate
- 22 the lowest annual flow rate

	Standard (1951–2020)	Year 2022
Month	Q [m ³ /s]	
XI	101	74.4
XII	106	81.9
I	109	121
II	124	173
III	163	173
IV	206	112
V	125	87.8
VI	84	61.4
VII	67.8	60
VIII	64.2	51.1
IX	66.5	49.2
X	81.8	58.7
Annual values		
XI - X	108	92

Table 10. Average characteristic flow rates from the multi-year period and 2022 recorded at the Ostrołęka (Narew) streamgage (source: Bulletin of the National Hydrological and Meteorological Authority – 2022)

SURFACE WATER BODIES

8.10

A Surface Water Body (JCWP) means a separate and significant element of surface waters, such as:

- a. lake or other natural water reservoir,
- b. artificial water reservoir,
- c. small stream, brook, stream, river, channel or parts thereof,
- d. internal marine waters, transitional waters or coastal waters.

In the Site Region, 41 river basin surface water bodies have been identified, while in the Site Area there are 7 (Tab. 11) of them.

SWB code	SWB name	River basin	SWB type	Condition/status assessment (general condition 2014–2019)	Chemical condition/status (assessment of the status for the surface water body)	Status of the surface water body	Evaluation of ecological status/potential according to 2014–2019 assessment	Assessment of risk of failing to meet the environmental objectives
RW200010265321	Mała Rozoga	Vistula River basin area	PNp – Stream or sandy lowland rivulet	Bad water condition	Chemical condition less than good	NWB	Moderate ecological condition/status	At risk
RW20001026534	Tributary from the Białobiel region						Low ecological condition/status	
RW200010265369	Czeczotka		RzN – Lowland river				Moderate ecological condition/status	
RW2000112652999	Rozoga						Good ecological condition/status	
RW200016265499	Omulew from Wałpusz to the river mouth		Rz_org – A river in a valley with a high share of peatlands				Moderate ecological condition/status	
RW20001626579	Narew from Omulew to Orzyc		RwN – Great lowland river					
RW20001226539	Narew from Biebrza to Omulew							

Table 11. Characteristics of surface water bodies identified in the Site Area (Source: <https://apgw.gov.pl>)

All of the existing Surface Water Bodies in the Site Area are at risk of failing to meet environmental objectives. The following Table 12 shows the main sources of pressures impacting each of the SWB.

SWB code	SWB name	Main source of trophic pressures	Main source of hydromorphological pressures	Main source of chemical pressures
RW200010265321	Mała Rozoga	Fertilization and deposition and domestic and municipal sources (spot and distributed)	<p>Chemical pressure: distributed – development of urban areas: transport, tourism, urban runoff; unknown (banned substances).</p> <p>Trophic pressure: fertilization and deposition and domestic and municipal sources (spot and distributed).</p> <p>Hydromorphological pressure: river bed straightening - main rivers, - other rivers, damming structures - main rivers, - other rivers.</p>	Distributed – development of urban areas: transport, tourism, urban runoff; unknown (banned substances).

Table 12 part 1. The main pressures to which the Surface Water Bodies present in the Site Area are subject (Source: <https://apgw.gov.pl>)

SWB code	SWB name	Main source of trophic pressures	Main source of hydromorphological pressures	Main source of chemical pressures
RW20001026534	Tributary from the Białobiel region	Domestic and municipal sources (distributed).	<p>Chemical pressure: distributed – development of urban areas: transport, tourism, urban runoff; unknown (banned substances).</p> <p>Trophic pressure: domestic and municipal sources (distributed).</p> <p>Hydromorphological pressure: river bed straightening - main rivers, bridges - main rivers.</p>	Distributed – development of urban areas: transport, tourism, urban runoff; unknown (banned substances).
RW200010265369	Czeczotka		<p>Chemical pressure: distributed – development of urban areas: transport, tourism, urban runoff; distributed - agriculture, forestry.</p> <p>Trophic pressure: Industrial, domestic, and municipal sources (spot and distributed).</p> <p>Hydromorphological pressure: river bed straightening - main rivers, - other rivers, damming structures - main rivers, - other rivers.</p>	Distributed – development of urban areas: transport, tourism, urban runoff; Distributed – agriculture, forestry.
RW2000112652999	Rozoga	Industrial, domestic, and municipal sources (spot and distributed).	<p>Chemical pressure: distributed – development of urban areas: transport, tourism, urban runoff; unknown (banned substances).</p> <p>Trophic pressure: Industrial, domestic, and municipal sources (spot and distributed).</p> <p>Hydromorphological pressure: river bed straightening - main rivers, - other rivers, damming structures - main rivers, - other rivers.</p>	Distributed – development of urban areas: transport, tourism, urban runoff; unknown (banned substances).
RW200016265499	Omulew from Wałpusz to the river mouth	not applicable	<p>Chemical pressure: distributed – development of urban areas: transport, tourism, urban runoff; distributed - agriculture, forestry; unknown (banned substances).</p>	Distributed – development of urban areas: transport, tourism, urban runoff;
RW20001626579	Narew from Omulew to Orzyc	Domestic and municipal sources (spot and distributed).	<p>Chemical pressure: distributed – development of urban areas: transport, tourism, urban runoff; distributed - agriculture, forestry; unknown (banned substances).</p> <p>Trophic pressure: domestic and municipal sources (spot and distributed).</p>	Distributed – agriculture, forestry; unknown (banned substances).
RW20001226539	Narew from Biebrza to Omulew	Industrial, domestic, and municipal sources (spot).	<p>Chemical pressure: distributed – development of urban areas: transport, tourism, urban runoff.</p> <p>Trophic pressure: industrial, domestic, and municipal sources (spot).</p>	Distributed – development of urban areas: transport, tourism, urban runoff.

Table 12 part 2. The main pressures to which the Surface Water Bodies present in the Site Area are subject (Source: <https://apgw.gov.pl>)

The boundary of the planned site for the nuclear facility is located in the area of the Czeczotka SWB (RW200010265369) (Fig. 23).

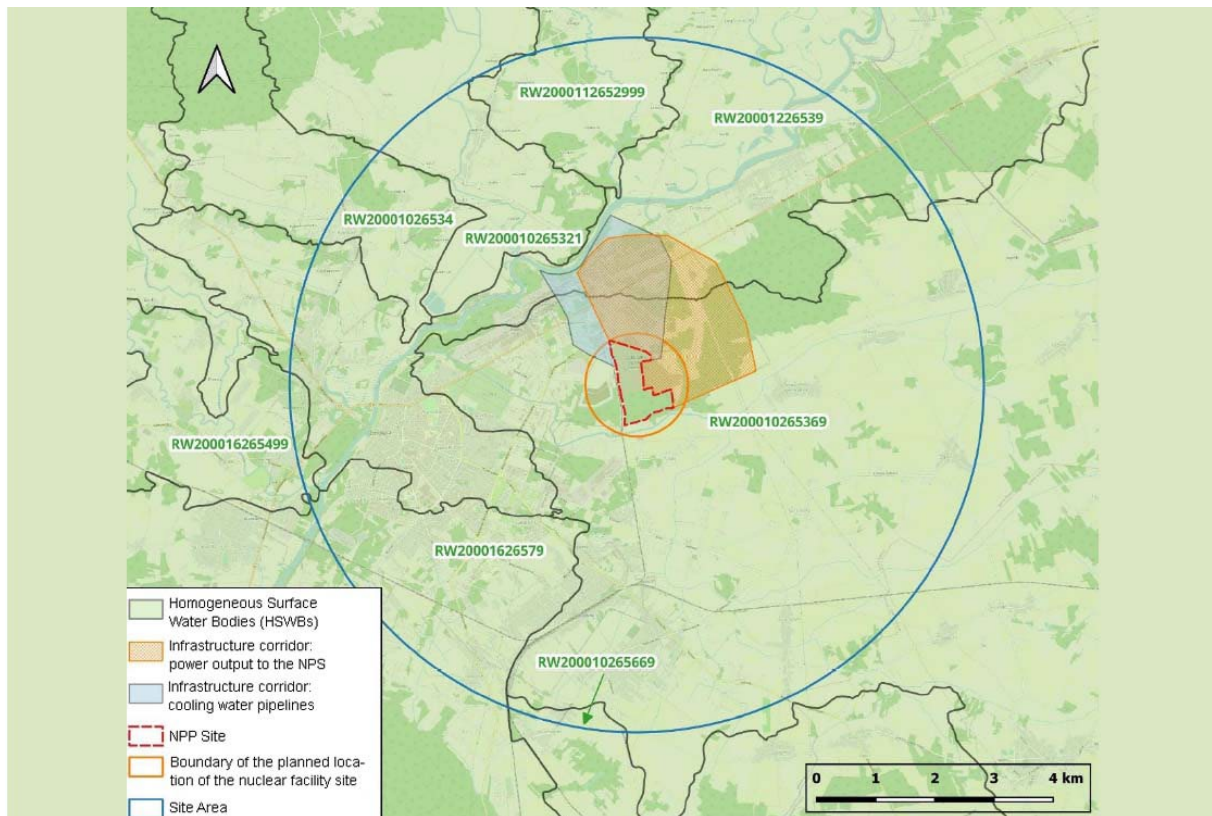


Figure 23. Planned site on the background of of SWBs (Source: own study using materials from <https://apgw.gov.pl>)

The results of the surveys and studies carried out in connection with the implementation of the Project will be considered in terms of assessing the risk of failing to achieve the environmental objectives set for these Groundwater Bodies in the Vistula River Basin Management Plan and taking into account the findings and actions contained in the National Water and Environment Program.

FLOOD RISK

8.11

According to the Flood Risk Map (data as of June 2023), the Nuclear Power Plant Site is not at risk of natural flooding, i.e., resulting from unfavorable weather conditions with a probability of occurrence of 0.2%, 1%, 10% (once in 500, once in 100, and once in 10 years, respectively). Only the cooling water intake with the pumping station, depending on their final location, may be within the flood risk area. Flood risk maps indicate that areas on the left bank of the Narew River will be inundated in the event of a flood. Figure 24 shows the areas that will be inundated in the event of a 500-year flood, i.e., with the greatest impact range. Even in the case of such flood, the power plant site will not be flooded.

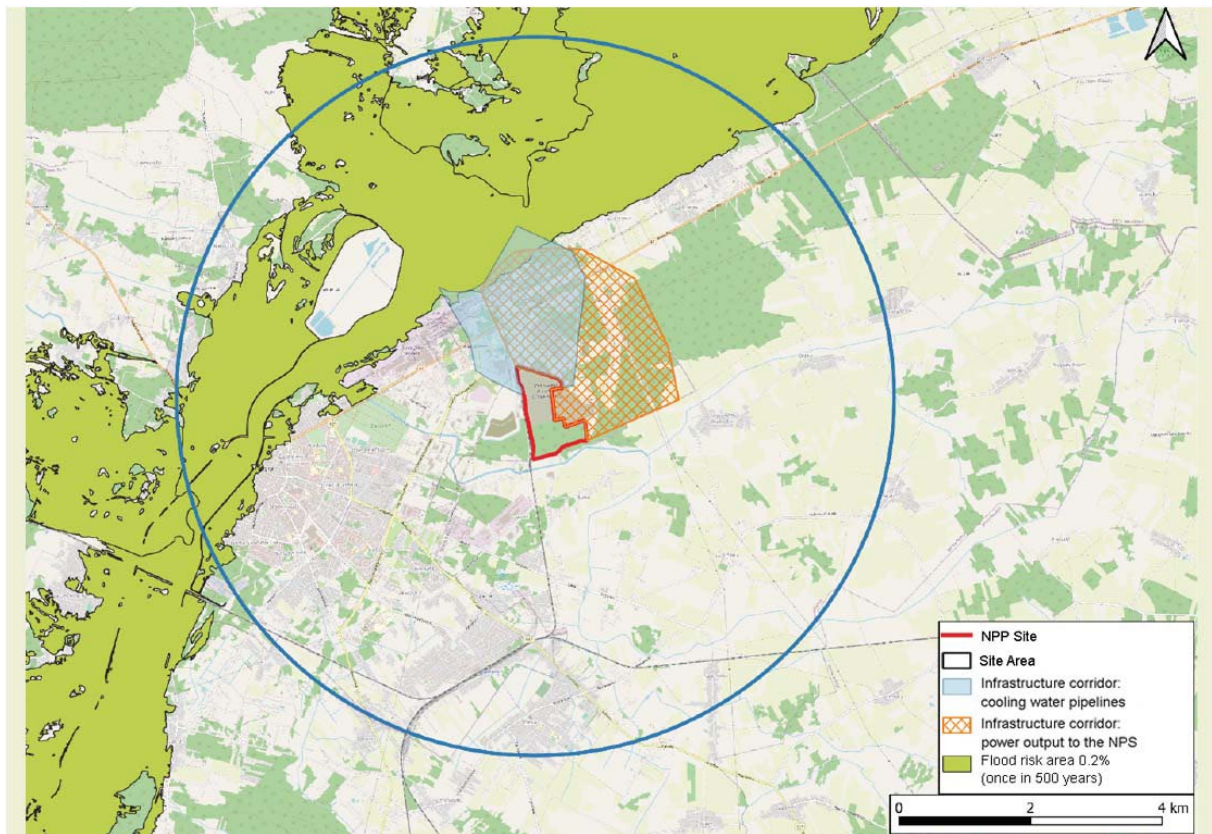


Figure 24. Flood risk map 0.2% for the Site Area in the case of a flood control dyke destruction (Source: own study using OpenStreetMap and data from the Flood Risk Map)

Analyses performed as part of the IT System of National Protection (ISOK) project have shown that in the event of a failure involving damage or destruction of the flood control dyke on the Narew River, the Site is not at risk of flood (Fig. 25).



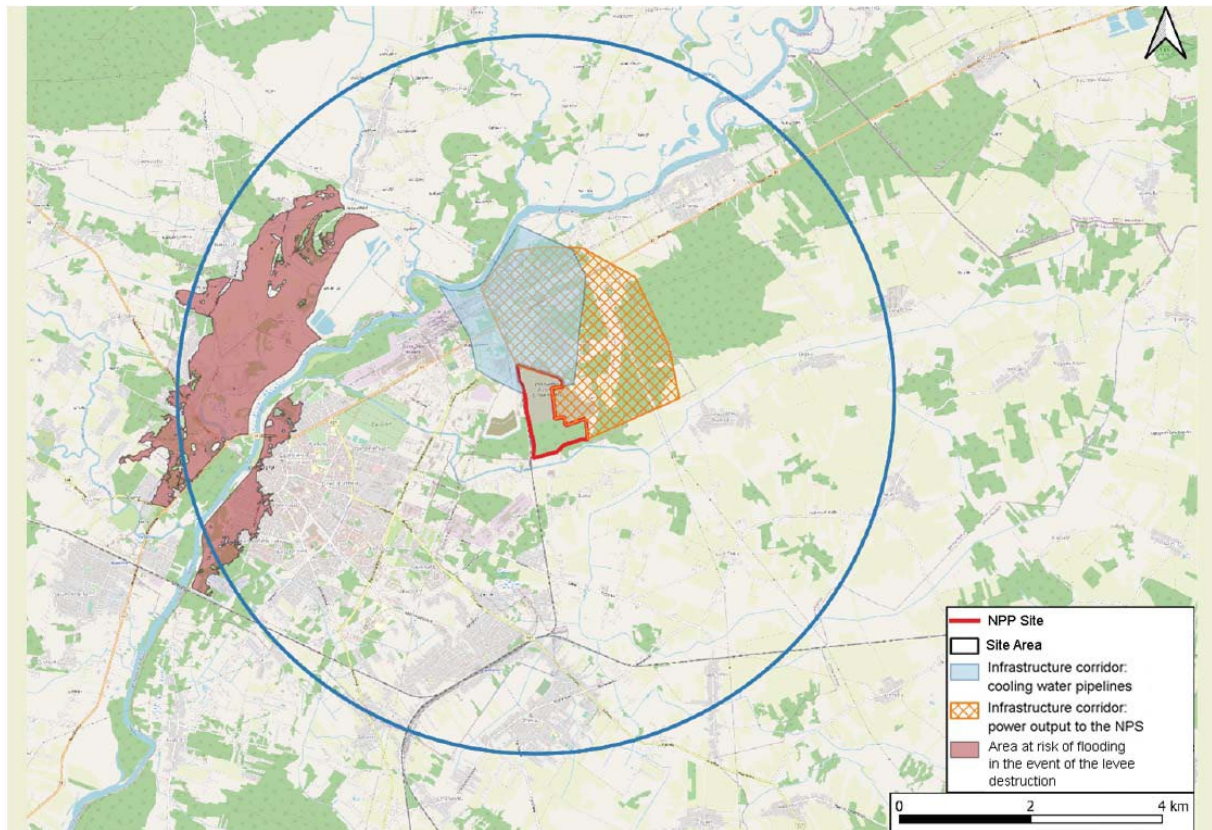


Figure 25. Flood Risk Map for the Site Area in the case of a flood control dyke destruction (Source: own study using OpenStreetMap and data from the Central Geological Database)

RISK OF FLOODING

8.12

Flooding is the phenomenon consisting in the groundwater occurrence close to the land surface, which is caused by the lowering of the land surface, the damming of groundwater in watercourses and reservoirs, or the inhibition of groundwater flow. Flooding can be permanent or seasonal and can be caused by extreme changes in water conditions, such as heavy rainfall, snowmelt, and floods. Flooding can occur both in areas with deep groundwater and in areas with shallow groundwater. The phenomenon of flooding may be evident in large areas with low-diversity area, wetlands, and land depressions.

Maps of areas with a high risk of flooding at a scale of 1:50 000 have been prepared at the Polish Geological Institute – National Research Institute in 2003-2006 as part of the task of the State Hydrogeological Authority (PSH) related to warning against dangerous phenomena that may pose a threat to groundwater supply and intake zones. The result of these works was the report entitled “Map of areas at risk of flooding in Poland”, which is a preliminary flooding risk assessment (WORP) related to flooding caused by groundwaters. The methodology of the work included analysis of various data, such as the geological structure of the area, the morphology and hydrography of the area, hydrogeological conditions, data on flood risk zones, data on the extent of

flooding on the Oder and Vistula, and maximum river water levels observed at streamgauge profiles.

According to the aforementioned map, it should be concluded that the planned Nuclear Power Plant Site is not located in an area at risk of flooding (Fig. 26). Only the cooling water intake along with the pumping station will be in this type of area.

The above issue will be analyzed at the stage of detailed site surveys and will be taken into account in the development of the architectural and construction design.

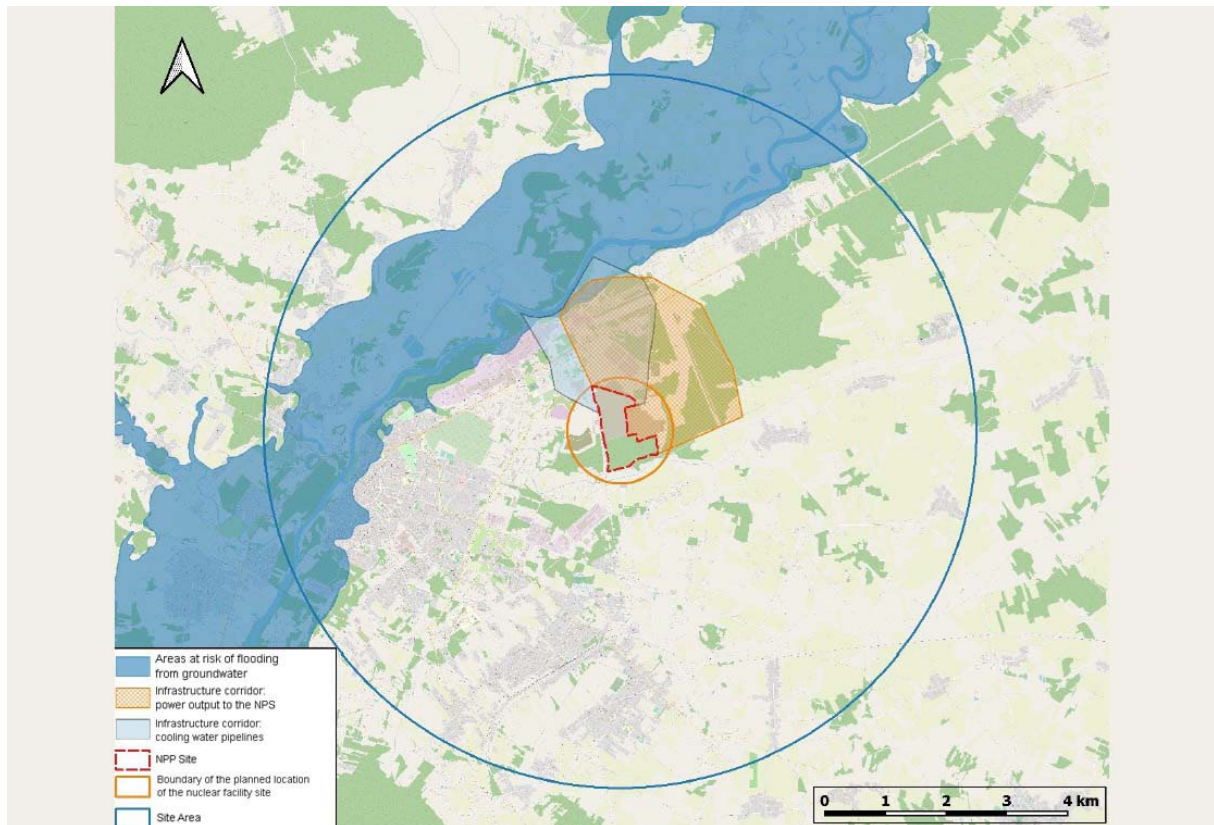


Figure 26. Risk of flooding in the Site Area (Source: own study using data provided by the Polish Geological Institute – National Research Institute and OpenStreetMap)

CLIMATE

8.13

The town of Ostrołęka is located in the Masurian climatic zone (according to the classification of W. Okołowicz and D. Martyn). The local climate has characteristics of a temperate climate with pronounced continental influences. In terms of the average number of days with a certain type of weather (A. Woś, 1999), the Ostrołęka area is located in the climatic region designated as R-XI Central Masurian. It is distinguished by a lower number of days with moderately cool weather than in other regions and fewer days with moderately warm, cloudy weather with no precipitation. However, there are more days with frosty weather both without and with precipitation. The climatic conditions that prevail in the city of Ostrołęka are characterized by data

collected at the Ostrołęka Meteorological Station from 2012 to 2020 (Table 13).

Year	Average annual temperature:					Annual precipitation [mm]	Number of days per year with:		
	T daily [°C]	T MAX [°C]	T MIN [°C]	V of wind [km/h]	Rain, drizzle		Snow	Fog	
2012	7.7	13.2	3.1	9.3	564.4	128	60	0	
2013	8.2	13.3	3.8	9.5	557.2	132	60	0	
2014	9.2	15	4.4	9.7	261.3	132	30	8	
2015	9.5	15.3	4.3	10.1	424.2	148	31	55	
2016	8.9	14.4	4.2	9.2	554.0	161	48	27	
2017	8.7	13.9	4.2	9.5	718.8	172	32	25	
2018	9.6	15.2	4.5	8.8	595.8	121	47	55	
2019	10	14.7	5	9.9	524.7	143	34	41	
2020	9.9	14.6	4.9	9.5	821.1	149	15	54	
Average	9.08	14.4	4.27	9.5	572.5	142.9	39.7	29.4	

Table 13 Historical meteorological data - Ostrołęka station (Source: Forest Management Plan, Ostrołęka Forest District, Ostrołęka District, prepared for the period from January 1, 2022 to December 31, 2031 on the basis of the state of the forest as of January 1, 2022, Forest Management and Geodesy Bureau, Olsztyn Branch, 2022)

The average temperature (based on IMGW data for the 1971-2000 multi-year period) recorded in July was 17-18°C, and the average temperature in January: -2 to -3°C. In contrast, the average annual temperature was 7-8°C. The annual temperature amplitude reaches high values and can even reach above 21.5°C. Summers are relatively short and mild in this zone, and winters are long, snowy and cold.

The annual average amount of precipitation is approx. 572.5 mm. The average number of days with rainfall is 142, with snowfall is 39.7 per year, with the highest precipitation falling in the summer months, with maximums in June and July: 70-80 mm per month. The lowest precipitation in the 1971-2000 multiyear period was recorded in the months of January-March, where the average precipitation per month did not exceed 40 mm. The growing season (with average daily air temperature above 5°C) lasts 200-210 days. Winds mainly blow from westerly and south-westerly directions. The average annual wind speed in the years from 2012 to 2020 was 9.5 km/h²³. The most frequently recorded winds are southwest (14.8%) and west (12.5%), i.e. in line with the course of the Narew valley, with an average wind speed of 2.6 m/s.

On the territory of Ostrołęka it is possible to distinguish regions with different microclimatic conditions, which are conditioned by terrain and land use. The microclimate in the downtown zone is transformed and exhibits a number of features typical of urban areas, such as reduced temperature amplitude relative to open areas,

²³ Forest Management Plan, Ostrołęka Forest District, Ostrołęka District, prepared for the period from January 1, 2022 to December 31, 2031 on the basis of the condition/state of the forest as of January 1, 2022, Forest Management and Geodesy Bureau, Olsztyn Branch, 2022

reduced humidity, limited occurrence of fog, reduced wind speed with increased gustiness in areas of compact multi-story buildings located along streets. Open areas lying in river valleys are characterized by increased humidity and day-night temperature amplitude, excluding waterside areas. In summer, the temperature amplitude in the immediate vicinity of the Narew River should be lower compared to other open areas (warmer air in the evening and cooler air in the morning). There is also an increased frequency of fog in these areas, which is important for routing of the road system. Water discharge from the Ostrołęka power plant complex modifies the above-mentioned natural tendencies. The warming of the water during the winter period keeps the river from freezing, which also reduces the temperature amplitude in the river valley. Open areas located on the outskirts of the city are characterized by increased wind speeds and increased amplitude of temperatures in the day/night ratio during the winter²⁴.

VEGETATION COVER

8.14

Location of the Site of Ostrołęka in relation to the physical-and-geographical regionalization²⁵:

Province Central European lowland (31)

Subprovince Central Polish Lowlands (318)

Macroregion North Mazovian Lowland (318.6)

Mesoregion Międzyrzecze Łomżyńskie (318.67)

Location of the Site in relation to the geobotanical regionalization²⁶:

Division Mazovia-Polesie

Subdivision Mazovia (E)

Land North Mazovian-Kurpian (E.2.)

Sub-land Kurpian (E.2b)

Region Międzyrzecze Łomżyńskie (E.2b.10)

Sub-region Ostrowsko-Łomżyński (E.2b.10.b)

The site is within the range of the South Mazovian morphogenetic region No. 28²⁷.

24 Draft Study on the conditions and directions of local spatial development for the City of Ostrołęka. Part I. Determinants of development", Ostrołęka, 2023. Prepared by the President of the City of Ostrołęka, Author team: Adam Syczewski et al.

25 Regionalna geografia fizyczna Polski (Regional Physical Geography of Poland), Collective work edited by: Andrzej Richling, Jerzy Solon, Andrzej Macias, Jarosław Balon, Jan Borzyszkowski and Mariusz Kistowski, Poznań 2021

26 Regionalizacja geobotaniczna Polski (Geobotanical regionalization of Poland), IGIPZ PAN, Matuszkiewicz J. M., Warsaw 2008

27 Morphogenetic-soil regions of Poland, Kowalkowski et al, 1994

The Project is mainly planned in an anthropogenically transformed area with a strong industrial character. The power part of the Project will be executed on land owned primarily by the Ostrołęka C Power Plant company. This area can be divided into two parts:

- Northern, which is devoid of vegetation, and is currently used as a back-up area for the construction of the Ostrołęka CCGT combined cycle power plant; previously, the area was the construction site of the not completed Ostrołęka C coal-fired unit, as well as a repository for waste remaining after the construction of Ostrołęka A and B power plants,
- Southern, which constitutes a forest area. The dominant stand of trees is coniferous.

The infrastructure corridor within which the cooling water pipelines are planned, including the raw water intake and pumping station, is mainly routed through industrial and urbanized areas. Vegetation grows sporadically in the form of small clusters of trees found between developments. Only the areas closest to the Narew River are characterized by a higher degree of vegetation cover in the form of meadows and pastures, and in the eastern part of the corridor, also in the form of coniferous forests.

The infrastructure corridor within which the construction of the connection power line that constitutes the power output to the NPS is planned partially overlaps with the cooling water infrastructure corridor. The western part of the corridor is dominated by developed areas with sparse vegetation. The eastern part of the corridor mainly includes forested areas dominated by coniferous forests. The area is also characterized by low vegetation in the form of meadows and shrubs growing under overhead power lines located in the area. The areas under the aforementioned lines are regularly mowed to maintain safety of the power infrastructure.

The location of the Investment project against the background of forest and wooded areas is presented in Figure 27.

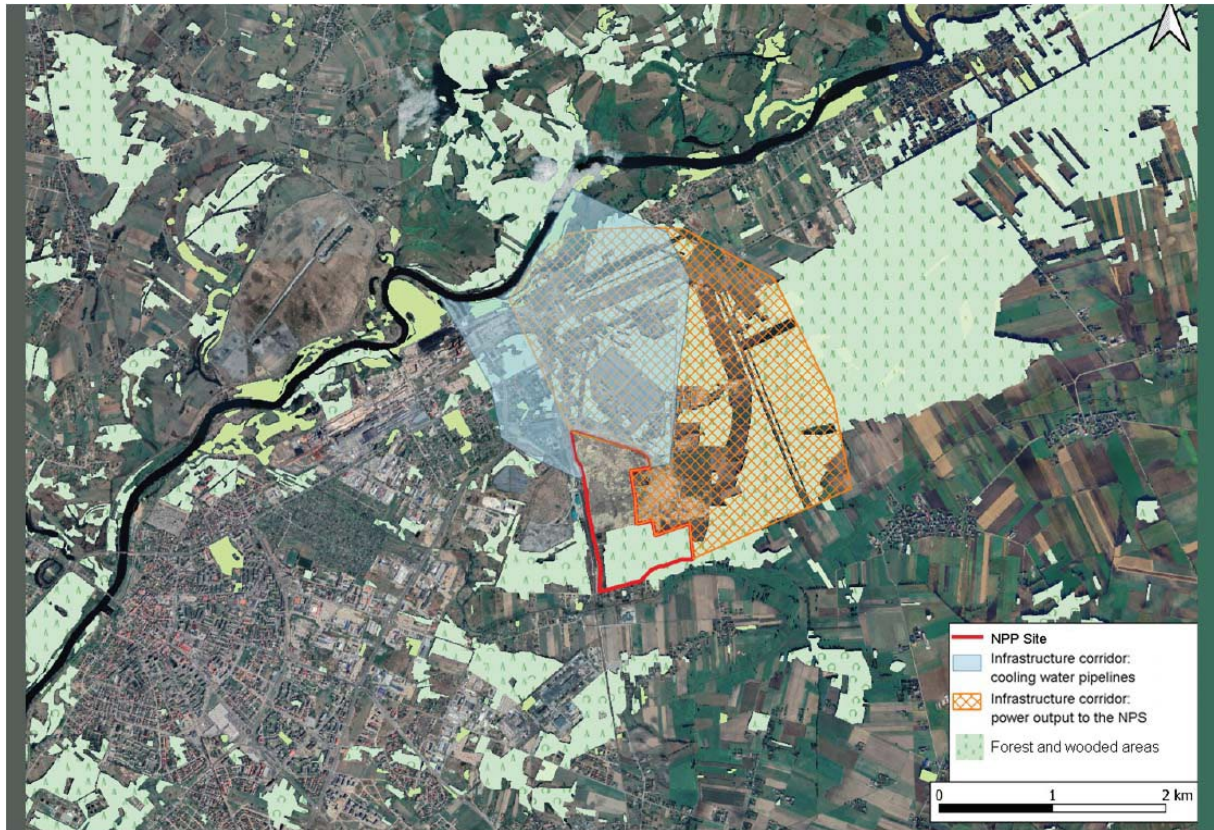


Figure 27. Forest and wooded areas within the planned Project (Source: own study using BDOT10k data, OpenStreetMap)

No forested areas were identified with forest habitats inventoried either within the Project Location or within the infrastructure corridors, as well as in their immediate vicinity.

The nearest area covered by the forest habitats inventory is about 1,300 meters southwest of the Site boundary. The occurrence of BMSW (fresh mixed coniferous forest) and a small area designated as BSW (fresh forest) were identified there. The location of the Investment project site against the results of the National Forest habitats survey is shown in Figure 28.

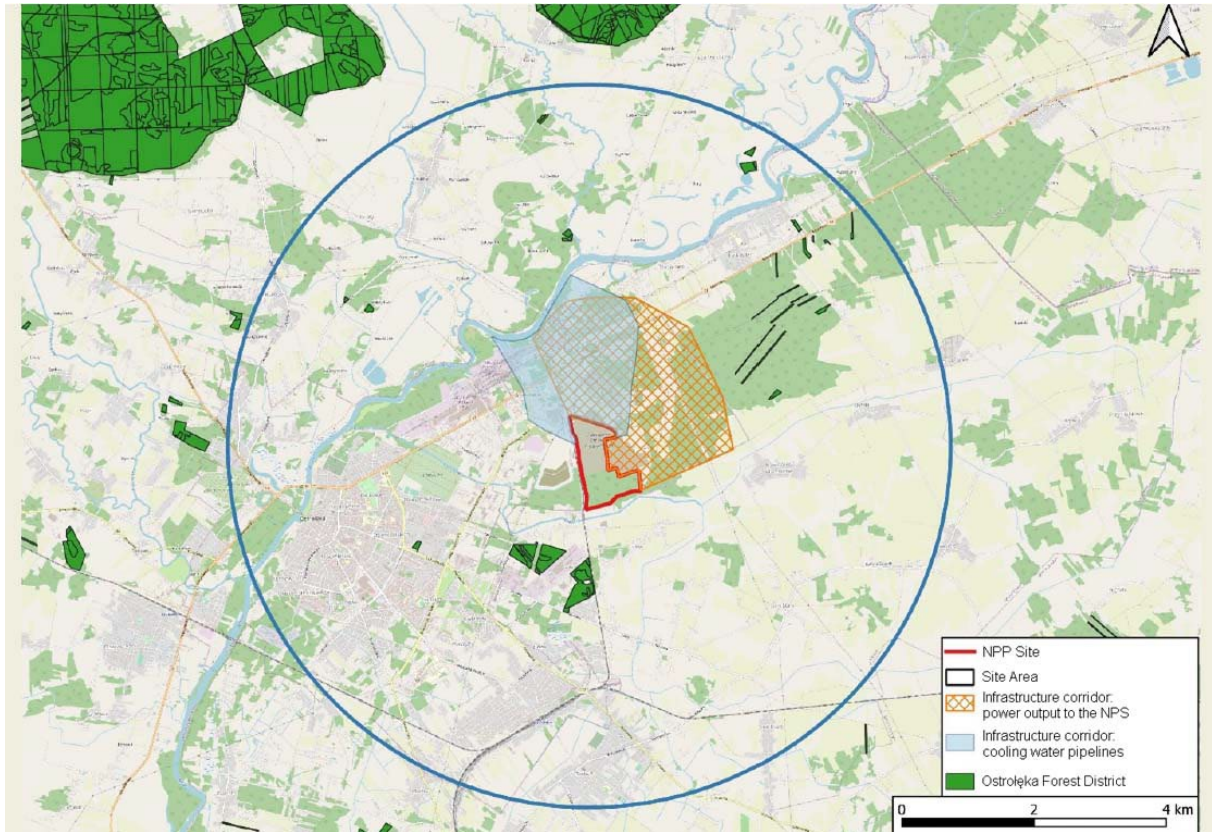


Figure 28. Location area against the results of the survey of natural habitats of the State Forests (Source: own study using data from the Directorate of State Forests – results of the State Forests habitat survey of 2022, OpenStreetMap base map)

EXPECTED AMOUNT OF THE CONSUMED WATER AND OTHER USED RAW MATERIALS, MATERIALS, FUELS AND ENERGY

9

Depending on the life cycle stage of a planned Nuclear Power Plant, the level of use of water and other raw materials, materials, fuels and energy will fundamentally change.

The greatest consumption of materials and fuels is expected to occur at the construction stage. Increased use of water, on the other hand, will take place during the operation stage (water making-up the cooling circuit).

The following subchapters provide approximate information on the estimated amounts of water, materials, fuels and energy used at various stages of the Investment Project life cycle. The quantities quoted are for the construction and operation of a Nuclear Power Plant consisting of one power unit with the BWRX-300 reactor.

CONSTRUCTION STAGE

9.1

The construction stage includes both preparatory works and actual construction works.

Use of materials and raw materials at the construction stage

9.1.1

Preparatory works comprise construction site preparation (i.a. demolition works, land leveling, construction of water supply, sewerage, telecommunications and electricity networks, construction of 110/15 kV transformer stations, preparation of construction site back-up facilities, including relocation of current infrastructure). High-intensity construction works include earthworks (excavation for the reactor) as well as civil and erection works for the power plant and accompanying infrastructure.

The construction stage is characterized by high use of materials and raw materials. The main building materials will be steel, concrete mix and steel components. The estimated quantities of main building materials are included in Table 14.

Reactor type	Capacity	number of units	Type of material	Quantity
BWRX-300	300 MWe	1	Steel pipes	27,500 m
			Electric cables	282,000 m
			Cable ducts	50,000 m
			Steel elements	6000 tons
			Modular steel components	8000 tons
			Concrete mix	50,000 m ³

Table 14. Estimated quantity of materials and raw materials that are the basic materials used to build the 300 MW nuclear power plant with the BWRX-300 reactor (Source: technology supplier: GE-Hitachi)

Approx. 900,000 m³ of excavated earth will be produced during the earthworks. If possible, some of the material will be managed on the Site.

Use of water during the construction stage

9.1.2

Water at the construction stage will be used mainly for process purposes, including concrete blending. The second main area of water demand comprises water for domestic uses of construction site workers. The estimated quantities of water used

during the construction stage are shown in Table 15.

Reactor type	Capacity	number of units	Type of material	Quantity
BWRX-300	300 MWe	1	Potable water	7.6 l/day per person (0.0076 m ³ /day per person)
			Process water	113-150 m ³ /day
			Water for the preparation of the concrete mixture	19-38 m ³ /day

Table 15. Estimated quantity of water used for the construction of the 300 MW nuclear power plant with the BWRX-300 reactor (Source: technology supplier GE-Hitachi).

Use of fuels at the construction stage

9.1.3

The construction stage is characterized by increased use of diesel oil to power building equipment and machinery used during civil and erection works. The quantity of fuel used will vary and will depend on the phase of works. Any fluctuations in consumption will be mainly due to the quantity of building machinery used during a given construction stage. It is estimated that the highest consumption of diesel oil will occur during earthworks and execution of concrete structures.

The estimated average quantity of diesel oil used during construction works will be up to 10 m³ per day.

Use of electricity at the construction stage

9.1.4

Electricity will be used on the construction site mainly to power machinery and electrical equipment and, if necessary, to illuminate the construction site. A transformer station with a capacity of approx. 5 MWe (preliminary estimates) powered from the local power system is planned to be constructed on the construction site. The construction site will also be equipped with a diesel generator with a capacity of approx. 3 MWe. This generator will be used as a back-up source of electricity and to supplement the necessary power if the power supplied from the power system proves insufficient at any given time. It is estimated that the peak electrical power needed during construction works will be approx. 4.5 MWe.

OPERATION STAGE

9.2

The operation stage will consist in the generation of electricity or electricity and heat. As part of operation, ongoing repairs and retrofit of systems and equipment necessary for proper and safe operation of the NPP will be performed. This stage is also characterized by activities relating to radioactive waste management and spent nuclear fuel storage.

Use of materials and raw materials during the operation stage 9.2.1

The operation of the nuclear power plant will be primarily associated with the use of nuclear fuel and chemicals necessary for proper operation of the power plant and its systems, and to a lesser extent, building materials in the event that overhauls are required. Examples of raw materials and materials along with the estimated quantities used during power plant operation are presented in Table 16.

Material/Raw material	Estimated quantity stored on the NPP site	Intended use
Nitrogen	approx. 50 m ³ stored in a cryogenic tank	Reactor containment inerting
Hydrogen	Tank with a capacity of approx. 360 m ³	Anticorrosive protection (Hydrogen Water Chemistry)
Diesel oil	Tank with a capacity of approx. 120 m ³	Power supply of diesel generators
Turbine oil	Tank with a capacity of approx. 20000 m ³	Control, protection, bearing lubrication, jacking oil systems
Petrol	Tank with a capacity of approx. 0.1 m ³	Vehicle maintenance
Propylene glycol	Tank with a capacity of approx. 40 m ³	Additive in the Chilled Water System, antifreeze protection
Tetrafluoroethane (coolant)	Tanks with a capacity of approx. 250 kg	Additive in the Chilled Water System, antifreeze protection

Table 16. Estimated quantity of materials and raw materials used during normal operation of the 300 MW nuclear power plant with the BWRX-300 reactor (Source: technology supplier GE-Hitachi).

The chemicals will be used primarily in the process of treating the water used to remove heat from the condenser. Depending on the selected cooling system technology, and the quality of raw water taken for condenser cooling, the quality and type of chemicals used for water treatment will vary (Table 17).

Material/Raw material	Estimated quantity stored on the NPP site
Sodium hypochlorite	Tank with a capacity of approx. 4 m ³
Sodium bisulfite	Tank with a capacity of approx. 11.4 m ³

Table 17. Estimated type and quantity of chemicals used in the process of raw water treatment during normal operation of the

Use of water at the operation stage

9.2.2

At the operation stage of the NPP, water will be used in the following areas:

- cooling water
- demineralized water (for feeding the power plant primary circuit)
- water for domestic uses
- water for fire protection purposes

The quantity of water used during operation in each area will depend on the final capacity of the power plant and the selected cooling system. The following estimates apply for the construction of one 300 MWe BWRX-300 power unit.

It is estimated that the demand for raw water to make up the cooling system with wet mechanical draft cooling towers is about 1,200 m³/h in the peak, while the water demand for the open system is estimated at about 50,000 - 90,000 m³/h - this water is fully returned to the river after use. The amount of water needed for cooling depends on the quality of water, meteorological conditions, or the power at which the power plant operates.

A detailed analysis of water consumption at the operation stage will be determined at the stage of preparation of the EIA Report.

The demand for demineralized water necessary to make up the coolant in the reactor tank is approx. 0.18 m³/day on average, with the maximum value of 15.2 m³/day.

Potable water demand is estimated at approx. 0.8 m³/day.

Use of fuels at the operation stage

9.2.3

Nuclear fuel will be the source of energy for generation of electricity or electricity and heat. The BWRX-300 reactor will use GNF2-type nuclear fuel, which is uranium oxide (UO₂) with a low enrichment level of up to 4.95%, that has been proven in service at other BWR power units. According to information made available by the technology provider, nuclear fuel reloading will take place once a year. 32 fuel assemblies will be replaced. Fuel consumption for one 300 MWe reactor will be approx. 6.6 tons of uranium per year.

During the operation of the NPP, regular tests will be performed as regards the

efficiency and operational readiness of diesel generators. The estimated annual consumption of diesel fuel used to power them will be approx. 200 m³.

■ Use of electricity at the operation stage **9.2.4**

The NPP own consumption during operation will mainly depend on the chosen cooling system and will be approx. 10–30 MWe.

■ DECOMMISSIONING STAGE **9.3**

The anticipated decommissioning stage will take place after the end of the NPP operation and will consist in dismantling the power plant and proper management of the resulting conventional and radioactive waste. The planned operation will be carried out for at least 60 years. Taking the above into account, and the fact of rapidly advancing technological changes concerning, i.a., changes in the method of driving vehicles or the method of radioactive waste management, at the current stage of Investment Project preparation it is extremely difficult to estimate even in general terms the quantities of raw materials and fuels used during the decommissioning stage of the nuclear power plant.

The decommissioning of the nuclear facility will be preceded by obtaining by the Investor of a nuclear facility decommissioning license issued under the Nuclear Law Act [Poland] and a demolition license issued under the Construction Law. In accordance with the EIA Act, the demolition license will be preceded by obtaining of the decision on environmental conditions by the Investor. Decommissioning of the nuclear facility will therefore be covered by a separate procedure for the decision on the environmental conditions.

■ ENVIRONMENTAL PROTECTION SOLUTIONS **10**

At each stage of the Project implementation, i.e. at the construction, operation and decommissioning stages, appropriate measures as well as organizational and process solutions will be taken to protect the environment.

The main areas of measures aimed at mitigation of the environmental impact of the Project can be divided into two main groups:

- Radiation protection solutions,
- Non-nuclear solutions.

The detailed scope of applied solutions will be developed at the stage of preparation of the EIA Report after detailed determination of environmental components and recognition of the types and scale of impacts of the Project on the identified and described environmental components.

RADIATION PROTECTION SOLUTIONS

10.1

Radiation protection solutions include all process and organizational solutions aimed at ensuring stable and safe operation of the nuclear power plant, whose operation does not adversely affect the radiation safety of the environment. Radiation protection measures should include the implementation of safe and proven reactor technology that meets the safety requirements of national law and complies with international standards, the design solutions of which mitigate or practically eliminate the possibility of a major accident, with effects that may significantly and on a long-lasting basis adversely affect the environment or threaten human health or life.

Selection of appropriate process and organizational solutions

10.1.1

In addition to environmental issues, the most important factor influencing the choice of technology is to ensure nuclear safety during the nuclear power plant operation. The nuclear power sector is among the industries with the most stringent safety regulations. The approach to safety management has evolved along with the growing nuclear power sector. Nuclear power sector pioneers had limited safety regulations, knowledge and experience. Over time, the increasing number of nuclear reactors in operation has resulted in an increase in operating experience, which, combined with continuously improving reactor technology, has contributed to a significant increase in the safety of reactor operation.

Despite the passage of years, safety aspects still remain a priority for any power unit in operation. In 1957, a specialized agency of the United Nations – the International Atomic Energy Agency (IAEA), was established, one of whose goals is to develop and implement international safety standards for newly designed and operated nuclear power plants. The IAEA guidelines are multi-level proposals for both organizational and process solutions, with the aim of continually improving the safety of nuclear power sector used for peaceful purposes.

The primary source of the required organizational and process solutions in the field of nuclear power implementation comprises national regulations in the form of the Nuclear Law Act [Poland] and secondary legislation.

At each stage of BWRX-300 technology implementation and operation, the Investor will follow both national regulations and IAEA guidelines that are the result of decades of work by experts from various countries with extensive experience in the operation of nuclear power plants.

This chapter presents only a general characteristics of the main concepts of the strategy for ensuring nuclear safety and radiation protection (NSRP).

Fundamental safety functions

10.1.2

The basic requirement for nuclear power plant designs is to ensure, through design solutions, the fulfillment of the so-called fundamental safety functions in all possible states of the facility (concerning normal operation and adverse events). The fundamental safety functions of a nuclear power plant cover key areas relating to the operation of nuclear reactors, the fulfillment of which guarantees the provision of NSRP:

- a. reactivity control;
- b. heat removal from the reactor, spent nuclear fuel storage facility, and nuclear fuel storage;
- c. shielding against ionizing radiation, confinement of radioactive substances, limiting and controlling their release to the environment, as well as limiting accidental releases.

The structures of the reactor, control room, turbine building and radioactive waste building are designed to prevent construction disasters that could:

- deteriorate the operation of systems, structural elements and equipment located in the reactor building and classified as the first safety class (i.e. of the highest importance for ensuring safety) in a manner that leads to an unacceptable reduction in the defense line;
- result in such injuries to occupants of the control room in the control room building that would deprive them of the ability to function;
- compromise the safety functions of systems, structures and components whose efficiency is required after seismic events.

The fundamental concept for ensuring safety of nuclear power plants is the defense-in-depth, i.e., a sequence of defense lines. According to it, safety is ensured through a wide variety of technical measures and organizational projects focused in three main areas:

1. Prevention (prevention of defects) through technical and organizational solutions of facility operation
2. Events control (detection and prediction of accidents);
3. Mitigation of effects (use of physical barriers to contain potential radiation releases).

The defense-in-depth concept involves planning several lines of defense against specific undesirable effects instead of a single strong protection layer. In the case of the NPP, an undesirable effect comprises the exposure of workers or the public to radiation in excess of safe levels.

The term defense-in-depth is reserved for defense lines composed of features, functions and practices that protect the continuity of barriers. The defense-in-depth concept is even largely aimed at identifying and organizing solutions, functions and activities in defense lines without referring directly to physical barriers. However, it should be understood that the fundamental purpose of multi-level defense is to ensure that the continuity of layered physical barriers is maintained.

The defense-in-depth concept implies that each successive layer of defense is designed to prevent accidents progress with the greatest possible efficiency. However, when an emergency event nevertheless occurs and exceeds the defense capabilities of a given line, then the next defense line acting with greater efficiency will be able to inhibit the developing emergency situation. The layers of defense are independent of each other, and their potential damage cannot affect the effectiveness of next layers of defense. The defense-in-depth concept is the best expression of a certain “mentality” and the absolute placement of safety of the nuclear facility in the first place. Also characteristic of the nuclear power sector is the use of significant safety margins for systems and equipment relating to the safety of power plant operation, as well as the use of redundant safety measures meaning the use of, for example, several independent devices with the same purpose in such a manner that in the event of a failure of the “first” device, the “second” device is immediately ready for operation, and in the event of its failure, the “third” device is activated. The used measures from next defense lines are considered for event scenarios with lower and lower probability of occurrence, so that most solutions will never be applied, but they are present.

The implementation of the defense-in-depth concept in the nuclear power plant design is required by Polish regulations (consistent with international recommendations) in

both areas, where the first area is called a sequence of defense lines, and the second is called a system of additional protective barriers:

1. Sequence of defense lines:

- a. first defense line – consists in preventing deviations from normal operation and failure of the nuclear facility's systems, in particular through its solid and conservative design, using redundancy, functional independence, and diversity of systems and equipment components of nuclear facility important in terms of nuclear safety and radiation protection, as well as high quality of construction and operation of the nuclear facility
- b. second defense line – consists in detecting and controlling deviations from normal operation in order to prevent anticipated operational occurrences from escalating to accident conditions, in particular, through the use of systems specified in safety analyses and operating procedures appropriate to prevent the occurrence or to limit failure as a result of anticipated initiating events
- c. third defense line – consisting in controlling design basis accidents, in the event that certain anticipated operational occurrences or postulated initiating events are not controlled at the second defense line, developing into a more serious event; this is accomplished by using the inherent safety features of the nuclear facility and the safety systems and procedures provided for in its design, aimed at bringing the facility first to the controlled state, and then to the safe shutdown state, as well as by ensuring that at least one protective barrier remains intact
- d. fourth defense line – consists in mitigating the consequences of severe accidents in order to maintain the radiation releases at the lowest practicable level, in particular, by maintaining the highest possible efficiency of the reactor containment in limiting the radiation releases into the environment
- e. fifth defense line – consists in mitigating the radiation effects of potential radiation releases to the environment, which may occur as a result of an accident, in particular, by providing a properly equipped emergency management center and by applying emergency plans in the event of radiation events on and off the premises of the facility

2. a system of additional protective barriers ensuring the maintenance of radioactive substances in specific places of the nuclear facility and preventing their uncontrolled release into the environment, such as: nuclear fuel material (fuel matrix), fuel element cladding, reactor coolant pressure boundary, and reactor containment.

The functional and design requirements of the BWRX-300 reactor are determined on the basis of deterministic safety analyses and from the defense-in-depth concept itself to ensure that the functions of defense lines are included in the design in accordance with their role within the defense-in-depth concept and duly included in the safety analyses.

The safety strategy for the BWRX-300 design is based on the foundation of implementation of the defense-in-depth concept.

Safety features of the BWRX-300 technology **10.1.4**

The BWRX-300 reactor design has been developed for use in a number of countries, and recommendations published by the IAEA were taken into account during its development. The IAEA safety standards represent an international consensus on measures that ensure a high defense line and use defense-in-depth as the primary measure for preventing accidents at NPPs and mitigating the consequences of accidents if they occur.

The safety system features of the BWRX-300 design are briefly listed in chapter 6 Description of the technology selected for implementation – BWRX-300. Detailed characteristics of individual solutions, along with safety analyses confirming compliance with nuclear safety criteria, will be presented in the documentation required at further stages of project preparation and assessed by the relevant authorities.

The solutions used in the BWRX-300 project make it possible to ensure that the probability of severe accidents resulting in radiation release into the environment is much lower than national and international requirements. Polish regulations require that the probability of hypothetical accidents that could result in large releases be less than 10^{-6} /year (once in a million years), which is consistent with the INSAG-12 recommendations of the International Atomic Energy Agency. In comparison, the estimated probability of hypothetical accidents resulting in large releases for the BWRX-300 project is approx. 10^{-8} /year (once every hundred million years).

Practical elimination of the possibility of severe accidents **10.1.5**

The international approach introduces the practical elimination concept, providing a basis for the practical elimination of potential nuclear reactor accident scenarios leading to the release of radionuclides in quantities that cause harmful effects on humans and the environment.

The practical elimination concept was introduced as a result of accidents in Three Mile Island (U.S.) and Chernobyl (Ukraine) power plants to explicitly incorporate the “defense-in-depth” concept (chapter 10.1.3 Defense-in-depth) for severe accidents. The use of the “defense-in-depth” strategy ensures the prevention and control of incidents and potential accidents at several levels of an engineering and procedural

nature. This ensures that additional physical barriers protecting radioactive substances from release are effectively protected. The “defense-in-depth” strategy is supported by strengthening the inherent safety features of the BWRX-300 reactor (resulting from physical phenomena naturally associated with the reactor’s design, such as a strong negative reactivity coefficient) and lessons learned from deterministic and probabilistic safety analyses conducted to assess and optimize the overall design of the power plant.

BWRX-300 technology SMRs are designed to provide a controlled state and maintain the “containment” function of radioactive substances, so as any consequences of an accident that could potentially result in early or large releases of such substances, requiring protective measures and intervention, are virtually eliminated.

Therefore, the design scope of the facility²⁸ states should be expanded to include not only the ability to defend against various emergency states, but also the practical means of stopping the development of severe accidents and practically eliminating their potential consequences. Consequences are considered practically eliminated if radioactive releases are either physically impossible to occur or can be considered improbable with a high degree of certainty.

Compared to reactors currently in operation in the world, the BWRX-300 reactor is structurally simpler, and the entire safety concept is based primarily on passive safety systems and inherent safety features (such as lower thermal power, and thus less residual heat for cooling). These safety features increase the so-called safety margins ensuring the effectiveness of physical safety barriers for radioactive substance containment and virtually eliminate the possibility of reactor core degradation conditions and the possibility of large radiation releases. Consequently, dependence on the containment and emergency response measures is reduced. For the postulated scenarios that could result in the containment function failure or its bypassing, the avoidance of early or large releases is appropriately achieved by demonstrating practical elimination for each individual case, by showing that the scenario is either physically impossible or extremely unlikely to occur with a high degree of certainty.

Given that the probability of hypothetical accidents that could result in large releases is less than 10^{-8} /year for the BWRX-300 project, it is reasonable to treat this value as an argument for practical elimination. In addition, probability assessments are supplemented by deterministic analyses of physical phenomena and functionality of design provisions. By including additional beyond-design-basis safety measures in the design, it is demonstrated that radioactive releases that could pose a hazard to the public and the environment are physically impossible to occur.

■ NON-NUCLEAR SOLUTIONS

10.2

²⁸ In terms of all potential operating and emergency states that must be considered in the design of the facility (more in Journal of Laws of 2012, item 1043, Appendix No. 1)

In addition to solutions for ensuring nuclear safety, it is also extremely important to provide appropriate measures and solutions to protect individual environmental components from the “conventional” negative impacts of a nuclear power facility. To minimize potential environmental impacts, all possible types and scales of impacts of the Project on individual environmental components and the public will be identified at the stage of preparation of the EIA Report. This action will then enable the development and implementation of an Environmental Management Plan (EMP), as well as proper organization of works and management of the Investment Project construction, operation and decommissioning processes.

Development and implementation of an environmental management plan

10.2.1

An Environmental Management Plan will be prepared to address all potential adverse environmental and social impacts associated with the Project. The EMP will be developed as a result of the EIA process.

The main objective of preparation of the EMP is to identify the full spectrum of environmental and social impacts that may occur in connection with the Investment Project. The EMP also presents a general analysis of environmental impacts with environmental and social criteria, as well as a general assessment of methods for mitigating and monitoring possible environmental and social impacts associated with the Investment Project. The document will propose measures to minimize negative impacts, as well as set guidelines and scope for environmental monitoring.

The main elements of the EMP, in accordance with international practice, will comprise:

- Project characteristics;
- Legal considerations including a description of the EIA process, compliance of the Investment Project with the law and industry standards;
- Description of potential environmental impacts;
- Plan for the implementation of minimization and compensation measures;
- Monitoring plan;
- Schedule for implementation of the EMP and reporting procedures.

Management of construction, operation and decommissioning stages

10.2.2

Each stage of the Project will be implemented in accordance with, i.a.:

- applicable legal acts,
- IAEA guidelines,
- integrated management system,
- environmental management plan,
- relevant industry standards.

Documents confirming correct implementation of the integrated management system will be part of the application for the construction license to be issued by the President of the PAA.

TYPES AND ESTIMATED QUANTITY OF SUBSTANCES OR ENERGY RELEASED INTO THE ENVIRONMENT BY USING THE SOLUTIONS AIMED TO PROTECT THE ENVIRONMENT

11

The life cycle of the Project consists of three consecutive stages: **construction**, **operation**, and **decommissioning**. Due to its specific nature, each of the mentioned stages is characterized by different activities, which consequently translates into differences in the type and quantity of substances released into the environment.

At the current stage of the Investment Project preparation, it is not possible to precisely determine the quantity of substances or energy that will be released into the environment at each stage of the Project operation. However, it is possible to approximate the types of these substances and their sources.

Detailed information on the types and quantities of emissions into the environment, along with their environmental impacts, at various stages of the power plant life cycle will be characterized and described in detail during the preparation of the EIA Report.

CONSTRUCTION STAGE

11.1

The construction stage will be characterized by increased earthworks as well as civil and erection works. It should be noted that the Project will be implemented in stages. The works schedule will be developed at a later stage of the Investment Project preparation. Both the method of staging and the approximate schedule for implementation of the Investment Project will be described in more detail in the EIA Report. The main emissions associated with the construction stage will involve the substances indicated in the following chapters.

Noise emission

11.1.1

Noise will be emitted during construction works, and the main emitting device will be the construction machinery. It should be emphasized that construction works will be performed in stages, so the accumulation of emissions from all construction machinery used for works on the Site in one period is unlikely. The works schedule will be developed at the stage of preparation of the building permit design. The magnitude and extent of noise emission will depend on the type of machinery used, the number of simultaneously operating equipment and the duration of their operation. It cannot be ruled out that the impact may also affect the area outside the boundaries of the Site.

In principle, the construction works will be carried out in 2 phases:

- execution of necessary earthworks related to leveling of the area and preparation of the area for foundation works;
- execution of foundations, erection of enclosed structures (buildings) and erection of systems and equipment

Conventional construction machinery such as excavators, loaders, “tub” trucks, cranes, etc. will be used during the aforementioned works. The sound power level of most construction machinery is within LWA = 50-101 dB measured at a distance of 15 m from the source. Depending on the stage of works, the number of actively working machinery and the intensity of their use will vary.

Taking into account the typical nature of noise impact during civil and erection works and the distance of the nearest residential development subject to protection, no significant impact of noise emission on these areas is to be expected. An analysis of the number and types of construction equipment and machinery, along with the determination of their impact on the acoustic environment during construction works, will be determined as part of the EIA Report.

Gas and dust emissions into the air

11.1.2

The construction stage does not involve organized gas and dust emission. However, construction works will be accompanied by unorganized gas and dust emission into the air, which will be associated with the circulation of transport vehicles and the operation of construction machinery and equipment.

Working machinery as well as earthworks and construction works will be accompanied by flue gas emission and temporary dust emission. All of the above-mentioned factors will occur only locally within no more than a dozen of meters from the machinery operation site.

To reduce the emission of dust and gas pollutants into the air, proper organization of the works will be ensured, only operational equipment (with up-to-date technical tests) will be used, which will be operated as intended, and construction machinery will not be left idle. If there is a high level of dust load, countermeasures in the form of sprinkling and water curtains will be used. Taking into account the fact that the designed Investment Project is located in an industrial area, away from larger groups of residential buildings, it should be assumed that air emissions will not adversely affect the health of people living in the areas adjacent to the Project.

An analysis of the number and types of construction equipment and machinery, along with the determination of their impact on atmospheric air quality during construction works, will be determined as part of the EIA Report.

Emissions into the groundwater environment

11.1.3

During the construction stage, the only impact on the Groundwater Bodies and Surface Water Bodies that could occur could be associated with the leakage of pollutants as a result of interference with the mechanical equipment used during the Project (e.g. leakage of oil derivative substances). The quantity and type of the substance that will be released into the water may determine the magnitude of this impact. Appropriate minimization measures will be taken to avoid the aforementioned hazard.

During construction, to prevent oil or gasoline from vehicles operating on the construction site from entering the groundwater environment in case of an accident, construction machinery and equipment and means of transport whose technical condition is not objectionable should be used, which will reduce the risk of a possible oil or gasoline leakage. In accordance with an adopted standard, the Investment Project site will be provided with sorbent, which will be used if there is a possible leakage of a harmful substance, and the soil will then be collected and disposed of by a qualified company. Refueling of equipment will take place in a specially designated

area equipped with absorbent mats to prevent possible leakage of harmful substances (i.e. oil derivative substances, operating fluids). Absorbent mats will also be part of the equipment in the area designated as a construction equipment service and repair area.

During construction, the following countermeasures will be implemented to provide adequate protection of the groundwater environment:

- ensuring proper organization of the works to maintain order: storage of materials in places designated for this purpose and protected from the penetration of pollutants into the ground, proper organization of amenity facilities, including the provision of the construction site with portable sanitary facilities with watertight tanks;
- protecting the parking, servicing, and refueling areas of the means of transport and construction machinery from potential spills of fuel, oil, and other technical substances used on the construction site;
- use of efficient technical equipment with valid technical tests, meeting the relevant standards;
- equipping the construction site with sorbents and other means to collect any oil leakage;
- excavations will be protected from the possibility of entry of pollutants associated with construction works; it is unacceptable to leave any waste in the excavations;
- waste management will be carried out in accordance with the Waste Act of December 14, 2012 (Journal of Laws of 2022, item 699, as amended). This will enable, i.a., the reduction and minimization of the volume of generated waste, proper collection of generated waste, including its selective collection, management of waste for repeated use on the construction site, recovery of waste that has the characteristics of recyclable raw materials, temporary storage of waste in places designated for this purpose, as well as proper and timely removal of waste from the sites of its generation and storage.

The analysis of the necessary construction works along with the determination of their impact on the quality of the groundwater environment during the construction works will be determined as part of the EIA Report.

Electromagnetic emissions

11.1.4

At the construction stage no electromagnetic impact is assumed. At this stage, no equipment will be used, the operation of which could generate hazard to the environment through long-term, above-normal emissions in terms of field emission or electromagnetic radiation. Any electrical equipment will be powered by a low voltage or medium voltage line connection, or portable power generator set and will operate at 220 V or 400 V, i.e., at low voltage, similarly as all household appliances. Only the

power transformer may be a source of electromagnetic impact; however, given its small capacity (up to 5 MWe), it should be concluded that it will not cause an above-normal environmental impact. Considering the above, it should be concluded that electromagnetic fields generated by electrical equipment used during construction will be negligible in relation to the prevailing electromagnetic background.

Heat emissions

11.1.5

At the construction stage, no heat sources are identified that may negatively affect the environment.

Radiation emissions

11.1.6

At the construction stage, the use of materials and equipment that may cause radiation emissions into the environment is not expected.

Defectoscopic techniques which may use ionizing radiation (gamma or X-rays), may be used in the course of engineering and construction works. The observance of basic OH&S and radiation protection rules by the authorized defectoscope operator will guarantee the exclusion of exposure to bystanders and construction site workers. Radioactive emission from a defectoscope using a radioisotope as a source are virtually eliminated.

OPERATION STAGE

11.2

The operation stage of the Project is characterized by limited gas and dust emission into the environment compared to conventional thermal power plants. The main pollution emitted by the operating nuclear power plant will comprise the noise emitted by the cooling system, locally, in the vicinity of the electrical switchyard and generator, as well as the power output lines; increased electromagnetic field (PEM) emission will be possible. Heat and steam emission is also possible, depending on the cooling option chosen for the power plant. However, it should be emphasized that this emission will be no different from that generated by conventional power plants.

Noise emission

11.2.1

At the operation stage, noise emissions will be mainly associated with the operation of turbines and generators located in the turbine hall building, and, depending on the chosen cooling option, also with the operation of mechanical draft cooling towers or natural draft cooling towers that are part of the power plant cooling system. The equipment will operate continuously. In addition, periodic noise from diesel generators may occur. The equipment will be operated once a month for approx. 4 hours to test its efficiency. It will operate continuously only in the event of the nuclear power plant blackout. The estimated noise sources along with emission levels are presented in Table 18.

Noise source	Measurement distance [m]	Sound emission [dB]
Mechanical forced-draft cooling towers	305	55
Diesel generator	8	80

Table 18. Expected noise sources and estimated noise emissions during normal operation of the 300 MW nuclear power plant with the BWRX-300 reactor. Data for the cooling system with a mechanical draft cooling tower (Source: technology provider GE-Hitachi).

A detailed characteristics of the emitting devices along with the analysis of their acoustic impact at the power plant operation stage will be developed as part of the EIA Report.

Gas and dust emissions into the air

11.2.2

Gas and dust emissions into the air during operation will be mainly associated with the circulation of cars and other vehicles, relating to periodic inspections, overhauls, transport of fresh and spent nuclear fuel, and transport of waste generated during the power plant operation. Another emission source will comprise diesel generators that provide backup power supply to the power plant. The diesel generators will mainly operate during periodic inspections, during which their readiness for emergency operation will be checked. The estimated emissions from diesel generators are presented in Table 19.

Type of equipment	Pollutant	Emission rate (mg/Nm ³)
Diesel generator	Solids	60
	Sulfur oxide	20
	Carbon monoxide	400

Hydrocarbons	60
Nitrogen oxides	6250

Table 19. Expected annual emissions from diesel power generators (source: technology supplier GE-Hitachi).

A detailed characteristic of the emitting devices along with the analysis of their acoustic impact during their operation will be developed as part of the EIA Report.

Emissions into the groundwater environment **11.2.3**

The operation of the nuclear power plant will involve the generation of liquid waste. Rainwater potentially contaminated with chemicals (lubricants, oils) from the workshop buildings will be collected by a drainage system and evacuated to separators, where it will be treated before discharge.

The operation of the power plant also involves the generation of wastewater from technological processes accompanying electricity generation. The wastewater will be treated before discharge.

Wastewater from systems directly associated with electricity generation, i.e. the reactor and its auxiliary systems, may be potentially radioactive and for this reason will be subject to special collection, storage (until signs of radioactivity cease) and possible discharge procedures.

The discharge of wastewater into the selected watercourse will be carried out on the basis of the water permit obtained. The physical and chemical parameters of the discharged wastewater will not exceed the relevant standards.

Electromagnetic field emissions **11.2.4**

Non-ionizing electromagnetic radiation (PEM) occurs in natural form (sources are the Earth, the Sun, atmospheric phenomena) and artificial form (relating to the widespread use of electricity and new radio techniques). Electromagnetic fields occur around all electrical devices.

The primary sources of electromagnetic fields are:

- cell phone base stations,
- radio and television stations,
- radiolocation stations,
- high voltage power lines,

- common appliances, including microwave ovens and mobile phones.

Permissible levels of electromagnetic fields in the environment are specified in Table 20 and Table 21, respectively (based on the Ordinance of the Minister of Health of December 17, 2019 on permissible electromagnetic field levels in the environment (Journal of Laws of 2019, item 2448).

Physical parameter: Electromagnetic field frequency	Electrical component E (V/m)	Magnetic component H (A/m)	Power density S (W/m ²)
50 Hz	1,000	60	N.A.

Table 20. Frequency range of electromagnetic fields, for which physical parameters are determined, characterizing electromagnetic field impact on the environment, for areas intended for residential development, and permissible electromagnetic field levels, characterized by permissible values of physical parameters, for areas intended for residential development (source: Ordinance of the Minister of Health of December 17, 2019 on permissible electromagnetic field levels in the environment).

Physical parameter: Electromagnetic field frequency	Electrical component E (V/m)	Magnetic component H (A/m)	Power density S (W/m ²)
0 Hz	10,000	2,500	N.A.
0 Hz to 0.5 Hz	N.A.	2,500	N.A.
0.5 Hz to 50 Hz	10,000	60	N.A.
0.05 kHz to 1 kHz	N.A.	3/f	N.A.
1 kHz to 3 kHz	250/f	5	N.A.
3 kHz to 150 kHz	87	5	N.A.
0.15 MHz to 1 MHz	87	0.73/f	N.A.
1 MHz to 10 MHz	87/f ^{0.5}	0.73/f	N.A.
10 MHz to 400 MHz	28	0.073	2
400 MHz to 2,000 MHz	1.375 x f ^{0.5}	0.0037 x f ^{0.5}	f/200
2 GHz to 300 GHz	61	0.16	10

f – frequency value of the electromagnetic field from the same row of the column “Electromagnetic field frequency range” | N.A. – not applicable

Table 21. Frequency range of electromagnetic fields for which physical parameters are determined, characterizing the impact of electromagnetic fields on the environment, for places accessible to the public and permissible levels of electromagnetic fields, characterized by permissible values of physical parameters, for places accessible to the public (Source: Ordinance of the Minister of the Health of December 17, 2019 on permissible levels of electromagnetic fields in the environment).

The power system in Poland operates at a frequency of 50 Hz, for this reason the values of EMF generated by high voltage lines should be compared to the limits of the components of electric and electromagnetic field intensity specified in the aforementioned Ordinance in the electromagnetic field frequency range from 0.5 Hz to 50 Hz.

The 1 kV/m electric field is a permissible intensity value in areas intended for residential development and is a value that is completely safe for human health; this value cannot be exceeded in the area outside the buffer zone of extra high voltage lines. In areas accessible to the public, but not intended for residential development, the permissible value of electric field strength is 10 kV/m.

The value of the EMF permissible magnetic component in places accessible to the public has been set at 60 A/m; this value cannot be exceeded outside the designated buffer zone. Normally, the buffer zone for 400 kV rated lines is 70 m (35 m from the axis of the line in both directions), for 110 kV lines the width of the buffer zone is 60 m (30 m from the axis of the line in both directions).

A place accessible to the public is to be understood as any place, except for places to which access by the public is prohibited or impossible without the use of technical equipment, determined according to the existing real property development.

The source of the 50 Hz electromagnetic field associated with the operation of the nuclear power plant may be low voltage and medium voltage lines capable of generating an electromagnetic field, the level of which is low enough not to threaten the environment in any way. Only high voltage lines with rated voltage of no less than 110 kV are capable of generating electromagnetic fields with levels that may violate electromagnetic climate quality standards. Sources of electromagnetic fields will include the generator, transformer, substation as well as high and extra high voltage cable lines that constitute the connection lines from the power plant to the point of connection to the grid. It should be noted that equipment such as the generator, transformer and substation (switchyard and transformer) will be located in the protected area of the nuclear power plant, where the presence of the public will be prohibited, including the presence of such persons in the immediate vicinity of electrical equipment that is part of the power plant.

The Investor does not exclude that for the execution of connections for power output to the grid in certain sections it will be necessary to build a cable line, i.e. placed in a specially prepared excavation. The construction of a cable line along its entire length is also under consideration. The line will be the only component of the power plant located in the public space that can generate electromagnetic fields with increased values relative to background values.

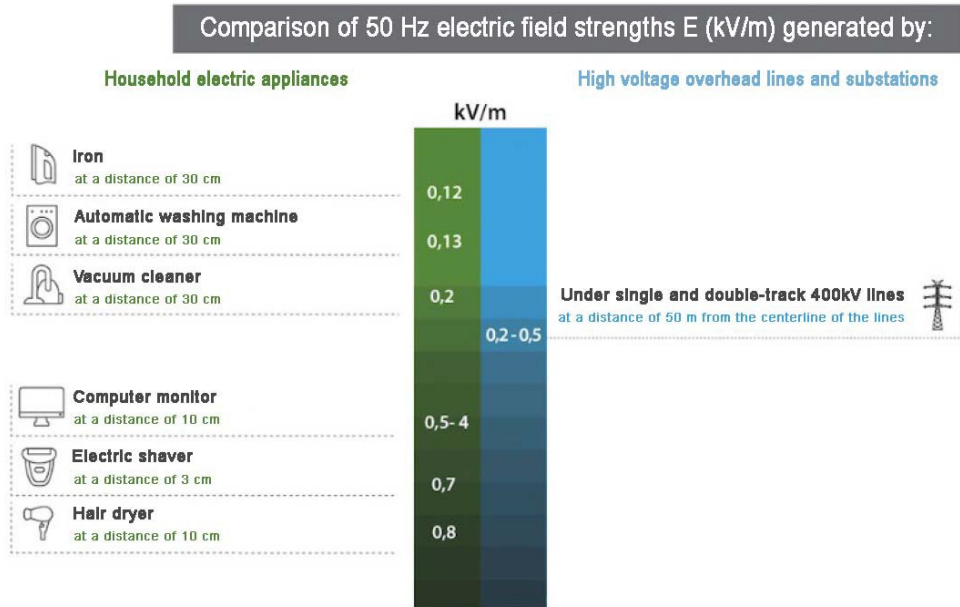


Figure 29. Comparison of 50 Hz electric field strengths (kV/m) generated by household electric appliances and extra high voltage overhead lines (Source: <http://budowalini400kv.pl/>).

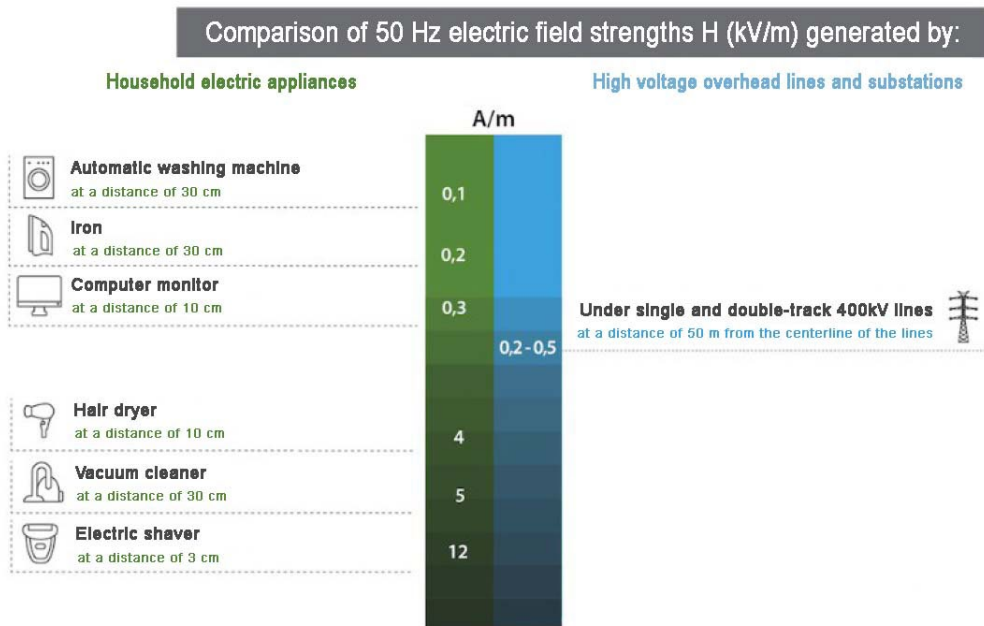


Figure 30. Comparison of 50 Hz electric field strengths (A/m) generated by household electric appliances and extra high voltage overhead lines (Source: <http://budowalini400kv.pl/>).

The power equipment included in the power generation and output facilities will be certified to meet PEM generation standards. Excessive impacts of electromagnetic fields on humans are not expected. It should be emphasized that the power equipment used for power generation and connection lines (power output) will be the equipment commonly used in power systems around the world for the generation and transmission of electricity.

A detailed characteristics of electromagnetic field emitting devices along with the analysis of their impact during operation will be developed as part of the EIA Report.

Heat emissions

11.2.5

During normal operation of the power plant, a byproduct of electricity generation is waste heat in the form of steam, which has already completed operation in the turbine, but its parameters do not allow further process use. The heat is collected from the cooling system water on the condenser and then dissipated in the external cooling system (once-through or closed cooling system). According to the information submitted by the technology provider, GE-Hitachi, the waste heat remaining from one BWRX-300 reactor will be approx. 570 MW. A detailed characteristics of heat emitting devices along with the analysis of their impact during operation will be developed as part of the EIA Report.

Radiation emissions

11.2.6

During normal operation, emission of radioactive substances at levels that comply with the applicable law will be possible. The volume of permissible emissions will ultimately be specified in the construction license, and detailed in the power plant operating license issued by the President of the National Atomic Energy Agency [Poland].

According to the Environmental Impact Forecast of the Polish Nuclear Power Program and the European Utility Requirements for LWR Nuclear Power Plants, Rev. D, during normal operation of the ESBWR, the effective annual dose (at a distance of 800 m from the reactor) is 0.002 mSv of exposure by water and 0.01 mSv by air. The total effective annual dose at a distance of 800 meters from the ESBWR (with a capacity of 1520 MWe) is therefore 0.012 mSv. In accordance with the Nuclear Law Act, for people in the general population, the limit dose, expressed as an effective dose, is 1 mSv. Comparing these values, it should be noted that the effective doses received as a result of normal operation of the ESBWR are approx. 20 times lower than allowed by national regulations²⁹.

Due to the fact that the BWRX-300 is an evolutionary development of the design of the large 1520 MWe ESBWR reactor, and assuming that the Project is implemented at the full capacity specified in the application, i.e. 1,300 MW, it should be assumed that the quoted dose rates specified for the ESBWR will not be exceeded during operation of the BWRX-300 reactor even if the distance from the reactor is significantly reduced.

The experience of operating nuclear power plants proves that the actual radiation doses associated with emissions of radioactive substances into the environment are much lower (usually by two orders of magnitude), i.e. they are at the level of a few μSv .

²⁹ Environmental Impact Assessment Forecast of the Polish Nuclear Power Program taking into account the conclusions and comments of the public and environmental protection authorities

A detailed list of the types of radioactive isotopes along with emission quantities will be analyzed as part of the EIA Report.

■ DECOMMISSIONING STAGE

11.3

The operation period of the Nuclear Power Plant is estimated to be approx. 60 years, only then will measures be taken to decommission the nuclear facility. At the current stage of preparation of the Investment Project, it is only possible to present conceptual assumptions for decommissioning activities. For this reason, the assessment of the potential impact of decommissioning activities on the environment is general in nature. Decommissioning works will mainly consist in dismantling various types of equipment and systems, followed by demolition works. As at the construction stage, the decommissioning stage will be characterized by increased construction works whose task will be to dismantle the infrastructure. These works will be accompanied by noise emissions caused by the equipment used. The dismantling of infrastructure will cause increased vehicle traffic. It is possible that periodic dust load will occur. If there is more dust load, use sprinkling. During the decommissioning stage of the project, however, it is inevitable that a significant amount of waste will be generated. Before demolition works begin, the power plant area will be checked for radiation to identify areas of special risk. Waste generated during decommissioning of power plants:

- conventional waste will be properly secured and transferred to be disposed of to a company with the legally required licenses;
- radioactive waste will be properly collected, processed, stored and transferred for storage to a qualified and licensed enterprise.

Decommissioning of the nuclear facility will be preceded by the Investor obtaining a demolition permit for the nuclear facility – issued under the Construction Law. In accordance with the EIA Act, the demolition license will be preceded by obtaining of the decision on environmental conditions by the Investor. Decommissioning of the nuclear facility will therefore be covered by a separate procedure for the decision on environmental conditions.

■ Noise emission

11.3.1

Decommissioning works will generate noise of a similar nature and intensity to construction works. The main emitting devices will be machinery used for demolition and transportation works. Noise intensity will depend on the degree of intensification of the works. Preventive measures will be applied to reduce negative impacts, similar

to those used at the construction stage of the Investment Project. Machinery will be in good working order and will not be left idle, and the works will be properly organized. A detailed schedule of decommissioning works along with the necessary assessment of the impact on environmental components will be analyzed at a later stage of the Investment Project. Updating the power plant decommissioning schedule and method will also be done during the operation of the power plant.

Gas and dust emissions into the air

11.3.2

During decommissioning works involving the crushing of concrete structures, a certain amount of dust and particulate matter will be released. To avoid excessive dust emission during the most adverse weather conditions and the most intensive works, water curtains will be used to minimize the effects of demolition activities.

Both heavy construction equipment and vehicles used to transport waste and other materials will release exhaust fumes into the atmosphere. The nature and extent of these releases will depend on the type of equipment used and the intensity and duration of its operation, and will be similar to those generated during the construction stage of the Project.

Emissions into the groundwater environment

11.3.3

The power plant decommissioning activities are not expected to cause significant topography changes. They are also not expected to have any additional impact on the deterioration of the quality of the groundwater environment compared to that observed during the construction and operation stage of the power plant. Potential threats to groundwater quality could be unanticipated equipment failures resulting in uncontrolled leaks of operating fluids directly into the ground. However, appropriate mitigation measures will be taken to reduce the risk of failures or accidents that could result in spills. The mitigation measures will include the use of operational equipment that meets appropriate standards, only properly qualified and trained operators will operate the equipment, the construction site will be equipped with special means to absorb potential spills, refueling and any repairs to construction equipment and machinery will be carried out only in a specially marked and secured area.

A detailed description and analysis of the possible types and quantities of substances that could potentially be emitted into the groundwater environment will be presented as part of the EIA Report.

Electromagnetic emissions

11.3.4

At the end of operation, power generation equipment will be disconnected and removed from the power plant. Electromagnetic fields generated by generating equipment will disappear with the termination of their operation. The power lines that constitute power output to the NPS will be removed. No electromagnetic impact is expected during decommissioning of the Project. This stage will not use any equipment whose operation could cause an above-normal impact of electromagnetic fields. Any electrical equipment used during demolition works will be powered by low-voltage lines or portable power generator sets and will operate at 220 V or 400 V supply voltage, i.e. at low voltage, like all household appliances, hence the electromagnetic fields they generate will be negligible compared to the prevailing electromagnetic background.

At the stage of decommissioning, appropriate technical and organizational measures will be applied to the relevant emissions to reduce the harmful environmental impact, so that there will be no above-normative impact of the factor on people and the environment.

Radiation emissions

11.3.5

Prior to the commencement of the decommissioning stage, both radioactive waste and spent nuclear fuel previously stored at the Nuclear Power Plant site will be removed and moved to the National Radioactive Waste Repository and spent nuclear fuel storage or spent fuel repository, respectively, if available. All equipment will be inventoried for potential radioactive contamination, removed from the power plant and properly managed so that it does not pose an emission risk during demolition works.

As already mentioned in Chapter 9.3 Decommissioning Stage, decommissioning of the nuclear facility will be preceded by obtaining of a demolition permit for the nuclear facility by the Investor – issued under the Construction Law. In accordance with the EIA Act, the demolition license will be preceded by obtaining of the decision on environmental conditions by the Investor. The decommissioning of the nuclear facility will therefore be covered by a separate procedure for the decision on environmental conditions, which will describe in detail the quantities of radioactive waste generated and potential radiological emissions, which will be determined on the basis of the power plant's operating experience.

POSSIBLE TRANSBOUNDARY ENVIRONMENTAL IMPACT

12

Procedure for transboundary environmental impact shall be carried out in the case of projects implemented within the borders of Poland, which could affect the environment on the territory of the neighboring countries of the parties to the Espoo Convention. If the possibility of a transboundary environmental impact of a planned project is identified during the environmental impact assessment procedure, it is necessary to initiate interstate procedures related to transboundary impacts. According to the Convention on environmental impact assessment in a transboundary context (Journal of Laws of 1999, No. 96, item 1110), with regard to the planned project, due to the scale of the project and preventive measures, there are no prerequisites for conducting an environmental impact assessment procedure in a transboundary context.

To date, the international approach to the implementation of Nuclear Power Plant projects has been characterized by the fact that these projects, even despite the demonstration of their lack of impact on people and the environment (including in the event of an accident), are treated as projects with transboundary environmental impacts. There is currently no developed approach in this regard for small modular nuclear reactors (SMRs), characterized by a number of favorable safety features compared to large reactors and posing less potential risk to the environment, including, in particular:

- lower power output level (up to 1000 MWth),
- smaller quantities of nuclear fuel,
- less accumulated radioactive material in the reactor core.

It should also be noted that the design solutions of SMRs use passive safety systems (which do not require continuous power supply to perform their safety function) and inherent safety features which increases the intrinsic safety of such reactors, limits the size of the emergency planning zone.

SAFETY FEATURES OF THE BWRX-300 TECHNOLOGY

12.1

The BWRX-300 modular reactor features unique design solutions that guarantee a high level of safety. Among the most important design solutions to ensure the practical elimination of the possibility of severe accidents are:

- a. use of reactor vessel isolation valves: the BWRX-300 reactor pressure vessel is

equipped with isolation valves that provide rapid isolation of the broken pipeline, helping to mitigate the consequences of the LOCA. All large piping systems, of such size that their rupture could result in the LOCA, are provided with double isolation valves that are an integral part of the reactor pressure vessel;

- b. no safety relief valves: pressure relief valves have been eliminated from the BWRX-300 design. A high-capacity Isolation Condenser System provides protection against excessive overpressure in the reactor. Historically, safety valves were the most likely cause of the LOCA, so they were eliminated from the BWRX-300 design, and the fulfillment of their function was provided by another solution (ICS);
- c. the passive nature of the above-mentioned reactor core Isolation Condenser System (ICS): performing its function without the need for power, using the law of gravity and natural convection, which determines its high reliability;
- d. the use of a dry containment: the BWRX-300 reactor has a dry-type containment, which provides effective containment of steam, water and fission product emissions following a hypothetical LOCA;
- e. passive containment cooling system (PCCS) to ensure that the temperature and pressure inside the containment are maintained within design limits. The system performs its function when required without the need for power supply and using the law of gravity and natural convection, which determines its high reliability.

The aforementioned solutions make it possible to ensure that the probability of a severe accident resulting in releases of radioactive substances into the environment is much lower than national and international requirements. Polish regulations require that the frequency of hypothetical accidents that could result in large releases be less than 10^{-6} /year (once in a million years), which is consistent with the International Atomic Energy Agency's (IAEA) INSAG-12 recommendations. In comparison, the probability of hypothetical accidents resulting in large releases for the BWRX-300 project is estimated at 10^{-8} /year (once every hundred million years).

PRACTICAL ELIMINATION OF THE CONSEQUENCES OF THE ACCIDENT

12.2

The international approach introduces the practical elimination concept, providing a basis for the practical elimination of the consequences of a nuclear reactor accident and, in particular, the release of radionuclides leading to harmful impact on people and the environment.

The practical elimination concept was introduced as a result of accidents in Three Mile Island and Chernobyl to explicitly incorporate the “defense-in-depth” concept for severe accidents. The use of the “defense-in-depth” strategy ensures the prevention and control of incidents and potential accidents at several levels of an engineering and

procedural nature. This ensures that additional physical barriers protecting radioactive substances from release are effectively protected. The “defense-in-depth” strategy is supported by strengthening the inherent safety features of the reactor (resulting from physical phenomena naturally associated with the reactor’s design, such as a strong negative reactivity coefficient) and lessons learned from deterministic and probabilistic safety analyses conducted to assess and optimize the overall design of the power plant.

BWRX-300 SMRs are designed to provide a controlled state and maintain the “confinement” function of radioactive substances, in such a way that any consequences of an accident that could potentially result in early or large releases of such substances, requiring protective measures and intervention, are virtually eliminated.

Therefore, the design scope of the facility's states should be expanded to include not only the ability to defend against various emergency conditions, but also the practical means of stopping the development of severe accidents and practically eliminating their potential consequences. Consequences are considered practically eliminated if releases of radioactive isotopes are either physically impossible to occur or can be considered improbable with a high degree of certainty.

Compared to reactors currently in operation in the world, the BWRX-300 reactor is structurally simpler, and the entire safety concept is based primarily on passive safety systems and inherent safety features (such as lower capacity, and thus less residual heat for cooling). These safety features increase the so-called safety margins ensuring the effectiveness of physical safety barriers for radioactive substance containment and virtually eliminate the possibility of reactor core degradation conditions and the possibility of large radiation releases. Consequently, dependence on the containment and emergency response measures is reduced. For the postulated scenarios that could result in the containment function failure or its bypassing, the avoidance of early or large releases is appropriately achieved by demonstrating practical elimination for each individual case, by showing that the scenario is either physically impossible or extremely unlikely to occur with a high degree of certainty.

Considering that the frequency of hypothetical failures that could lead to large releases is approx. 10^{-8} /year for the BWRX-300 project, it is reasonable to treat this value as an argument for practical elimination. In addition, probability assessments are supplemented by deterministic analyses of physical phenomena and functionality of design provisions. By including additional beyond-design-basis safety measures in the design, it is demonstrated that radioactive releases that could pose a hazard to the public and the environment are physically impossible to occur.

In addition, the Investor will present in the EIA Report an analysis of the effects of the release of radionuclides for the adopted hypothetical accident scenario, proving the absence of harmful impact on people and the environment.

Due to the implementation of the Project at a considerable distance from the borders

of the Republic of Poland, the Investor does not expect that the planned Project may have a transboundary impact on neighboring countries when taking into account other types of impacts.

AREAS SUBJECT TO PROTECTION UNDER THE ACT OF APRIL 16, 2004 ON NATURE CONSERVATION, LOCATED WITHIN THE RANGE OF SIGNIFICANT IMPACT OF THE PROJECT

13

Pursuant to Article 6 section 1 of the Act of April 16, 2004 on nature conservation (Journal of Laws of 2022, item 916, as amended), the forms of nature conservation are: national parks, nature reserves, landscape parks, protected landscape areas, Natura 2000 sites, monuments of nature, documentation sites, ecological arables, landscape-nature complexes, plant, animal and fungi species protection.

NATIONAL PARKS

13.1

There are no National Parks in either the Region or the Small Modular Reactor (SMR) Site Area

NATURA 2000 SITES

13.2

Figure 31 shows the location of Natura 2000 sites in both the Area and the Region of the Location of a nuclear facility. A list of the Natura 2000 sites with their distance from the boundaries of the planned nuclear facility site is provided in Tab. 22. There are two Natura 2000 sites in the Site Area, and 10 sites in the Site Region.

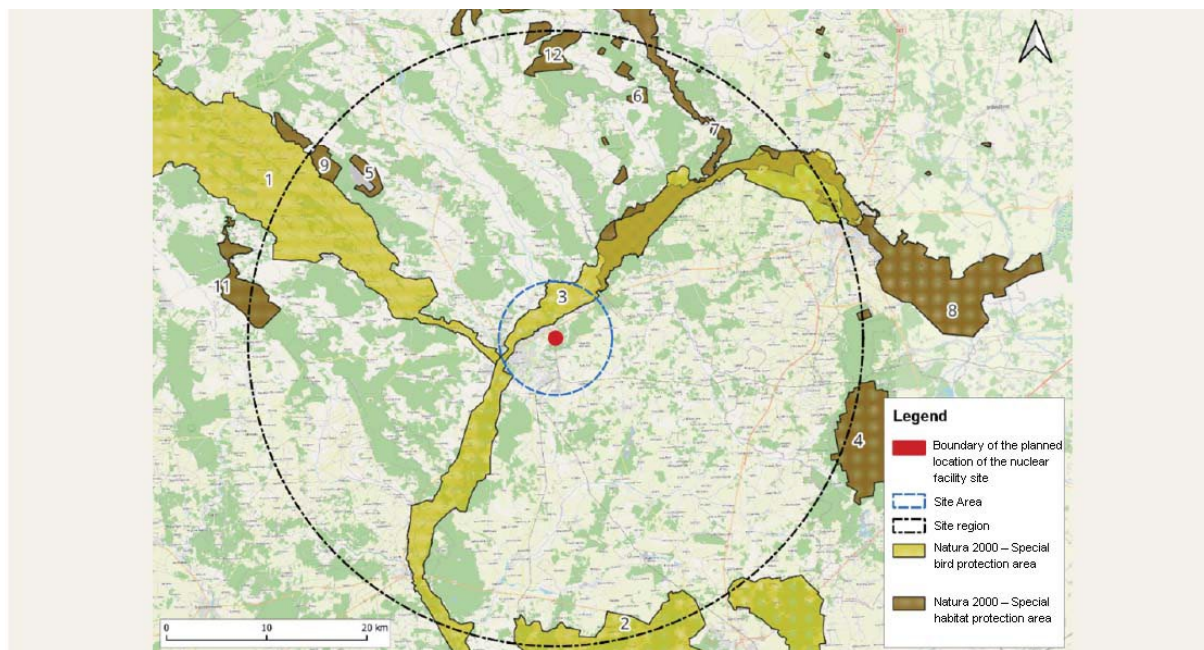


Figure 31. Planned site of NPP against the background of Natura 2000 sites (Source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)

Item	Name	Special Protection Area	Code	Distance from the boundaries of the planned location of the nuclear facility site
1	Omulwia and Płdownica Valleys	of birds	PLB140005	approx. 5 km
2	Biała Forest	of birds	PLB140007	approx. 27 km
3	Lower Narew River Valley	of birds	PLB140014	approx. 1 km
4	Czerwony Forest	of habitats	PLH200018	approx. 28 km
5	Karaska Coniferous Swamp and Peat Bogs	of habitats	PLH140046	approx. 22 km
6	Kolno and Kurpie Wetlands	of habitats	PLH200020	approx. 16 km
7	Pisa River Valley	of habitats	PLH200023	approx. 22 km
8	Narew Refuge	of habitats	PLH200024	approx. 6 km
9	Karaska Cladonio-Pinetum Forests	of habitats	PLH140047	approx. 27 km
10	Serafin Peat Bog	of habitats	PLH140057	approx. 29 km
11	West Kurpie Pasque Flower Forests	of habitats	PLH140052	approx. 27 km
12	Myszyniec Pasque Flower Forests	of habitats	PLH140049	approx. 26 km

Table 22. A list of Natura 2000 sites occurring in the Site Area and in the Site Region and their distance from the boundaries of the planned nuclear facility site (source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)

Most of the identified protected areas are located at considerable distances from the boundaries of the planned nuclear power plant site (more than 20 km) – the Investment Project's impact on these areas should therefore be considered unlikely. For this reason, only areas within the Site Area, i.e. less than 20 km away from the planned site of the Investment Project, were characterized in more detail.

“OMULWIA AND PŁODOWNICA VALLEY” PLB04003

The Special Bird Protection Area of Omulwia and Płodownica River Valley PLB140005 covers an area of about 34,286.7 hectares. The area is located within two physical-and-geographic macroregions: North Mazovian Lowlands and the Masurian Lake District. Most of the area of the Omulwia and Płodownica Valley is located within the Kurpiowska Plain mesoregion (southern and central parts). The plain is mainly made up of sands, which form dunes on the inter-valley divisions, reaching up to 20 meters in relative height, while there are wet floodplain terraces occupied by meadows along the two rivers. A small northern part of the area is located within the Masurian Plain mesoregion, which is made up of extensive glacial outwash plains covering the range of the Leszno phase. In terms of phytogeographical division, the area in question is located within the Kurpie Forest district.

A total of 48 amphibian species covered by Article 4 of Directive 2009/147/EC and species listed in Annex II of Directive 92/43/EEC were found in the area.

26 bird species from Annex I to the Birds Directive were found in the refuge of the Omulwia and Płodownica Valley. Moreover, a number of species of Migratory Birds non-covered by Annex I were found. Nineteen species were recognized as objects of protection. Of these, 12 species are species from Annex I to the Birds Directive. The area is home to several highly endangered species (European roller, aquatic warbler and black grouse). The area is crucial for the protection of the Eurasian curlew, being one of the largest national refuges of the species. The species occupying a variety of habitats are protected. In the meadow and sedge areas, these include spotted crane, Eurasian curlew, black-tailed godwit, common redshank, great snipe, snipe, hen harrier, aquatic warbler and black grouse. The white stork, woodlark, tawny pipit, hoopoe and highly endangered European roller are common in the varied cultural landscape. While, the bearded reedling and citrine wagtail are associated with fish ponds. In woodlands (poor pine forests on sandy soils), it is common to find European nightjar³⁰.

“LOWER NAREW RIVER VALLEY” PLB140014

The Lower Narew Valley PLB140014 special bird protection area covers an area of about 26,527.92 hectares. The area is located in the North Mazovian Lowland between Łomża and Pułtusk – the river is about 140 km long, and the width of the valley varies

30 Standard Data Form of the “Omulwia and Płodownica Valley” Natura 2000 SPA PLB04003

from 1.5 to 7 km. Almost along its entire length, the river meanders strongly. The river banks are generally steep, the river course is 80–100 m wide, and there are shallows, shoals, and numerous old river beds. There are willow and alder woodlands and small areas of pine forests in the valley. Forest areas are alternated with open areas, where pastures dominate.

55 bird species have been inventoried in the PLB140014 site, including 32 protected ones. The numbers of 4 species meet the criteria for delineating bird sanctuaries eligible to be regarded as international sanctuaries. 19 of the mentioned species are listed as endangered birds in the Polish Red Data Book of Animals.

The main threats identified in the area are the cessation of pasturage (and subsequent strong succession of shrubs and trees) and the penetration of habitats and destruction of bird hiding places, peat and sand mining, water pollution, illegal dumps, encroachment of recreational development into the valley area³¹.

“NAREW REFUGE” PLH200024

The Narew Refuge Special Habitat Protection Area PLH200024 covers an area of about 18,604.96 hectares. The area is occupied by meadow and scrub habitats to a significant extent (about 60%), about 20% are agricultural habitats, the rest of the area is occupied by deciduous forests, coniferous forests, peat bogs, marshes, vegetation on water banks, bog-spring, inland waters other areas. The Valley's natural environment diversity has been formed by natural fluvial processes and long-term agricultural use, primarily as hay meadows and for pasturage, which continue to be the dominant form of land use over most of the refuge.

The Narew Valley in the section between the mouth of the Szkwa River and the mouth of the Supraśl River is one of the few valleys in the country characterized by a slightly changed river system with numerous meanders and old river beds. The result of the preservation of the natural fluvial regime is annual flooding that covers significant portions of the valley. The dynamics of impoundments plays a great role in shaping and maintaining the diversity of hydrogenic (lotic and lenitic) and semihydrogenic habitats, representing different stages of development and succession, depending on the intensity of the impact of natural and anthropogenic factors. The importance of the Narew Valley as a Natura 2000 refuge results from its high natural diversity, including the presence of many habitat types, represented in some cases by several subtypes. These should include, first and foremost, old river beds, juniper thickets, and sandy and xerothermic grasslands, as well as various types of meadows and thermophilous oak forests. The Narew Valley has also an important function of an ecological corridor and a refuge for species associated with non-forest ecosystems in the agricultural landscape of the North Podlasie and North Masovian Plain. The presence of 18 habitat types listed in Annex I to Council Directive 92/43/EEC was identified in the refuge. The aggraded flat sections of the riverbed have muddy flooded riverbanks with brown

31 http://ine.eko.org.pl/index_areas.php?rek=420

galingale (*Cyperus fuscus*), three-lobe beggarticks (*Bidens tripartita*) and marsh yellow cress (*Rorippa palustris*). There are numerous old river beds in all stages of development: from those still connected to the current of the river to shallow ones and those that periodically dry out. They are greatly diverse in terms of trophism, surface area (from large reservoirs of >3 hectares, to small water bodies of a few tens of square meters) and depth. The waters and wetlands of the Narew Valley provide habitat for thirteen species of amphibians, including the European fire-bellied toad (*Bombina bombina*) and the northern crested newt (*Triturus cristatus*). The European pond turtle (*Emys orbicularis*) and five fish species listed in the Annex to the Habitat Directive – including the Ukrainian brook lamprey (*Eudontomyzon maria*), asp (*Aspius aspius*), European weatherfish (*Misgurnus fossilis*) and Amur bitterling (*Rhodeus amarus*) 5339, – were found here. There is a large and stable population of beaver (*Castor fiber*) there, and the European otter (*Lutra lutra*) is also quite common. The largest area share in the refuge has floristically rich and extensively used fresh and wet meadows with locally occurring patches of alluvial meadows occupying highly waterlogged depressions in the area. The Narew Valley plays a key role as a sanctuary for xeric sand calcareous grasslands (6120) and xerothermic swards (6210-3) in northeastern Poland. However, due to suboptimal climatic conditions, these communities occur here in an impoverished form. The grasslands are clearly anthropogenic, with extensive pasturage being the dominant land use in the valley as a factor of their formation and stabilization. Thanks to pasturage, unlike in many other regions of Poland, the grassland communities have a stable character and their prospects for protection are very good. There are particularly floristically rich patches of grasslands on the slopes of the valley on the breakthrough section between Pniewo and Łomża and in the valley below Nowogród. Their species composition includes, among others: *Dianthus carthusianorum*, *Filipendula vulgaris*, *Seseli annuum*, *Phleum phleoides*, *Anemone sylvestris*. Higher-lying and drier portions of the floodplain and above-floodplain terrace used for pasturage are occupied by junipers (5130) with heather, wild thyme, goldmoss and *Helichrysum arenarium*.

Small areas of the valley are occupied by forest communities: riparian forests and broadleaved forests; some of them are strongly degraded due to pasturage and logging. Thermophilous oak forest and patches of broadleaved forest occur in places on the floodplain terrace located higher and on the slopes of the valley. Forest communities, especially oak woods, are often significantly transformed, which manifests itself in the fragmentation of patches and their floristic impoverishment. Nevertheless, they are among the best preserved communities of this type in the northeastern part of the country. On the edges of oak woods, among others, on the southern outskirts of the protected forest complex in the Rycerski Kierz reserve (west of Łomża) occurs *Thesium ebracteatum* – a species listed in Annex II of the Council Directive 92/43/EEC. The Narew Valley serves as a floristic diversity sanctuary at least of national importance. There are 14 species from PCKL and/or PCKR here, including those considered extinct until recently, such as the bug orchid (*Orchis coriophora*) and the crested cow-wheat (*Melampyrum cristatum*), as well as *Succisella inflexa*,

Gentianella uliginosa, the leathery grapefern (*Botrychium multifidum*), the Siberian iris (*Iris sibirica*), and the rock cinquefoil (*Potentilla rupestris*)³².

The biggest threat to the valley's nature is posed by human activity. Harmful activities include, in particular:

- afforestation of unused grasslands, meadows and pastures with pine, as well as the expansion of shrubs and woody vegetation, which may occur as a result of the abandonment of the traditional type of management by farmers – changing water circulation systems, excessive intensification of agricultural production, especially the increase in fertilization, plowing of existing grasslands and seeding of high grade grass species, the use of plant protection products
- quarrying of natural aggregates, water pollution, illegal dumps, intensive recreational penetration, encroachment of recreational development into the valley area, poaching
- unification of tree stands and failure to adapt their species composition to habitat conditions by introducing pine monocultures in moderately fertile forest habitats
- upsetting the correct age structure of tree stands caused by the elimination of mature trees³³.

A protection tasks plan has been established for the area in question (Regulation No. 25/2013 of the Regional Director for Environmental Protection in Białystok of December 9, 2013 concerning the adoption of a protection tasks plan for the Natura 2000 Narew Refuge (Ostoja Narwiańska) PLH200024 site.

“KOLNO AND KURPIE WETLANDS” PLH200020

The Kolno i Kurpie Wetlands Special Habitat Protection Area PLH200020 covers an area of about 1446.57 hectares. “Kolno and Kurpie Wetlands” is a dispersal Natura 2000 site, covering 15 wetland sites scattered across the Kolno Upland and Kurpiowska Plain.

The high natural values of the site are influenced by the significant internal habitat diversity in a relatively small area, as well as the rarity of such elements in the landscape of the Kolno Upland and Kurpiowska Plain. 10 types of natural habitats (with division into subtypes) were found here. Some of them are rare habitats in both mesoregions (especially coniferous swamp 91D0-2, pine-birch bog forest 91D0-6), and some are rare in the whole northeast Poland (such as the perfectly preserved 7230-3 flow bogs here). There is also the largest complex of high peat bogs in the Kurpie Forest here. Sites with open water, including mainly the Rybnica River valley, are biotopes for the European beaver (*Castor fiber*) (1337), European otter (*Lutra lutra*) (1355). Numerous amphibian species include the fire-bellied toad (*Bombina bombina*) (1188) – a species listed in Annex II of Council Directive 92/43/EEC. Several bird

32 Standard Data Form of the Narew Refuge PLH200024 Natura 2000 SAC

33 http://ine.eko.org.pl/index_areas.php?rek=819

species listed in Annex I to Council Directive 79/409/EEC have also been recorded, including common crane (*Grus grus*) (A127), black stork (*Ciconia nigra*) (A030), mute swan (*Cygnus olor*) (A036), gray heron (*Ardea cinerea*) (A028) and black woodpecker (*Dryocopus martius*) (A236). Moreover, within the boundaries of the site, in addition to the protected plants found in the bogs, the surrounding pine forests contain stands of other rare representatives of native flora, including the sand pink (*Dianthus arenarius*). The area is a refuge for 8 species listed in the Polish Red Data Book of Plants (Kaśmierczakowa, Zarzycki 2001), in the Red List of Plants and Fungi of Poland (Mirek et al. 2006) or the Red List of Mosses in Poland (Ochyra 1992). It is also home to 22 plant species under strict protection in Poland and rare in the northeastern region³⁴.

The most important environmental hazards within the boundaries of the site include drainage as a result of land reclamation carried out in the vicinity of the facilities, as well as upsetting of water circulation systems in the peatlands as a result of poorly functioning drainage control structures and accelerated outflow of water, and the cessation of mowing of meadows and mosslands, resulting in natural succession, primarily the development of willow thickets and the encroachment of pine and birch on open bogs, as well as the intensification of agricultural activities (mainly fertilization and intensive grazing)³⁵.



34 Standard Data Form of the Natura 2000 SPA "Kolno and Kurpie Wetlands" (Mokradła Kolneńskie i Kurpiowskie) PLH200020

35 http://www.ine.eko.org.pl/index_areas.php?rek=820

There are no Landscape Parks in either the Region or the Small Modular Reactor (SMR) Site Area. The closest area of this type is the Łomża Landscape Park of the Narew Valley, located approx. 31 km east of the Site (Figure 32).

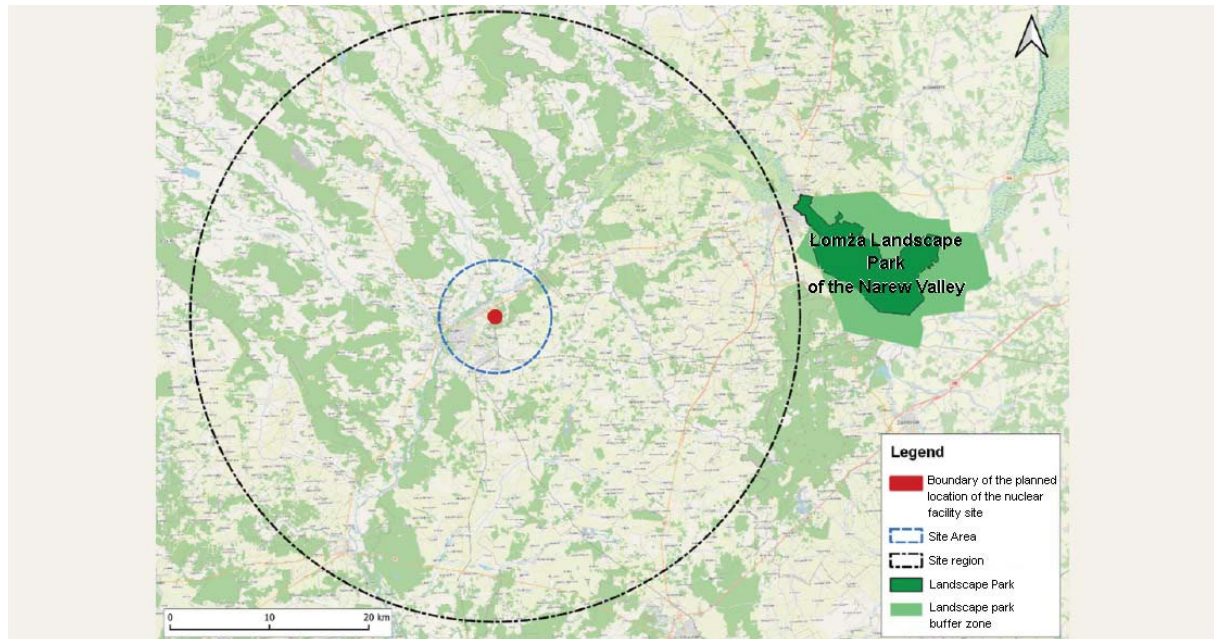


Figure 32. Planned Site of the NPP against the background of the Landscape Parks (source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)

One area of this type – Protected Landscape Area “Kurpiowska Plain and Lower Narew Valley” located approx. 6 km from the NPP Site boundary – has been identified in the Site Region (Figure 33).

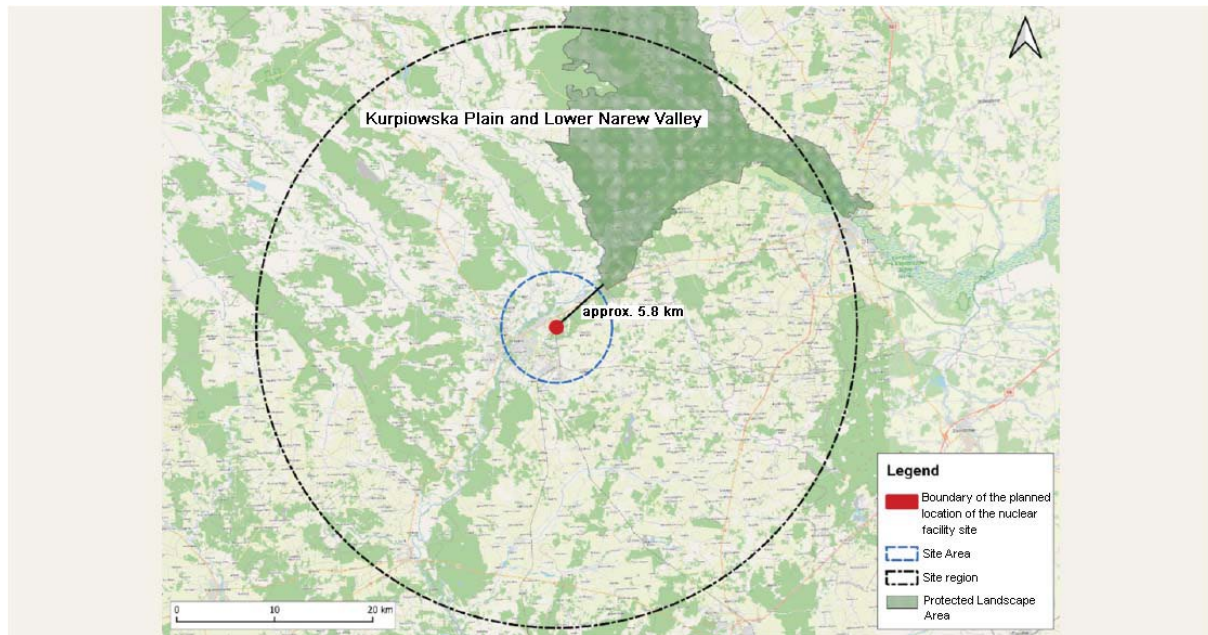


Figure 33. Planned Site of the NPP against the background of the Protected Landscape Areas (source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)

The Protected Landscape Area “Kurpiowska Plain and Lower Narew Valley” was established by Resolution No. X/46/82 of the Provincial National Council in Łomża dated April 27, 1982, as amended by Regulation No. 14/98 of the Łomża Governor dated May 19, 1998 and Regulation No. 17/04 of the Podlasie Voivodeship Governor dated September 16, 2004.

It covers the area of the Narew and Pisa valleys and the Kurpie Forest with a total surface area of 48,994.1 hectares. Active protection of the Area's ecosystems, implemented within the framework of rational agricultural and forestry management, consists in preserving the biodiversity of natural habitats occurring in the valleys of the meandering Narew and Pisa rivers, with numerous old river beds, and in the Kurpie Forest complex³⁶. The Lower Narew Valley, with its meandering Pisa, numerous meanders, old river beds and dune islands, as well as the current part of the former Kurpie Forest, is a mosaic of many intertwined habitats, conditioning the high biodiversity of the area. The area is distinguished by its high, well-preserved, natural values – a wealth of flora and fauna – as well as scenic and cultural values.

The Kurpiowska Plain is a vast sandur (glacial outwash plain) in the southern foothills of the Mazurian Lake District, crisscrossed by valleys of small rivers. Its flat, plain landscape is varied by dune hills. They are most abundant in the inter-basins of the Pisa, Szkwa and Rozoga rivers, where the terrain rises 100–150 meters above sea level and slopes gently to the south. The river valleys here are flat, wide, and dominated by hay meadows and pastures. Only the Pisa Valley, retains the natural character of a lowland river with numerous meanders and old river beds. Along the Pisa River are forests and open, wet floodplain terraces, used mainly as meadows.

36 Central Register of Nature Protection Forms [available online] General Directorate for Environmental Protection, accessed June 2023.

Originally, the Kurpiowska Plain was overgrown by the Green (Kurpie) Forest. Today, forests are no longer a compact complex, but are dissected by a network of fields, meadows and river valleys³⁷.

NATURE RESERVES

13.5

Figure 34 shows the location of nature reserves in both the Area and the Region of the Nuclear Facility Site. A list of the reserves, along with an indication of the distance from each Nature Reserve, is provided in Tab. 23. There are no nature reserves in the Site Area, and there are 11 nature reserves in the Site Region. 8 of them are located more than 20 km from the planned Site of the NPP.

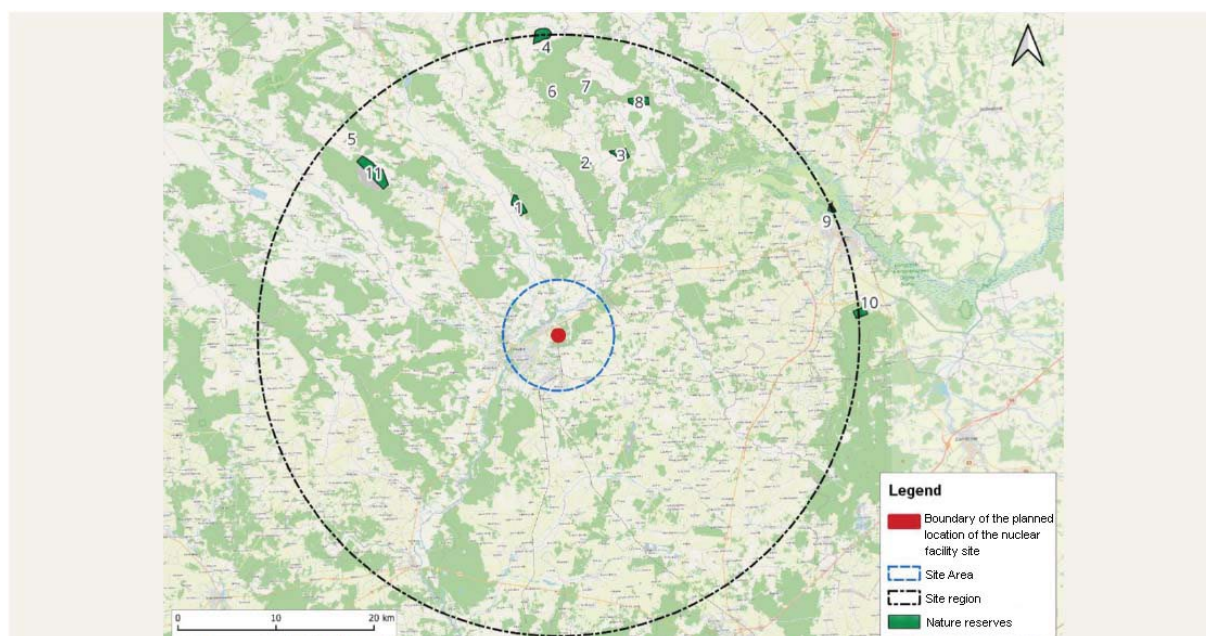


Figure 34. Nature reserves in the Site Region. The numerical designations are explained in Table 23 (Source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)

NATURE RESERVES		
Item	Name of the reserve	Distance
1	Olsy Płoszyckie	approx. 12 km
2	Czarny Kąt	approx. 17 km
3	Kaniston	approx. 18 km
4	Torfowisko Serafin	approx. 29 km
5	Podgórze	approx. 28 km
6	Mingos	approx. 24 km

37 <https://powiatlomzynski.pl/index.php?wiad=3463>

7	Tabory	approx. 25 km
8	Łokieć	approx. 25 km
9	Rycerski Kierz	approx. 30 km
10	Dębowe Góry	approx. 30 km
11	Torfowiska Karaska	approx. 22 km

Table 23. List of nature reserves occurring in the Site Region and their distance from the Boundaries of the planned nuclear facility site

The closest nature reserve (12 km) is the Olsy Płoszyckie forest reserve, where the object of protection is alder riparian woods aged 70–90 years. There are 199 vascular plants in the reserve. The plant community is dominated by black alder (*Alnus glutinosa*). The mazereon (*Daphne mezereum*), which occurs here in great numbers, is completely protected as a species in the reserve area. The abundant glossy buckthorn (*Frangula alnus*), coral calla (*Viburnum opulus*), guelder-rose (*Ribes nigrum*) and lily of the valley (*Convallaria majalis*), which grows in only 3 sites, are also under partial protection³⁸.

Due to the significant distance of the planned Site of the Project from nature reserves, it is expected that the Project will not have a negative effect on them.

OTHER PROJECTS UNDER CONSTRUCTION AND COMPLETED 14

The Project is mainly planned in an anthropogenically transformed area with a strong industrial character. The power part of the Project will be executed on land owned by the Ostrołęka C Power Plant company. The site is currently being used as a construction site for the ongoing investment project involving the construction of the Ostrołęka CCGT power plant with a capacity of approximately 800 MW, and was previously used as a construction site for the not completed Ostrołęka C coal-fired power unit, as well as a repository for waste remaining after the construction of Ostrołęka A and B Power Plants. In addition, in the immediate vicinity of the planned site of the Investment Project, there is a railway line along with a railway siding, Ytong building ceramic plants and the bankrupt horticultural farm Prywatne Gospodarstwo Ogrodnicze Sp. z o.o. (bankruptcy declared in 2018). Further away are the “Ostrołęka” 400/220/110 kV substation, several industrial plants, the 690 MW Ostrołęka B coal-fired power plant and shutdown Ostrołęka A coal-fired power plant. To the east of the analyzed Site, works are also underway on the construction of a power line that constitutes the connection line (power output) from the Ostrołęka CCGT power plant, which is currently under construction. Each of these activities is characterized by its specificity, including also various environmental impacts – with respect to their type,

38 <http://www.parki.org.pl/inne-pozostale/rezerwat-olsy-ploszyckie>

range, time scope and scale.

Emission and disturbances that may occur as a result of the Project will be identified, and their impact on the environment will be analyzed and assessed during the preparation of the EIA Report. The impacts of neighboring projects, both under construction and completed, located in the area of impact of the planned Project will also be identified – to the extent that their impacts may result in impacts cumulated with the planned Project.

RISK OF A SERIOUS ACCIDENT OR NATURAL DISASTER AND STRUCTURAL COLLAPSE

15

To avoid the risk of a serious industrial accident and structural collapse resulting from, e.g., a natural disaster, prescreening analyses were carried out on behalf of the Investor to identify, i.a., potential natural and human-related hazards in the Site Region. Analyses have shown that there are no factors that absolutely exclude the possibility of setting the foundation of a nuclear power plant in the analyzed area. With proper building permit design and proper performance of works, the possibility of a structural collapse risk is minimized. Proper management and protection of chemicals, as well as adherence to safety procedures, will in turn ensure that the risk of an industrial accident hazard is minimized.

RISK OF A SERIOUS ACCIDENT

15.1

In accordance with Article 3 section 23 of the EIA Act, the term serious accident means an event, in particular emission, fire or explosion, taking place during an industrial process, storage or transport, in which one or more hazardous substances occur, leading to the immediate hazard to life or health of people or to the environment or the delayed occurrence of such a hazard.

The Project is classified as a plant associated with the possibility of a serious industrial accident – in accordance with Article 248 of the Environmental Protection Law (Journal of Laws of 2022, item 2556, as amended) and the Ordinance of the Minister of Development of January 29, 2016 on the types and quantities of hazardous substances whose presence in a plant determines its classification as a plant with an increased risk or a plant with a high risk of a serious industrial accident (Journal of Laws of 2016, item 138).

It is highly probable that the Project will be classified as a plant with a high risk of a serious industrial accident, but a detailed inventory of the chemicals that will be stored in the plant will be prepared during the development of the EIA Report for the Project.

■ RISK OF A NATURAL DISASTER

15.2

Pursuant to Article 3 section 1 point 2 of the Act of April 18, 2002 on the state of natural disaster (Journal of Laws of 2017, item 1897), a natural disaster shall be understood as an event related to the impact of forces of nature, in particular lightning strikes, seismic shocks, strong winds, heavy atmospheric precipitation, prolonged occurrence of extreme temperatures, landslides, fire incidents, droughts, floods, icing growth on rivers and sea, lakes and reservoirs, mass occurrence of pests, diseases of plants or animals or infectious diseases of people or an impact of other elements.

The main natural hazards that can have a negative impact on the safety of nuclear power plant operation, recognized by nuclear experts worldwide, are seismic phenomena and tectonic activity in the region. Therefore, on behalf of OSGE, the Site was covered by prescreening analyses performed by the Institute of Geophysics of the Polish Academy of Sciences (IGF PAN) for seismicity and tectonic activity. The analyses conducted showed that there were no exclusionary factors from natural and induced seismicity in both the Site Region and the Site Area. The Site region is characterized by a stable tectonic structure with a low risk of fault throw activation. Preliminary analyses of the Region's seismicity have shown that the maximum possible earthquake could cause ground accelerations (PGA) of 0.22 g.

In addition, as part of the prescreening analyses commissioned by OSGE, the analyzed Site was assessed by the industry advisor – Energoprojekt Katowice (EPK), whose task was to identify natural phenomena and hazards in the field of geology, that could have a significant impact on the safety of NPP operation. According to the EPK report, there is no possibility of a natural disaster in the form of landslides, liquefaction of soil, suffosion or flood risk on the Site due to geological conditions.

Other natural disaster risk is associated with extreme meteorological and hydrological phenomena, in the form of violent storms and gusty winds or prolonged periods of drought. Depending on the preparedness of the population and the structural features of civil structures, the effects of a natural disaster can vary dramatically. For example, gusty winds, depending on the building permit design of the building, can be completely imperceptible to a solid structure or cause the roof to tear off for older types of buildings. The building permit design of the planned nuclear power plant will be adapted to local conditions in such a manner as to ensure its safe operation even under a combination of adverse meteorological, seismic, hydrological, etc. conditions.

Both the structure and the safety systems used ensure safe operation of the nuclear

power plant under the most demanding conditions. To confirm the correctness of the architectural and construction design of the power plant and the solutions contained therein, the Site of the planned Project will be subjected to meteorological monitoring and a detailed analysis of meteorological phenomena, along with anticipated changes in their intensity and frequency in the future, taking into account progressive climate change.

When analyzing the Project resilience to climate change, the following in particular will be assessed: resistance to prolonged droughts, violent winds, heat waves, cold waves, extreme precipitation, violent storms, intensive snowfall, lightning strikes, seismic phenomena, risk of flooding, freezing and thawing.

The aforementioned monitoring and analyses will be carried out at the stage of site surveys, which are necessary for the detailed assessment of the Site and for the development of the location report which is attached to the application for the construction license. The above documents will be assessed by experts of the National Atomic Energy Agency [Poland] at the stage of issuing the construction license.

RISK OF A STRUCTURAL COLLAPSE **15.3**

Pursuant to Article 73 section 1 of the Construction Law (Journal of Laws of 2023, item 682, as amended), a structural collapse is an unintentional, violent destruction of a civil structure or part thereof, as well as structural elements of scaffolding, elements of forming devices, sheet piling and excavation support.

The idea of building Small Modular Reactors (SMRs) is based on the assumption that the volume of construction works on the Investment Project site will be reduced to the necessary minimum, and a significant part of the elements that make up the entire Project will be delivered to the site in the form of prefabricated components. Prefabricated components will be manufactured in specialized factories to ensure the quality and durability of these components, and then the components will be transported to the construction site. This approach significantly reduces the scope of construction works performed on the construction site, thus dramatically reducing the risk of a structural collapse during construction. Construction works will be carried out in accordance with the applicable regulations, permits and standards by specialized companies with relevant experience, which will ensure the appropriate quality of the works performed.

It should be added that the building permit design will be adapted to local geological conditions, also taking into account meteorological conditions that may occur on the Site, potential hazards of explosions from nearby industrial plants, or a passenger airplane crash.

It is also not insignificant that both the power unit and the technical infrastructure and

auxiliary buildings will be subjected to regular and detailed inspections and ongoing maintenance to ensure their trouble-free operation throughout the life cycle of the Project, starting from the commencement of construction until the end of its decommissioning. Regular safety inspections will be carried out by the power plant personnel, public administration authorities and expert international organizations such as the IAEA.

The planned Project involves the construction of a nuclear power plant using proven yet modern technologies. The Investor undertakes to perform all possible construction works in accordance with the applicable regulations and legal norms, in particular bearing in mind the provisions of the Construction Law, including the Ordinance of the Minister of Infrastructure of February 6, 2003 on occupational health and safety during construction works (Journal of Laws of 2003 No. 47 item 401). All civil and erection works will be carried out only by qualified workers, in accordance with OH&S rules.

It is important to emphasize the fact that the nuclear industry, compared to other types of industries, is characterized by the application of extraordinarily safety principles referred to as the “safety culture” – this approach consists primarily in promoting certain behaviors and habits among workers. They must strictly adhere to specific operating procedures in their works and pay close attention to any failure, and be sensitized to any irregularities in the operation of equipment or other workers.

In view of the above, it should be concluded that the risk of a structural collapse, as understood under the provisions of the Construction Law, should be considered marginal, and in the event of its occurrence, its impact will not go beyond the area limited by the fence of the power plant.

EXPECTED AMOUNTS AND TYPES OF WASTE GENERATED AND THEIR IMPACT ON THE ENVIRONMENT

16

During the life cycle of the nuclear power plant, waste will be generated at various stages of operation:

- **Conventional** (municipal and industrial waste)
- **Radioactive waste:**
 - Low-activity
 - Medium-activity
 - High-activity

The largest amounts of conventional industrial waste will be generated at the

construction and decommissioning stages of the power plant. Municipal waste in moderate amounts will be generated at each stage of the power plant life.

Radioactive waste will be generated only at the operation and decommissioning stages of the Project.

■ CONVENTIONAL WASTE

16.1

Generally, conventional waste is divided into two categories: industrial and municipal. In both groups, a subgroup of hazardous waste is distinguished. Municipal waste is mainly generated in households as a result of human existence, while industrial waste accompanies business activities.

■ RADIOACTIVE WASTE

16.2

Radioactive waste generated at the power plant will be handled in accordance with the requirements of the law – it is the organizational unit where radioactive waste or spent fuel is generated that is responsible for safety in the handling of this waste or spent fuel from the moment it is generated until it is transferred for storage.

In accordance with Article 47 section 1 of the Nuclear Law Act [Poland], radioactive waste, due to the concentration of radioisotopes, is classified into the following categories of waste:

- Low-activity
- Medium-activity
- High-activity

After the storage period, spent nuclear fuel destined for storage is classified as high-activity radioactive waste.

During operation of the BWRX-300 reactor mainly low- and medium-intensity waste will be generated. The waste will be processed in accordance with the license issued by the PAA President. After processing, the waste will be stored in an interim radioactive waste storage facility, and then it will be collected by the Zakład Unieszkodliwiania Odpadów Promieniotwórczych – public utility company (ZUOP). ZUOP, in accordance with the Nuclear Law Act, was established to carry out activities in the field of radioactive waste and spent nuclear fuel handling and, above all, to ensure the permanent storage of waste and spent fuel. The currently operating radioactive waste repository in Różan will not be able to accept waste from the

operation of the planned nuclear power plant; however, the problem has been identified and, in accordance with the provisions of the National Plan for Handling Radioactive Waste and Spent Nuclear Fuel (KPPzOPiWPJ), works are in progress to select the location, build and operate a new surface radioactive waste repository. This task is the responsibility of the Ministry of Climate and Environment, ZUOP and the Polish Geological Institute – National Research Institute.

In terms of spent nuclear fuel handling, it will be safely stored in a basin at the reactor for about 8 years, after which it will be transferred to a spent fuel storage facility, where it will be stored until it is transferred for storage in a deep radioactive waste repository. Currently, there is no such a repository in Poland; however, in accordance with the National Plan for Handling Radioactive Waste and Spent Nuclear Fuel, works are in progress to identify the optimal location for a deep repository. The Ministry of Climate and Environment, ZUOP and the Polish Geological Institute – National Research Institute are responsible for this process.

CONSTRUCTION STAGE

16.3

The construction stage is characterized by intensive earthworks, construction, as well as civil and erection works, including the construction of nuclear power units, spent fuel storage facility building, interim radioactive waste storage facility, cooling systems, power output infrastructure, and other auxiliary buildings and technical infrastructure.

The performance of construction works will involve the generation of a significant amount of waste characteristic for construction, installation and finishing works. The waste catalog, in accordance with the classification contained in the waste catalog, which is an appendix to the Ordinance of the Minister of Climate of January 2, 2020 on waste catalog (Journal of Laws of 2020, item 10), is contained in Table 24.

Group code	Description
07	Waste from production, preparation, marketing and use of organic chemical industry products
08	Waste from production, preparation, trading and application of protective coatings (paints, veneers and ceramic enamels), putties, glues, sealing agents and printing paints
12	Waste from forming and physical and mechanical treatment of metal and plastic surfaces
13	Waste oils and liquid fuel waste (except for edible oils and groups 05, 12, and 19)
14	Waste organic solvents, refrigerants and propellents (excluding groups 07 and 08)
15	Packaging waste; sorbents, wiping cloths, filter materials and protective clothing not specified in other groups

16	Waste not included in other groups
17	Waste from construction, renovation and demolition of civil structures and road infrastructure (including soil and soil from polluted areas)
18	Medical and veterinary waste (excluding kitchen and restaurant waste not relating to health or veterinary care)
19	Waste from systems and equipment used for waste management, water treatment plants and treatment of potable water and water for industrial purposes
20	Municipal wastes (household waste and similar commercial, industrial and institutional wastes) including separately collected fractions

Table 24. Classification of waste likely to be generated on the investment project site at the construction stage (waste classification in accordance with the Waste Act (Journal of Laws of 2022, item 699, as amended)).

No radioactive waste is expected to be generated at the construction stage of the Investment Project.

A waste generator within the meaning of the Waste Act of December 14, 2012 (Journal of Laws of 2022, item 69, as amended) will be the entity that performs the service involving the performance of construction works, which under the Waste Act will be obliged to manage the waste generated during construction.

During the performance of works, the Site will be cleaned up on an ongoing basis. The waste generated will be subject to quantitative and qualitative records. All the above-mentioned waste will be collected selectively and stored and then transferred to specialized companies with the necessary licenses for further management. Liquid waste until it is accepted, will be collected in closed containers in areas with a paved and impermeable surface.

Proper organization of the ongoing waste management system and proper organization of the construction site, and above all, compliance with the Waste Act and secondary legislation, will minimize the direct impact of waste on human health and life and the environment. Therefore, it is concluded that waste management at the construction stage will not have a negative environmental impact.

The detailed characteristics of the generated waste by subgroups and types of waste, along with their estimated amounts, will be determined during the preparation of the EIA Report.

OPERATION STAGE

16.4

The operation stage is characterized by the generation of both conventional and radioactive waste.

Conventional waste generated at the operation stage is expected to fall mainly into the

groups in accordance with Table 25.

Group code	Description
06	Waste from production, preparation, marketing and use of inorganic chemical industry products
08	Waste from production, preparation, trading and application of protective coatings (paints, veneers and ceramic enamels), putties, glues, sealing agents and printing paints
12	Waste from forming and physical and mechanical treatment of metal and plastic surfaces
13	Waste oils and liquid fuel waste (except for edible oils and groups 05, 12, and 19)
14	Waste organic solvents, refrigerants and propellents (excluding groups 07 and 08)
15	Packaging waste; sorbents, wiping cloths, filter materials and protective clothing not specified in other groups
16	Waste not included in other groups
17	Waste from construction, renovation and demolition of civil structures and road infrastructure (including soil and soil from polluted areas)
18	Medical and veterinary waste (excluding kitchen and restaurant waste not relating to health or veterinary care)
19	Waste from systems and equipment used for waste management, water treatment plants and treatment of potable water and water for industrial purposes
20	Municipal wastes (household waste and similar commercial, industrial and institutional wastes) including separately collected fractions

Table 25. Classification of waste likely to be generated on the investment project site at the NPP operation stage (waste classification in accordance with the Waste Act)

It is estimated that the main waste stream will be the waste generated from overhauls, municipal waste or waste generated from maintenance of equipment and systems.

In accordance with the information submitted by the technology provider GE-Hitachi, operation of one BWRX-300 reactor will generate mainly solid waste. The estimated annual amount of solid radioactive waste will be less than 224.00 m³/year. The main stream of radioactive waste will be low-activity waste. Waste will be processed on the NPP site in accordance with the procedures approved by the PAA President.

Detailed characteristics of waste generated at the operation stage of the nuclear power plant by category and subcategory of waste, along with its estimated amount, will be determined during the development of the EIA Report.

■ DECOMMISSIONING STAGE

16.5

The decommissioning stage of the nuclear power plant will first consist in an inventory

of facilities and components that may have been subject to radioactive contamination during the facility operation. Subsequently, uncontaminated facilities and elements will be subject to demolition works. The waste from the demolition of the power plant will be mainly conventional waste in the form of concrete, debris, earth masses, steel structural and system components, metals and other typical components generated during the demolition of infrastructural facilities. It should be noted that the vast majority of waste generated during decommissioning works will be conventional waste. The waste will be properly segregated and classified on the demolition site. It is estimated that most of the conventional waste will be recycled (mainly steel and other metals, concrete, glass, plastic) or other forms of recovery; only waste that proves impossible or economically infeasible to recycle or recover will be transported and deposited in a suitable repository. Waste handling will be adapted to the regulations in effect at the time of the power plant decommissioning.

It is estimated that radioactive waste generated during decommissioning of nuclear facilities will account for only a few to 10% of the mass of all waste generated during decommissioning works. This waste, after appropriate preparation, will be transported by ZUOP to a radioactive waste repository.

DEMOLITION WORKS FOR PROJECTS LIKELY TO HAVE A SIGNIFICANT IMPACT ON THE ENVIRONMENT

17

In accordance with the Construction Law, demolition is a type of construction works involving the dismantling and removal from space of a specific civil structure or part thereof. The commencement of demolition works will be preceded by the Investor obtaining the necessary decisions and license including:

- Decision on environmental conditions – issued under the EIA Act,
- Nuclear facility decommissioning license – issued under the Nuclear Law Act,
- Nuclear facility demolition license – issued under the Construction Law.

The environmental impact of decommissioning and demolition works will be characterized as part of a separate environmental impact assessment procedure on a date close to the actual end of the power plant operation. Given the distant time (at least 60 years) when the demolition of the facilities will take place, and given the process progress relating to, i.a., the manner vehicles and equipment are powered, the description of the potential impact of the works as of today would not be precise.

Demolition works will be characterized by similar impacts as civil and erection works.

All works will be carried out by appropriately qualified personnel under the supervision of persons with appropriate building licenses. All works will be performed after workers have been trained in OH&S.

At the time when it is necessary to perform demolition works, the Investor will fulfill all legally required formalities to allow demolition works to be performed, and during the works, the safety conditions for workers provided for by the relevant regulations will be observed.



1. Atlas klimatu Polski (Climate Atlas of Poland) (1991–2020), Scientific Editor: Arkadiusz M. Tomczyk, Ewa Bednorz, Bogucki Wydawnictwo Naukowe, Poznań 2022.
2. Bulletin of the National Hydrological and Meteorological Authority – 2022 year, IMGW-PIB, Warsaw, 2022.
3. BWRX-300 Generic Plant Parameter Envelope 005N3953 Rev. D, April 2023
4. Central Geological Database [online access], Polish Geological Institute – National Research Institute, accessed June 2023.
5. Central Register of Nature Protection Forms [available online] General Directorate for Environmental Protection, accessed June 2023.
6. Characteristics of surface water bodies, [online access], <https://apgw.gov.pl/>, accessed June 2023.
7. Characteristics of groundwater bodies, [online access], <https://apgw.gov.pl/>, accessed June 2023.
8. Directive 2000/60/EC of the European Parliament and of the Council of October 23, 2000 establishing a framework for Community action in the field of water policy (OJ L 327 of 22.12.2000, p. 1)
9. Directive 2009/147/EC of the European Parliament and of the Council of November 30, 2009 on the conservation of wild birds (Birds Directive), OJ EU L 20 of 26 January 2010, as amended
10. Council Directive 92/43/EEC of May 21, 1992 on the conservation of natural habitats and of wild fauna and flora, OJ L 206/7 of 22 July 1992, as amended
11. Gospodarka energetyczna i gazownictwo w 2021 r. (Energy management and gas engineering in 2021), Statistics Poland, Warsaw, September 15, 2022
12. Hydrogeologia regionalna Polski [Regional hydrology of Poland] – B. Paczyński, A. Sadurski, PIG, Warsaw 2007.
13. IAEA Nuclear Series No. NG-T-3.11, Managing Environmental Impact Assessment for Construction and Operation in New Nuclear Power Programs, 2014
14. IAEA SSR-2/1 (Rev. 1) Safety of Nuclear Power Plants: Design
15. IAEA-TECDOC-1915, Considerations for Environmental Impact Assessment for Small Modular Reactors, IAEA, 2020
16. PSH handbook, Main groundwater reservoirs in Poland, J. Mikołajków, A. Sadurski, PIG-BIP, 2017
17. Classification of forest habitats – comments on soils in terms of diagnosis principles, S. Brożek, 2007
18. Convention on environmental impact assessments in a transborder context (Journal of Laws No. 1999, No. 96, item 1110)
19. Kryteria wyboru lokalizacji elektrowni jądrowej w Polsce, Logistyka — nauka (Selection criteria for nuclear power plant sites in Poland, Logistics – science), 5/2011, 544-551, Fabisiak J., Kupiński J., Michalak J., Nowik H., 2011
20. Mapa geośrodowiskowa Polski w skali 1:50 000 (Geoenvironmental map of Poland at a scale of 1:50,000) sheet Ostrołęka (333) – A. Jasińska, D. Janica, Polish Geological Institute – National Research Institute, Warsaw, 2010

21. Mapa hydrogeologiczna Polski w skali 1:50 000 (Hydrogeological map of Poland at a scale of 1:50,000), sheet Ostrołęka (333) – A. Hulboj, Polish Geological Institute – National Research Institute, Warsaw, 2002.
22. MIT Energy Initiative, “The Future of Nuclear Energy in a Carbon-Constrained World”, 2018
23. Objasnienia do mapy geośrodowiskowej Polski 1:50 000 (Explanations to the geoenvironmental map of Poland at a scale of 1:50,000) sheet Ostrołęka (333) – A. Jasińska, D. Janica, P. Kwecko, I. Bojakowska, H. Tomassi-Morawiec, J. Król, Polish Geological Institute – National Research Institute, Warsaw, 2010.
24. Objasnienia do Mapy hydrogeologicznej Polski w skali 1:50 000 (Explanations to the hydrogeological map of Poland at the scale of 1:50,000), sheet Ostrołęka (333) – A. Hulboj, Polish Geological Institute – National Research Institute, Warsaw, 2002.
25. Objasnienia do Szczegółowej mapy geologicznej Polski w skali 1:50 000 (Explanations to the detailed hydrogeological map of Poland at the scale of 1:50,000), sheet Ostrołęka (333), A. Bałuk, Polish Geological Institute – National Research Institute, Warsaw, 1993
26. Geotechnical opinion for the foundation of the designed power unit, operating in the CCGT arrangement, on the premises of Ostrołęka C Power Plant, ILF Consulting Engineers Polska Sp. z o.o., 2021
27. Written summary containing results of the strategic environmental impact assessment and justification for the selection of the Polish Nuclear Power Program, Warsaw 2020
28. Forest Management Plan, Ostrołęka Forest District, Ostrołęka District, prepared for the period from January 1, 2022 to December 31, 2031 on the basis of the state of the forest as of January 1, 2022, Forest Management and Geodesy Bureau, Olsztyn Branch, 2022)
29. “Polish Energy Policy 2040” (PEP2040) developed by the Ministry of Climate and Environment dated February 2, 2021
30. Environmental impact forecast for the local development plan for the “Wilcza 3” area in Ostrołęka, I. Robak, 2021
31. Environmental impact forecast for the local development plan of the “Partyzantów I” area in Ostrołęka, I. Robak, 2022
32. Environmental protection program for the city of Ostrołęka for 2021–2027 with the perspective until 2030, Ostrołęka, 2021
33. Environmental protection program for Ostrołęka district for 2023–2026 with the perspective until 2030, M. Przybylski, 2022
34. Polish Nuclear Power Program (PPEJ) dated October 16, 2020 (Resolution No. 141 of the Council of Ministers)
35. Ostrołęka site analysis final report, Energoprojekt Katowice, 2023.
36. Report of the National Center for Emission Management (KOBiZE) titled “CO₂, SO₂, NO_x, CO and total dust emission factors for electricity based on the information contained in the national database on greenhouse gases and other substances emissions for 2021”
37. Report on preliminary seismicity assessment for the nuclear facility (city of Ostrołęka, Ostrołęka district) Institute of Geophysics of the Polish Academy of Sciences, Warsaw, April 2023
38. Regionalizacja geobotaniczna Polski (Geobotanical regionalization of Poland), IGiPZ PAN, J. M. Matuszkiewicz, Warsaw 2008
39. Regionalizacja przyrodniczo-leśna Polski 2010 (Nature and forest regionalization of Poland), R. Zielony, A. Kliczkowska, Warsaw, November 2012

40. Regionalna geografia fizyczna Polski, karty informacyjne mezoregionów (Regional physical geography of Poland, information sheets of mesoregions) Collective work edited by: A. Richling, J. Solon, A. Macias, J. Balon, J. Borzyszkowski and M. Kistowski, Poznań 2021
41. Ordinance of the Minister of Climate of January 2, 2020 on the waste catalog (Journal of Laws of 2020, item 10)
42. Ordinance of the Minister of Infrastructure of November 4, 2022 on the Water Management Plan in the Vistula River Basin (Journal of Laws of 2023, item 300)
43. Ordinance of the Minister of Infrastructure of February 6, 2003 on occupational health and safety during construction works (Journal of Laws of 2003, No. 47, item 401)
44. Ordinance of the Minister of Development of January 29, 2016 on types and volumes of hazardous substances present in the plant, which decide on classification of a plant as a plant of increased or high risk of major industrial accident (Journal of Laws of 2016, item 138)
45. Ordinance of the Minister of Environment of June 14, 2007 on the permissible noise levels in the environment (Journal of Laws of 2014, item 112)
46. Ordinance of the Minister of Health of December 17, 2019 on the permissible levels of electromagnetic fields in the environment (Journal of Laws of 2019, item 2448)
47. Ordinance of the Council of Ministers on the nuclear safety and radiation protection requirements to be taken into account in the design of a nuclear facility (Journal of Laws of 2012, item 1048)
48. Ordinance of the Council of Ministers of August 10, 2012 on detailed scope of assessment of the land intended for the location of a nuclear facility, cases excluding the possibility of finding the area compliant with the requirements for the location of a nuclear facility and on requirements for the site evaluation report for a nuclear facility (Journal of Laws of 2012, item 1025)
49. Ordinance of the Council of Ministers of September 10, 2019 on projects that may have a significant impact on the environment (Journal of Laws of 2019, item 1839, as amended)
50. Ordinance of the Council of Ministers of December 14, 2015 on radioactive waste and spent nuclear fuel (Journal of Laws of 2022, item 1320)
51. Report on the activities of the President of the Energy Regulatory Office for 2022, April 2023
52. Standard Data Form for Special Protection Areas (SPAs) [online access]: PLB040003, PLB140005, PLB140007, PLB140014, GDEP, accessed June 2023
53. Standard Data Form for Special Protection Areas (SPAs) [online access]: PLH140046, PLH140047, PLH140049, PLH200018, PLH200020, PLH200023, PLH200024, GDEP, accessed June 2023
54. Strategy for the city of Ostrołęka adaptation to climate change by 2025 with a perspective until 2030, Institute of Environmental Protection – National Research Institute, Vista Analyse, edited by D. Kobus, P. Legutko-Kobus, A. Degórska, M. Hajto, A. Kuśmierz, I. Grzegorzczak, A. Romańczak, A. Bojanowicz-Bablok, 2020
55. Strategy for Responsible Development (SRD) until 2020 (with an outlook to 2030)
56. Study of the conditions and directions of spatial development for the City of Ostrołęka, Mayor of Ostrołęka, 2023
57. Szczegółowa mapa geologiczna Polski w skali 1:50 000 (Detailed hydrogeological map of Poland at the scale of 1:50,000), sheet Ostrołęka (333), A. Bałuk, Warsaw, 1989
58. RESOLUTION No 15/2014 of the COUNCIL OF MINISTERS of January 28, 2014 on the long-term program titled “Polish Nuclear Power Program”
59. Resolution No. 529/LV/2021 of the Ostrołęka City Council on the adoption of the “Environmental Protection Program for the City of Ostrołęka for 2021–2027 with a perspective until 2030”, 2023

60. Construction Law Act (Journal of Laws of 2023, item 682, as amended)
61. Geological and Mining Law Act (Journal of Laws of 2023, item 633)
62. Act of April 16, 2004 on nature protection (Journal of Laws of 2022, item 916, as amended)
63. Act of July 20, 2017 – Water Law (Journal of Laws of 2022, item 2625, as amended)
64. Act of April 27, 2001 – Environmental Protection Law (Journal of Laws of 2022, item 2556, as amended)
65. Act of November 29, 2000 – Nuclear Law (Journal of Laws of 2023, item 1173)
66. Act of October 3, 2008 on providing access to information on the environment and its protection, public participation in environmental protection, and on environmental impact assessments (Journal of Laws of 2023, item 1094, as amended)
67. Act of December 14, 2012 on waste (Journal of Laws of 2022, item 699, as amended)
68. Act of April 18, 2002 on the state of natural disaster (Journal of Laws of 2017, item 1897)
69. Emission factor of CO₂, SO₂, NO_x, CO and total dust for electricity based on the information contained in the national database on emissions of greenhouse gases and other substances for 2021
70. Regulation No. 25/2013 of the Regional Director for Environmental Protection in Białystok concerning the adoption of a protection tasks for the Natura 2000 site Ostoja Narwiańska PLH200024, 2013.

Websites:

<http://geologia.pgi.gov.pl>

http://ine.eko.org.pl/index_areas.php?rek=462

http://www.ine.eko.org.pl/index_areas.php?rek=463

LIST OF FIGURES

DRAWING NO.		PAGE
1	Comparison of the structure of electricity generation in 2020–2022 [GWh], (Source: ERO Report 2022)	11
2	Location of Ostrołęka on the map of Poland	19
3	Areas adjacent to the planned Site (Source: own study using Google maps data)	20
4	Location of the power part of the Project (Source: own study using Google maps data)	21
5	Infrastructure corridor – cooling water pipeline (Source: own study using OpenStreetMap data)	22
6	Considered directions for implementation of the grid connection (Source: own study using Google maps data)	24
7	Land cover forms (Source: own study using Corine Land Cover 2018)	26
8	Countries with the largest number of nuclear power plants as of 2011 (Source: World Nuclear Industry Status Report 2022, www.statista.com)	29
9	The schematic view of the fission reaction (“Energia jądrowa i promieniotwórczość” [Nuclear Energy and Radioactivity], A. Czerwiński, Oficyna Edukacyjna Krzysztof Pazdro, Warsaw 1998, http://www.pazdro.com.pl/)	30
10	General process flow diagram of a NPP with a BWR reactor (https://www.nrc.gov)	31
11	Example location of power plant buildings (Source: GE-Hitachi)	37
12	Visualization of a power plant with the BWRX-300 reactor (Source: GE-Hitachi)	38
13	Reactor Building – Schematic cross-section through the primary containment of the BWRX-300 reactor (Source: GE Hitachi)	39
14	Example of a steam turbine (Source: GE-Hitachi)	40
15	Simplified diagram of the BWRX-300 systems (Source: GE-Hitachi)	42
16	Topography of the Site Area (Source: Own study using the data from the Digital Elevation Model – geoportal, OpenStreetMap)	50
17	A fragment of a geological transect (Source: Detailed Geological Map of Poland, sheet Ostrołęka)	51
18	No landslides in the analyzed Site Area for the planned location of the nuclear facility (according to SOPO access May 17, 2023) with the approximate location of the nuclear facility and CCGT marked (Source: Ostrołęka site analysis final report, 2023, Energoprojekt Katowice)	53
19	Location of deposits in the Site Area (Source: own study using OpenStreetMap data, CBDG database – mining lands)	56
20	Mining lands in the Site Region and Area (Source: own study using OpenStreetMap and CBDG data – mining lands)	58
21	Site Region in view of the major groundwater reservoirs (Source: own study using data from the Public Information Bulletin of the Central Geological Database of the Polish	63

	Geological Institute, OpenStreetMap)	
22	Groundwater Bodies (Source: own study using materials from https://apgw.gov.pl and OpenStreetMap)	64
23	Planned site on the background of SWBs (Source: own study using materials from https://apgw.gov.pl)	69
24	Flood risk map 0.2% (a 500-year flood) for the Site Area in the case of a flood control dyke destruction (source: own study using OpenStreetMap and data from the Flood Risk Map)	70
25	Flood Risk Map for the Site Area in the case of a flood control dyke destruction (source: own study using OpenStreetMap and data from the Central Geological Database)	71
26	Risk of flooding in the Site Area (Source: own study using data provided by the Polish Geological Institute – National Research Institute and OpenStreetMap)	72
27	Forest and wooded areas within the planned Project (Source: own study using BDOT10k data, OpenStreetMap)	75
28	Location area against the results of the survey of natural habitats of the State Forests (Source: own study using data from the Directorate of State Forests – results of the State Forests habitat survey of 2022, OpenStreetMap base map)	76
29	Comparison of 50 Hz electric field strengths (kV/m) generated by household electric appliances and extra high voltage overhead lines (Source: http://budowalini400kv.pl/)	97
30	Comparison of 50 Hz electric field strengths (A/m) generated by household electric appliances and extra high voltage overhead lines (Source: http://budowalini400kv.pl/).	98
31	Planned site of NPP against the background of Natura 2000 sites (Source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)	106
32	Planned Site of the NPP against the background of the Landscape Parks (Source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)	112
33	Planned Site of the NPP against the background of the Protected Landscape Areas (Source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)	113
34	Nature reserves in the Site Region. The numerical designations are explained in Table 18 (source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)	114

LIST OF TABLES

TABLE NO.		PAGE
1	Glossary of acronyms and definitions	6
2	Contents of the PIS in accordance with Article 62a of the EIA Act.	9
3	Emission factors expressed in [kg/MWh] for electricity generated in fuel combustion plants in 2021 (Source: KOBiZE report: CO ₂ , SO ₂ , NO _x , CO and total dust emission factor for electricity based on the information contained in the national database on greenhouse gases and other substances emissions for 2021).	12
4	CO ₂ emissions by source (Source: own study)	12
5	Estimated surface area of real property required for the construction of a 300 MWe nuclear power plant using BWRX-300 technology (based on data provided by technology supplier GE-Hitachi, BWRX-300 Generic Plant Parameter Envelope 005N3953 Rev. D).	26
6	Example of dimensions of the main buildings of the BWRX-300 power unit (Source: technology supplier GE-Hitachi)	38
7	Tectonic features of the Site Region and its surroundings (Source: Report on preliminary seismicity assessment for the nuclear facility (Ostrołęka, Ostrołęka district) Institute of Geophysics of the Polish Academy of Sciences, Warsaw, 2023).	54
8	Groundwater Bodies within and adjacent to the area of the planned Project (Source: https://apgw.gov.pl/).	63
9	Characteristic flows recorded at existing hydrological stations in the Site Area (Source: https://hydro.imgw.pl/)	65
10	Average characteristic flows from the multi-year period and the year 2022 recorded at the Ostrołęka (Narew) streamgage (Source: Bulletin of the National Hydrological and Meteorological Authority – 2022)	66
11	Characteristics of surface water bodies identified in the Site Area (Source: https://apgw.gov.pl/)	67
12	The main pressures to which the Surface Water Bodies present in the Site Area are subject (Source: https://apgw.gov.pl/)	67
13	Historical meteorological data – Ostrołęka station	73
14	Estimated quantity of materials and raw materials that are the basic materials used to build the 300 MW nuclear power plant with the BWRX-300 reactor (Source: technology supplier: GE-Hitachi)	77
15	Estimated quantity of water used for the construction of the 300 MW nuclear power plant with the BWRX-300 reactor (Source: technology supplier GE-Hitachi).	78
16	Estimated quantity of materials and raw materials used during normal operation of the 300 MW nuclear power plant with the BWRX-300 reactor (Source: technology supplier GE-Hitachi).	79
17	Estimated type and quantity of chemicals used in the process of raw water treatment during normal operation of the 300 MW nuclear power plant with the BWRX-300 reactor. Data for an open cooling system (Source: technology provider GE-Hitachi).	80

18	Expected noise sources and estimated noise emissions during normal operation of the 300 MW nuclear power plant with the BWRX-300 reactor. Data for the cooling system with a mechanical draft cooling tower (Source: technology provider GE-Hitachi).	94
19	Expected annual emissions from diesel power generators (source: technology supplier GE-Hitachi).	94
20	Frequency range of electromagnetic fields, for which physical parameters are determined, characterizing electromagnetic field impact on the environment, for areas intended for residential development, and permissible electromagnetic field levels, characterized by permissible values of physical parameters, for areas intended for residential development (Source: Ordinance of the Minister of Health of December 17, 2019 on permissible electromagnetic field levels in the environment).	95
21	Frequency range of electromagnetic fields for which physical parameters are determined, characterizing the impact of electromagnetic fields on the environment, for places accessible to the public and permissible levels of electromagnetic fields, characterized by permissible values of physical parameters, for places accessible to the public (Source: Ordinance of the Minister of the Health of December 17, 2019 on permissible levels of electromagnetic fields in the environment).	96
22	A list of Natura 2000 sites occurring in the Site Area and in the Site Region and their distance from the boundaries of the planned nuclear facility site (Source: Ostrołęka site analysis final report, Energoprojekt Katowice, 2023)	107
23	Summary of nature reserves occurring in the Site Region and their distance from the Boundaries of the planned nuclear facility site	114
24	Classification of waste likely to be generated on the investment project site at the construction stage (waste classification in accordance with the Waste Act (Journal of Laws of 2022, item 699, as amended)).	121
25	Classification of waste likely to be generated on the investment project site at the NPP operation stage (waste classification in accordance with the Waste Act (Journal of Laws of 2022, item 699, as amended)).	122